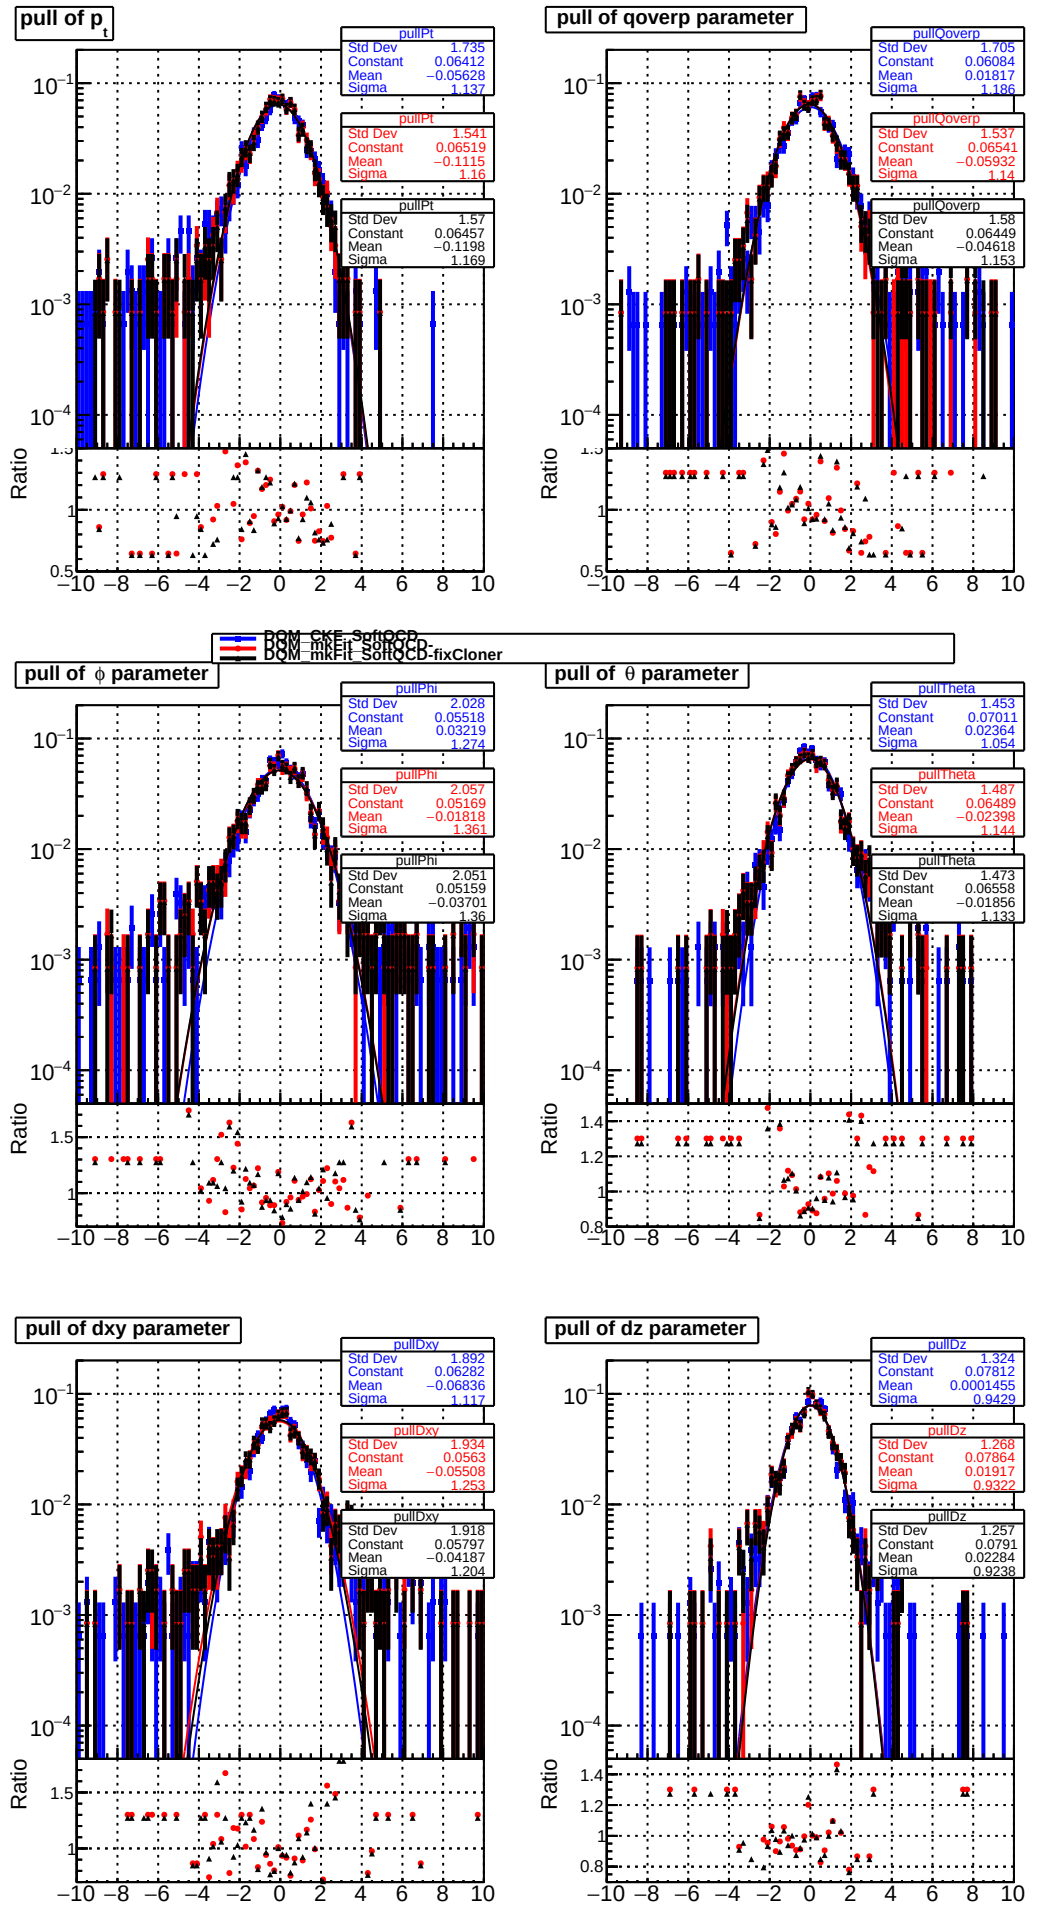
pull of p_t
pullPt
Std Dev 1.735
Constant 0.06412
Mean −0.05628
Sigma 1.137
pullPt
Std Dev 1.541
Constant 0.06519
Mean −0.1115
Sigma 1.16
pullPt
Std Dev 1.57
Constant 0.06457
Mean −0.1198
Sigma 1.169
pull of qoverp parameter
pullQoverp
Std Dev 1.705
Constant 0.06084
Mean 0.01817
Sigma 1.186
pullQoverp
Std Dev 1.537
Constant 0.06541
Mean −0.05932
Sigma 1.14
pullQoverp
Std Dev 1.58
Constant 0.06449
Mean −0.04618
Sigma 1.153
DQM_CKF_SoftQCD
DQM_mkFit_SoftQCD
DQM_mkFit_SoftQCD-fixCloner
pull of ϕ parameter
pullPhi
Std Dev 2.028
Constant 0.05518
Mean 0.03219
Sigma 1.274
pullPhi
Std Dev 2.057
Constant 0.05169
Mean −0.01818
Sigma 1.361
pullPhi
Std Dev 2.051
Constant 0.05159
Mean −0.03701
Sigma 1.36
pull of θ parameter
pullTheta
Std Dev 1.453
Constant 0.07011
Mean 0.02364
Sigma 1.054
pullTheta
Std Dev 1.487
Constant 0.06489
Mean −0.02398
Sigma 1.144
pullTheta
Std Dev 1.473
Constant 0.06558
Mean −0.01856
Sigma 1.133
pull of dxy parameter
pullDxy
Std Dev 1.892
Constant 0.06282
Mean −0.06836
Sigma 1.117
pullDxy
Std Dev 1.934
Constant 0.0563
Mean −0.05508
Sigma 1.253
pullDxy
Std Dev 1.918
Constant 0.05797
Mean −0.04187
Sigma 1.204
pull of dz parameter
pullDz
Std Dev 1.324
Constant 0.07812
Mean 0.0001455
Sigma 0.9429
pullDz
Std Dev 1.268
Constant 0.07864
Mean 0.01917
Sigma 0.9322
pullDz
Std Dev 1.257
Constant 0.0791
Mean 0.02284
Sigma 0.9238
Ratio