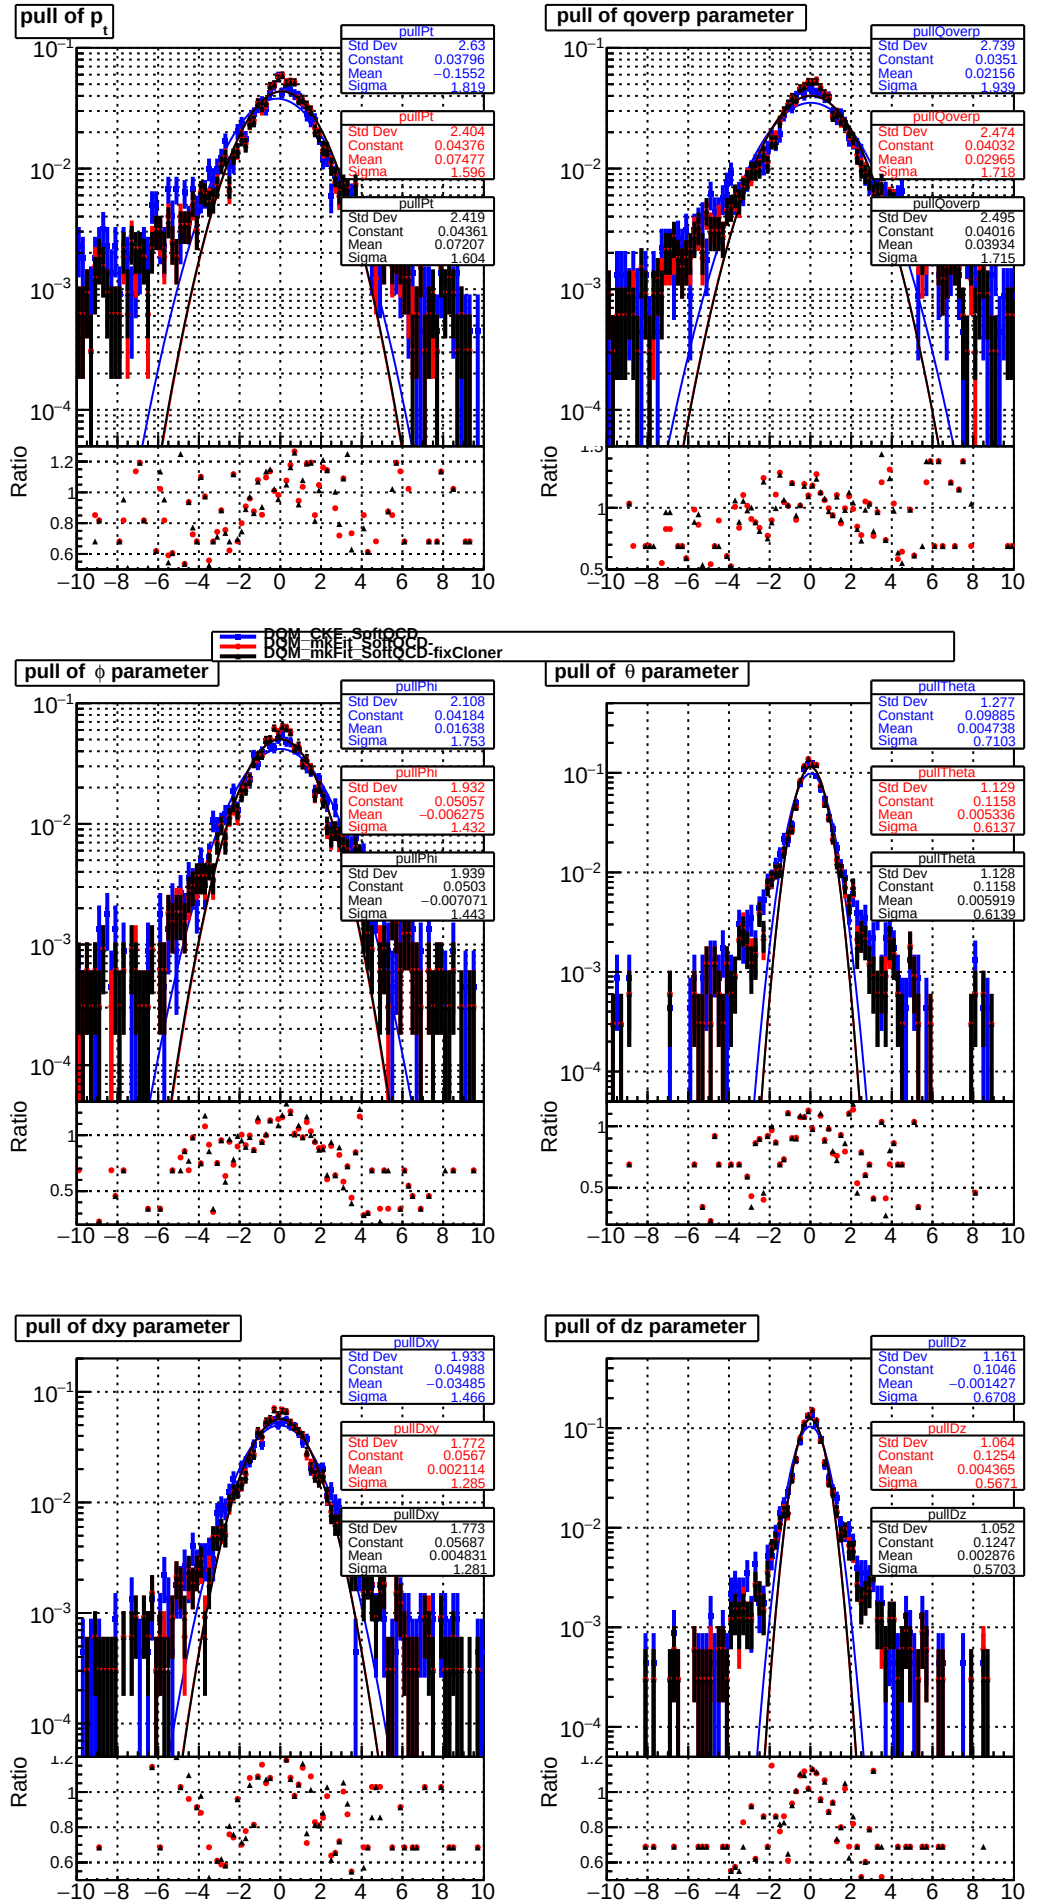
pull of p_t
pullPt
Std Dev 2.63
Constant 0.03796
Mean −0.1552
Sigma 1.819
pullPt
Std Dev 2.404
Constant 0.04376
Mean 0.07477
Sigma 1.596
pullPt
Std Dev 2.419
Constant 0.04361
Mean 0.07207
Sigma 1.604
pull of qoverp parameter
pullQoverp
Std Dev 2.739
Constant 0.0351
Mean 0.02156
Sigma 1.939
pullQoverp
Std Dev 2.474
Constant 0.04032
Mean 0.02965
Sigma 1.718
pullQoverp
Std Dev 2.495
Constant 0.04016
Mean 0.03934
Sigma 1.715
DQM_CKF_SoftQCD
DQM_mkFit_SoftQCD
DQM_mkFit_SoftQCD-fixCloner
pull of ϕ parameter
pullPhi
Std Dev 2.108
Constant 0.04184
Mean 0.01638
Sigma 1.753
pullPhi
Std Dev 1.932
Constant 0.05057
Mean −0.006275
Sigma 1.432
pullPhi
Std Dev 1.939
Constant 0.0503
Mean −0.007071
Sigma 1.443
pull of θ parameter
pullTheta
Std Dev 1.277
Constant 0.09885
Mean 0.004738
Sigma 0.7103
pullTheta
Std Dev 1.129
Constant 0.1158
Mean 0.005336
Sigma 0.6137
pullTheta
Std Dev 1.128
Constant 0.1158
Mean 0.005919
Sigma 0.6139
pull of dxy parameter
pullDxy
Std Dev 1.933
Constant 0.04988
Mean −0.03485
Sigma 1.466
pullDxy
Std Dev 1.772
Constant 0.0567
Mean 0.002114
Sigma 1.285
pullDxy
Std Dev 1.773
Constant 0.05687
Mean 0.004831
Sigma 1.281
pull of dz parameter
pullDz
Std Dev 1.161
Constant 0.1046
Mean −0.001427
Sigma 0.6708
pullDz
Std Dev 1.064
Constant 0.1254
Mean 0.004365
Sigma 0.5671
pullDz
Std Dev 1.052
Constant 0.1247
Mean 0.002876
Sigma 0.5703
Ratio