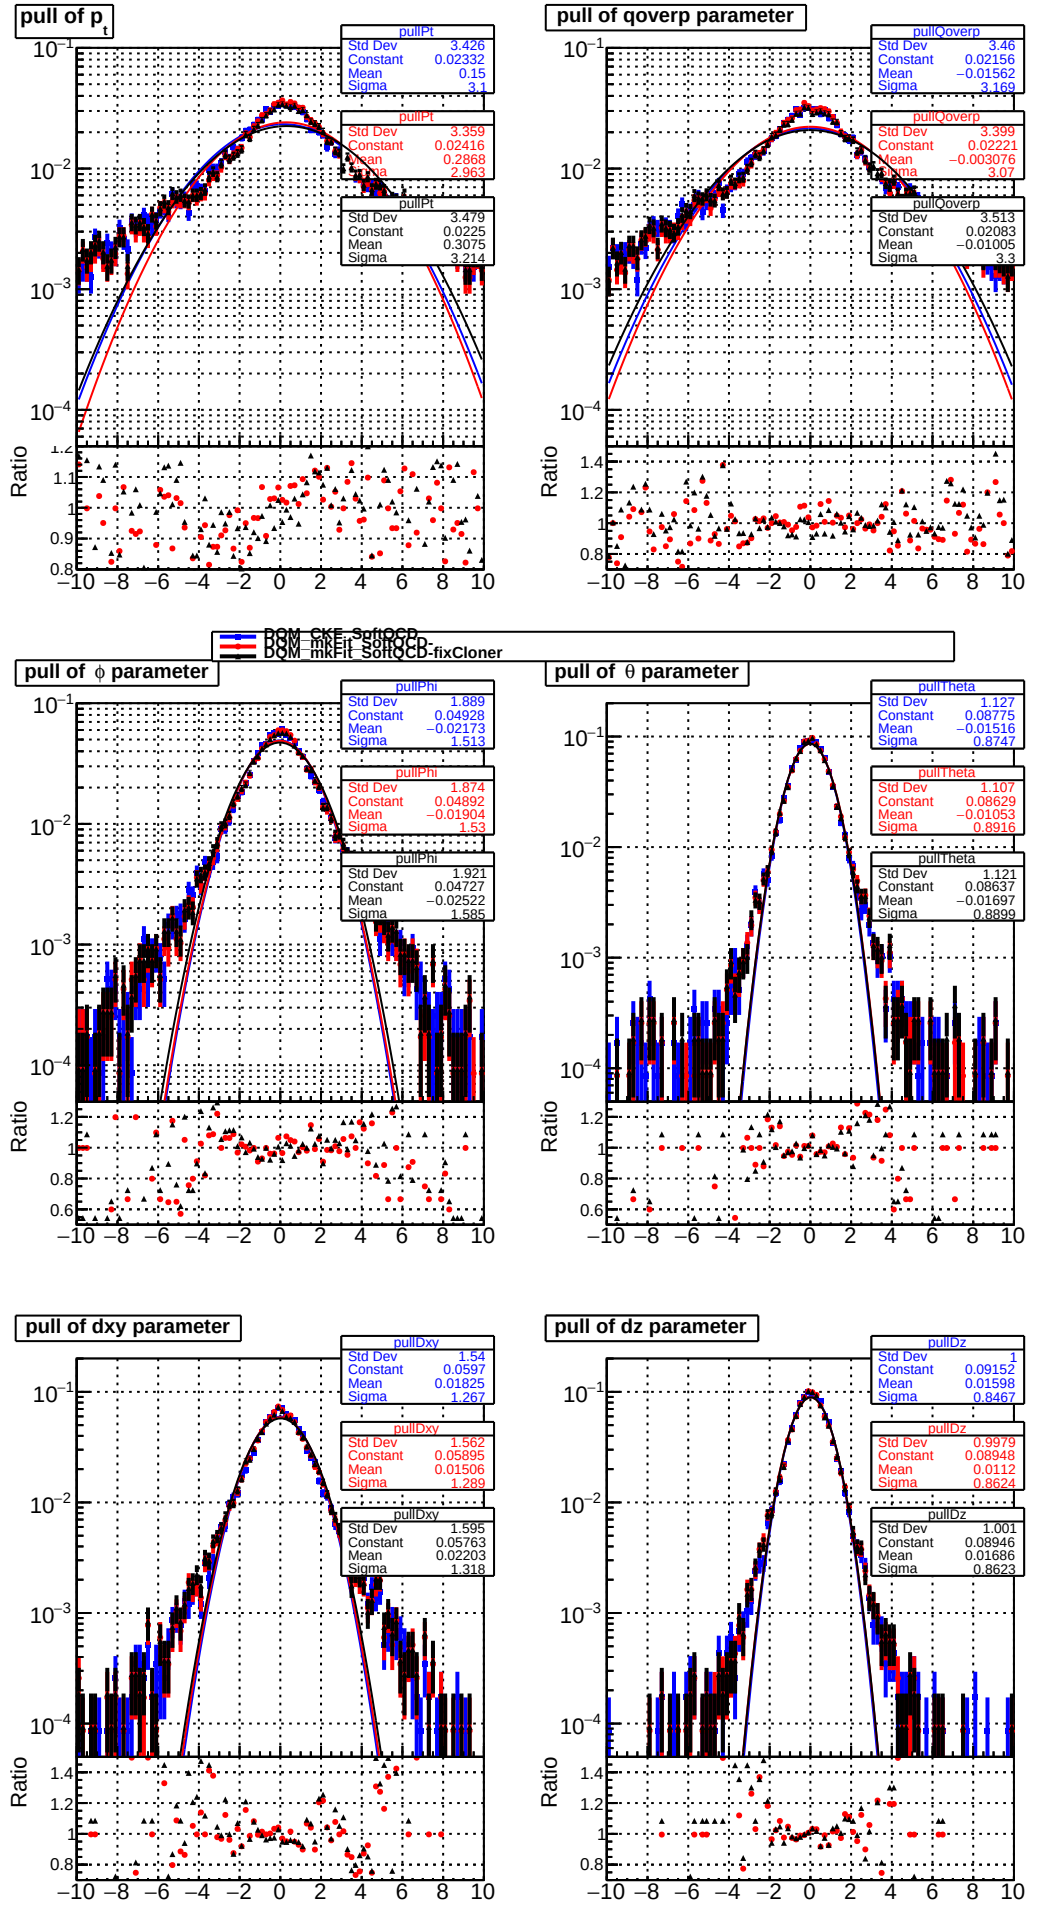
pull of $p_t$
pullPt
Std Dev 3.426
Constant 0.02332
Mean 0.15
Sigma 3.1
pullPt
Std Dev 3.359
Constant 0.02416
Mean 0.2868
Sigma 2.963
pullPt
Std Dev 3.479
Constant 0.0225
Mean 0.3075
Sigma 3.214
pull of qoverp parameter
pullQoverp
Std Dev 3.46
Constant 0.02156
Mean −0.01562
Sigma 3.169
pullQoverp
Std Dev 3.399
Constant 0.02221
Mean −0.003076
Sigma 3.07
pullQoverp
Std Dev 3.513
Constant 0.02083
Mean −0.01005
Sigma 3.3
DQM_CKF_SoftQCD
DQM_mkFit_SoftQCD
DQM_mkFit_SoftQCD-fixCloner
pull of ϕ parameter
pullPhi
Std Dev 1.889
Constant 0.04928
Mean −0.02173
Sigma 1.513
pullPhi
Std Dev 1.874
Constant 0.04892
Mean −0.01904
Sigma 1.53
pullPhi
Std Dev 1.921
Constant 0.04727
Mean −0.02522
Sigma 1.585
pull of θ parameter
pullTheta
Std Dev 1.127
Constant 0.08775
Mean −0.01516
Sigma 0.8747
pullTheta
Std Dev 1.107
Constant 0.08629
Mean −0.01053
Sigma 0.8916
pullTheta
Std Dev 1.121
Constant 0.08637
Mean −0.01697
Sigma 0.8899
pull of dxy parameter
pullDxy
Std Dev 1.54
Constant 0.0597
Mean 0.01825
Sigma 1.267
pullDxy
Std Dev 1.562
Constant 0.05895
Mean 0.01506
Sigma 1.289
pullDxy
Std Dev 1.595
Constant 0.05763
Mean 0.02203
Sigma 1.318
pull of dz parameter
pullDz
Std Dev 1
Constant 0.09152
Mean 0.01598
Sigma 0.8467
pullDz
Std Dev 0.9979
Constant 0.08948
Mean 0.0112
Sigma 0.8624
pullDz
Std Dev 1.001
Constant 0.08946
Mean 0.01686
Sigma 0.8623
Ratio