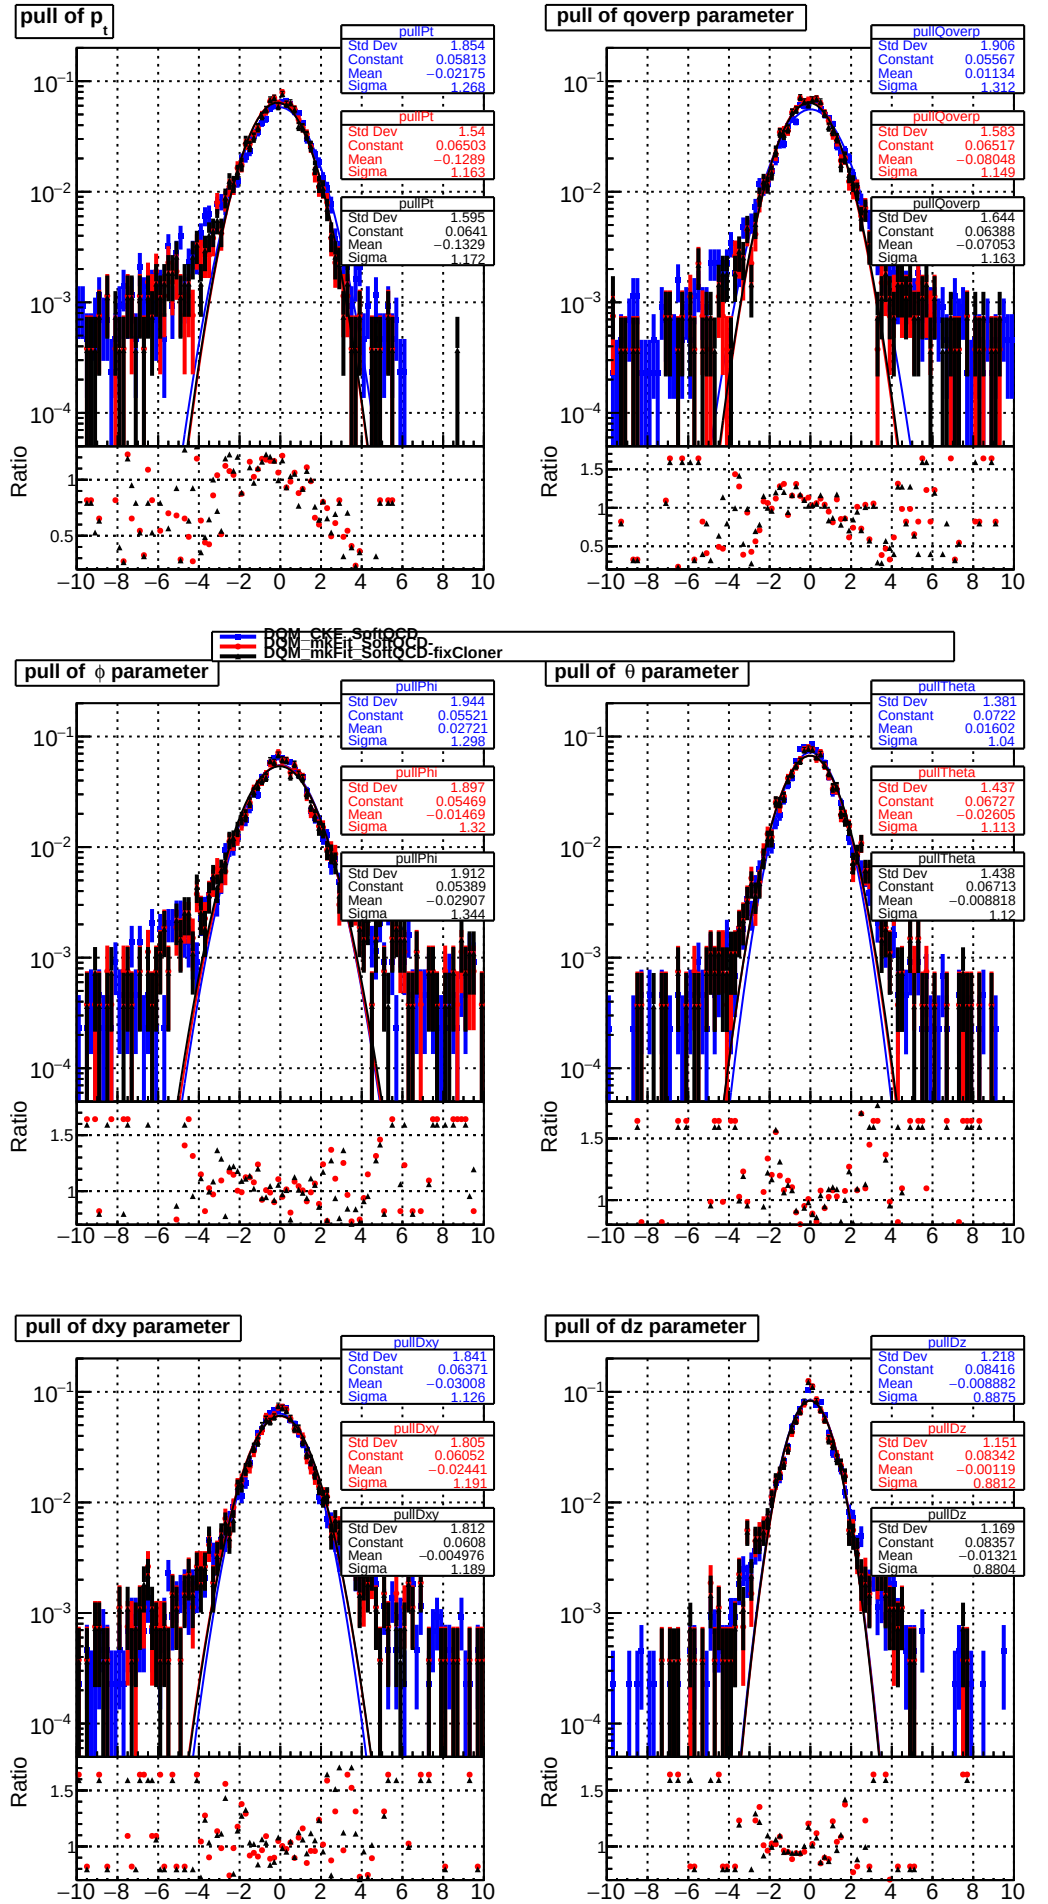
pull of p_t
pullPt
Std Dev 1.854
Constant 0.05813
Mean −0.02175
Sigma 1.268
pullPt
Std Dev 1.54
Constant 0.06503
Mean −0.1289
Sigma 1.163
pullPt
Std Dev 1.595
Constant 0.0641
Mean −0.1329
Sigma 1.172
pull of qoverp parameter
pullQoverp
Std Dev 1.906
Constant 0.05567
Mean 0.01134
Sigma 1.312
pullQoverp
Std Dev 1.583
Constant 0.06517
Mean −0.08048
Sigma 1.149
pullQoverp
Std Dev 1.644
Constant 0.06388
Mean −0.07053
Sigma 1.163
DQM_CKF_SoftQCD
DQM_mkFit_SoftQCD
DQM_mkFit_SoftQCD-fixCloner
pull of ϕ parameter
pullPhi
Std Dev 1.944
Constant 0.05521
Mean 0.02721
Sigma 1.298
pullPhi
Std Dev 1.897
Constant 0.05469
Mean −0.01469
Sigma 1.32
pullPhi
Std Dev 1.912
Constant 0.05389
Mean −0.02907
Sigma 1.344
pull of θ parameter
pullTheta
Std Dev 1.381
Constant 0.0722
Mean 0.01602
Sigma 1.04
pullTheta
Std Dev 1.437
Constant 0.06727
Mean −0.02605
Sigma 1.113
pullTheta
Std Dev 1.438
Constant 0.06713
Mean −0.008818
Sigma 1.12
pull of dxy parameter
pullDxy
Std Dev 1.841
Constant 0.06371
Mean −0.03008
Sigma 1.126
pullDxy
Std Dev 1.805
Constant 0.06052
Mean −0.02441
Sigma 1.191
pullDxy
Std Dev 1.812
Constant 0.0608
Mean −0.004976
Sigma 1.189
pull of dz parameter
pullDz
Std Dev 1.218
Constant 0.08416
Mean −0.008882
Sigma 0.8875
pullDz
Std Dev 1.151
Constant 0.08342
Mean −0.00119
Sigma 0.8812
pullDz
Std Dev 1.169
Constant 0.08357
Mean −0.01321
Sigma 0.8804
Ratio