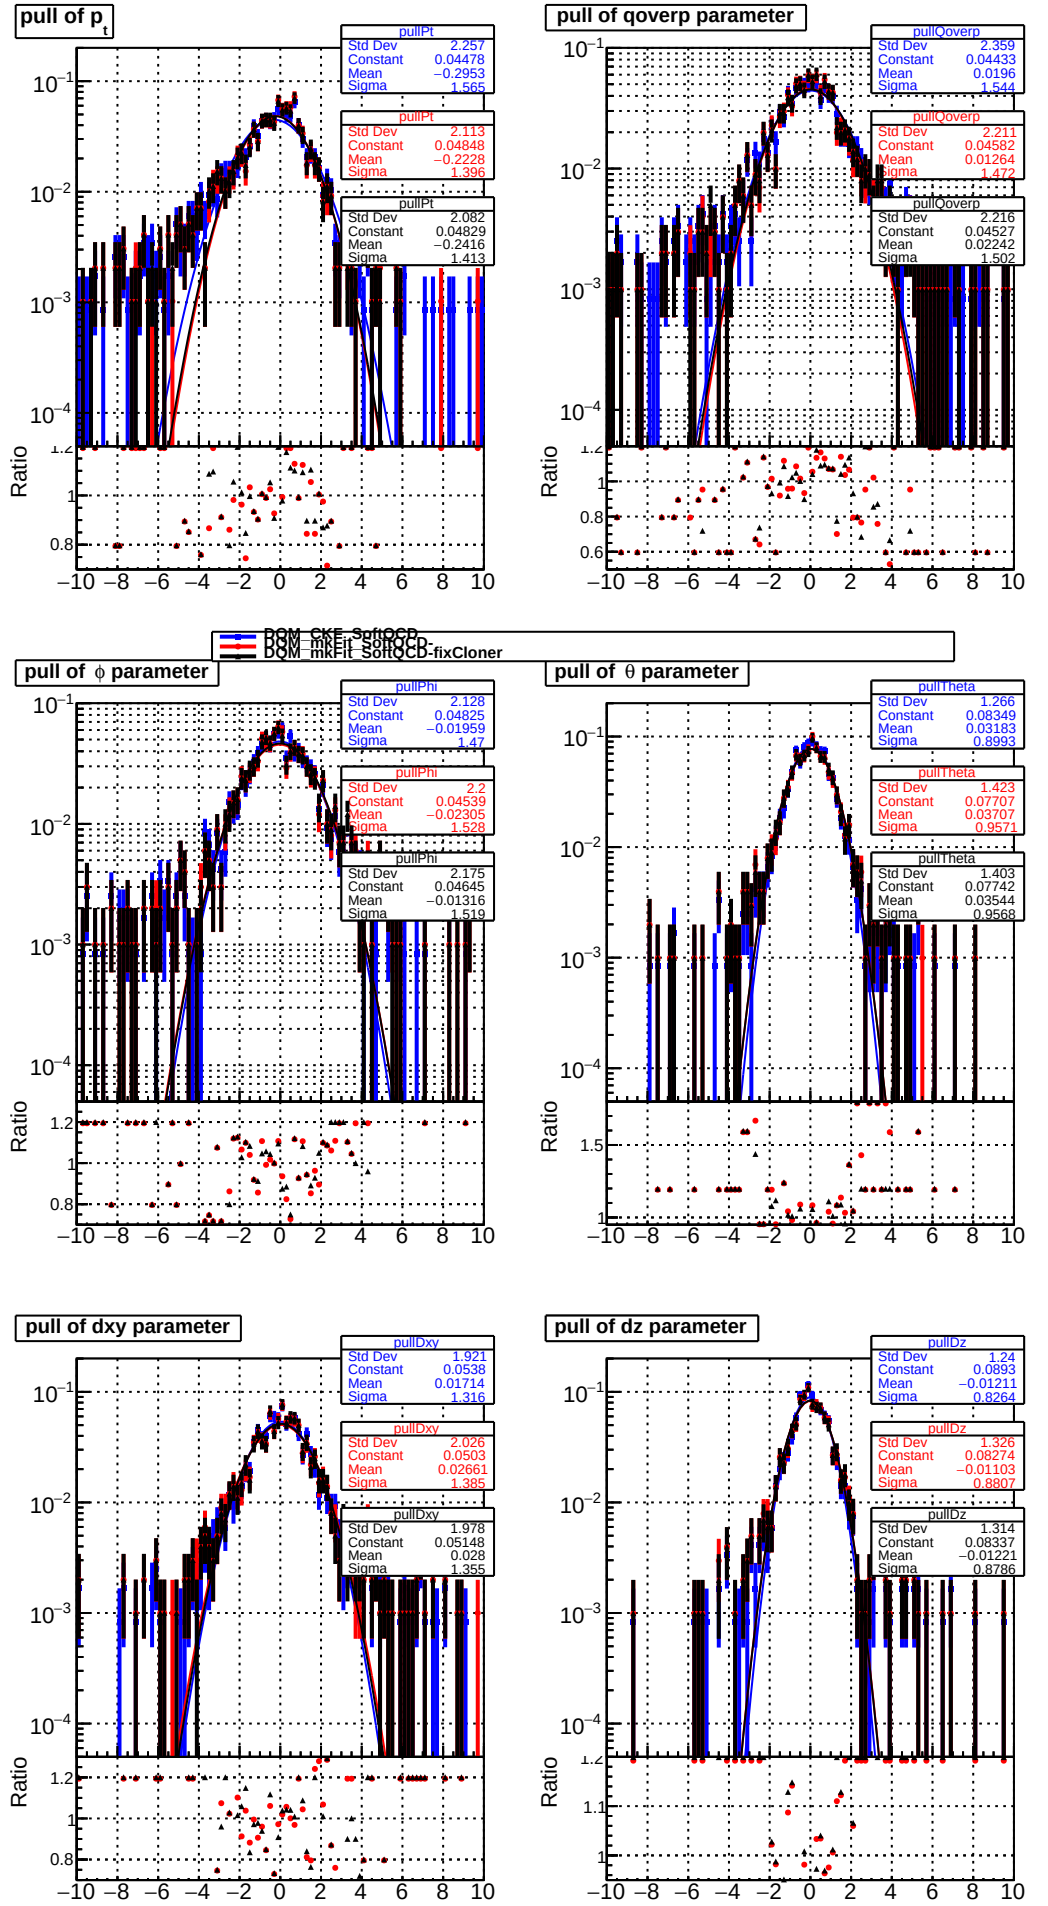
pull of p_t
pullPt
Std Dev 2.257
Constant 0.04478
Mean −0.2953
Sigma 1.565
pullPt
Std Dev 2.113
Constant 0.04848
Mean −0.2228
Sigma 1.396
pullPt
Std Dev 2.082
Constant 0.04829
Mean −0.2416
Sigma 1.413
pull of qoverp parameter
pullQoverp
Std Dev 2.359
Constant 0.04433
Mean 0.0196
Sigma 1.544
pullQoverp
Std Dev 2.211
Constant 0.04582
Mean 0.01264
Sigma 1.472
pullQoverp
Std Dev 2.216
Constant 0.04527
Mean 0.02242
Sigma 1.502
DQM_CKF_SoftQCD
DQM_mkFit_SoftQCD
DQM_mkFit_SoftQCD-fixCloner
pull of ϕ parameter
pullPhi
Std Dev 2.128
Constant 0.04825
Mean −0.01959
Sigma 1.47
pullPhi
Std Dev 2.2
Constant 0.04539
Mean −0.02305
Sigma 1.528
pullPhi
Std Dev 2.175
Constant 0.04645
Mean −0.01316
Sigma 1.519
pull of θ parameter
pullTheta
Std Dev 1.266
Constant 0.08349
Mean 0.03183
Sigma 0.8993
pullTheta
Std Dev 1.423
Constant 0.07707
Mean 0.03707
Sigma 0.9571
pullTheta
Std Dev 1.403
Constant 0.07742
Mean 0.03544
Sigma 0.9568
pull of dxy parameter
pullDxy
Std Dev 1.921
Constant 0.0538
Mean 0.01714
Sigma 1.316
pullDxy
Std Dev 2.026
Constant 0.0503
Mean 0.02661
Sigma 1.385
pullDxy
Std Dev 1.978
Constant 0.05148
Mean 0.028
Sigma 1.355
pull of dz parameter
pullDz
Std Dev 1.24
Constant 0.0893
Mean −0.01211
Sigma 0.8264
pullDz
Std Dev 1.326
Constant 0.08274
Mean −0.01103
Sigma 0.8807
pullDz
Std Dev 1.314
Constant 0.08337
Mean −0.01221
Sigma 0.8786
Ratio