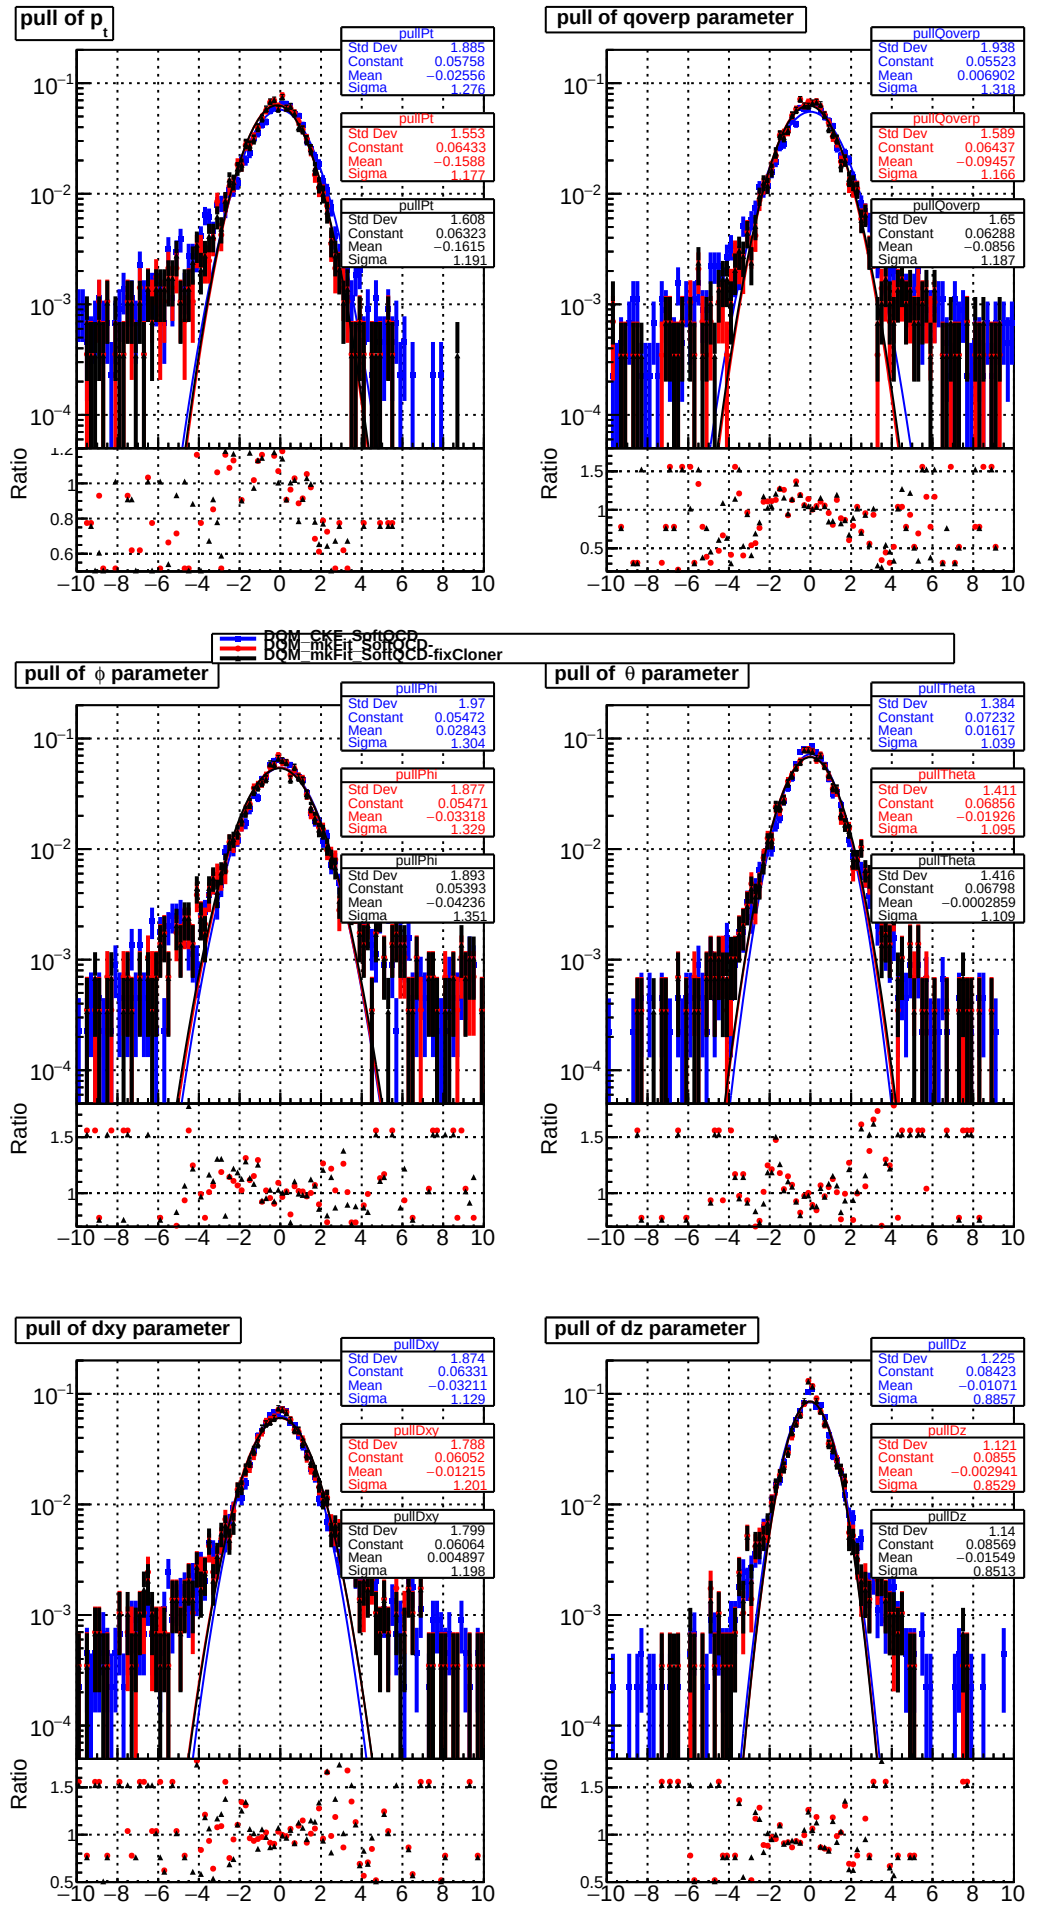
pull of p_t
pullPt
Std Dev 1.885
Constant 0.05758
Mean −0.02556
Sigma 1.276
pullPt
Std Dev 1.553
Constant 0.06433
Mean −0.1588
Sigma 1.177
pullPt
Std Dev 1.608
Constant 0.06323
Mean −0.1615
Sigma 1.191
pull of qoverp parameter
pullQoverp
Std Dev 1.938
Constant 0.05523
Mean 0.006902
Sigma 1.318
pullQoverp
Std Dev 1.589
Constant 0.06437
Mean −0.09457
Sigma 1.166
pullQoverp
Std Dev 1.65
Constant 0.06288
Mean −0.0856
Sigma 1.187
DQM_CKF_SoftQCD
DQM_mkFit_SoftQCD
DQM_mkFit_SoftQCD-fixCloner
pull of ϕ parameter
pullPhi
Std Dev 1.97
Constant 0.05472
Mean 0.02843
Sigma 1.304
pullPhi
Std Dev 1.877
Constant 0.05471
Mean −0.03318
Sigma 1.329
pullPhi
Std Dev 1.893
Constant 0.05393
Mean −0.04236
Sigma 1.351
pull of θ parameter
pullTheta
Std Dev 1.384
Constant 0.07232
Mean 0.01617
Sigma 1.039
pullTheta
Std Dev 1.411
Constant 0.06856
Mean −0.01926
Sigma 1.095
pullTheta
Std Dev 1.416
Constant 0.06798
Mean −0.0002859
Sigma 1.109
pull of dxy parameter
pullDxy
Std Dev 1.874
Constant 0.06331
Mean −0.03211
Sigma 1.129
pullDxy
Std Dev 1.788
Constant 0.06052
Mean −0.01215
Sigma 1.201
pullDxy
Std Dev 1.799
Constant 0.06064
Mean 0.004897
Sigma 1.198
pull of dz parameter
pullDz
Std Dev 1.225
Constant 0.08423
Mean −0.01071
Sigma 0.8857
pullDz
Std Dev 1.121
Constant 0.0855
Mean −0.002941
Sigma 0.8529
pullDz
Std Dev 1.14
Constant 0.08569
Mean −0.01549
Sigma 0.8513
Ratio