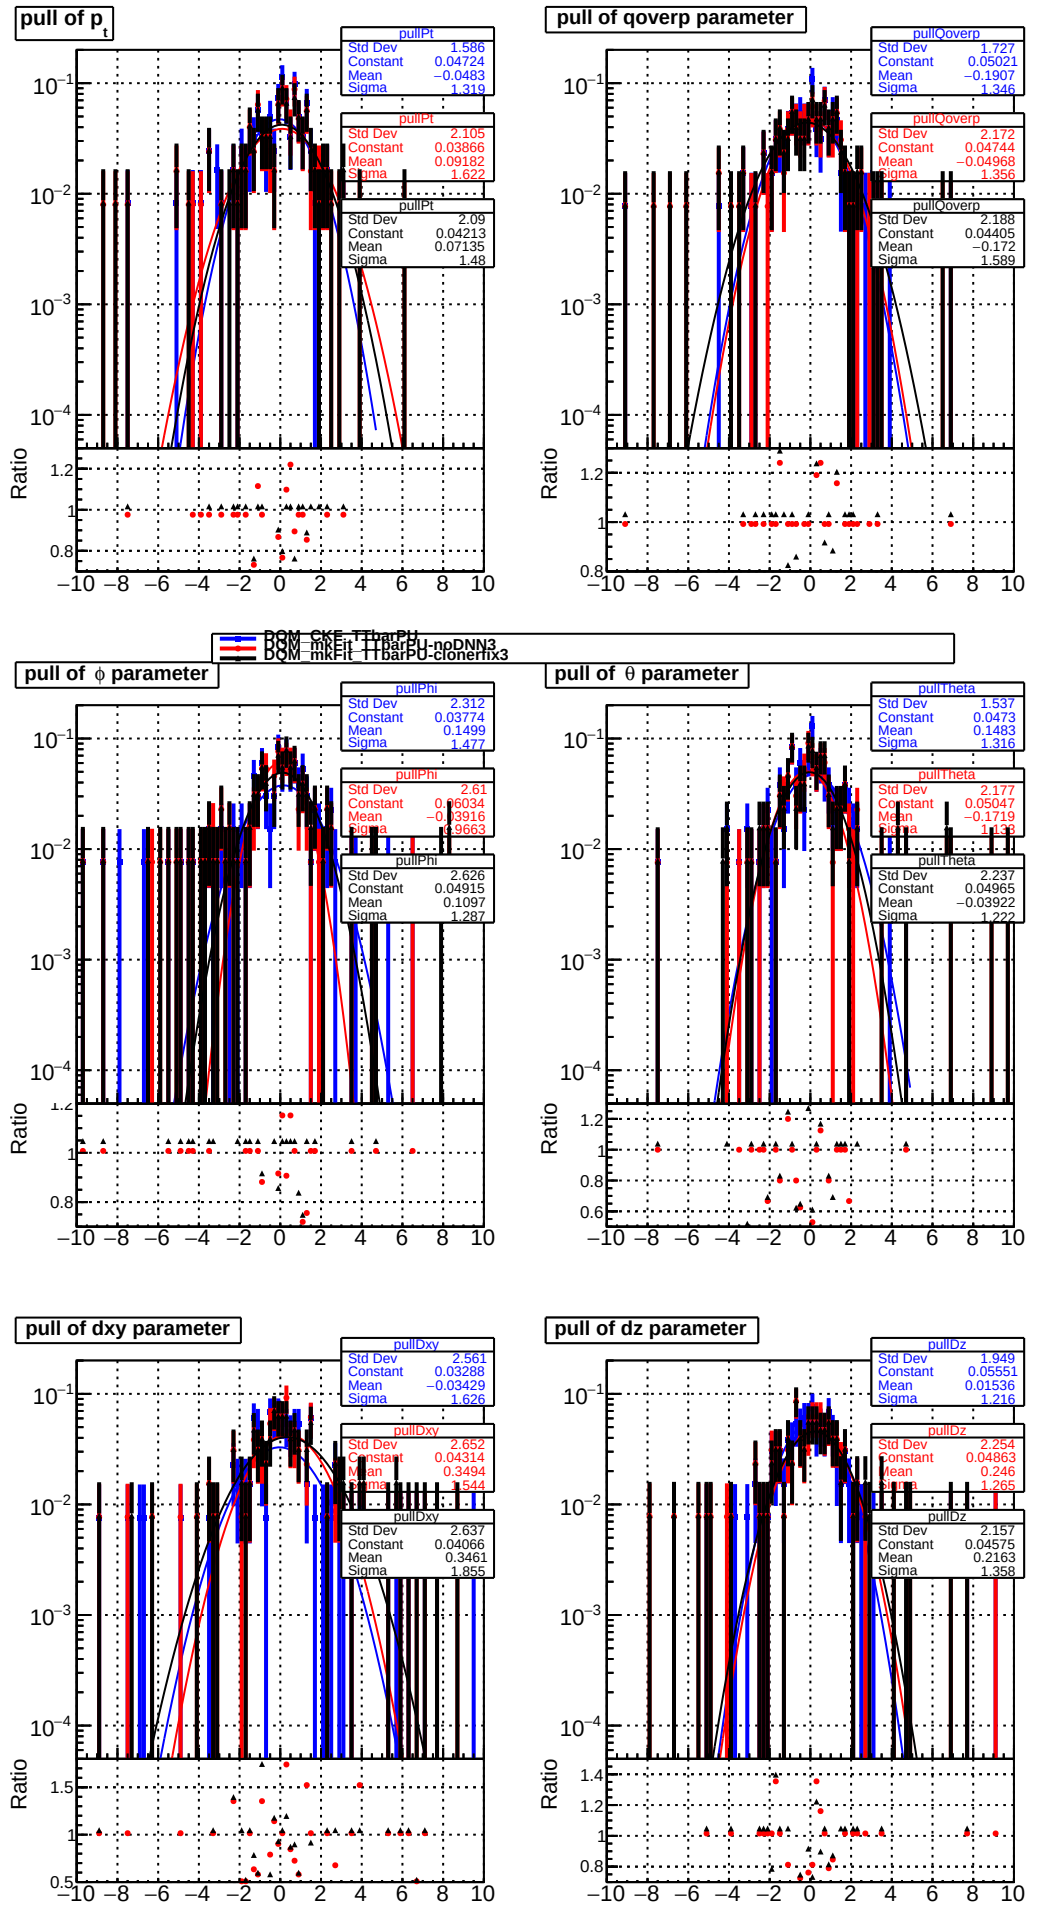
pull of p_t
pullPt
Std Dev 1.586
Constant 0.04724
Mean −0.0483
Sigma 1.319
pullPt
Std Dev 2.105
Constant 0.03866
Mean 0.09182
Sigma 1.622
pullPt
Std Dev 2.09
Constant 0.04213
Mean 0.07135
Sigma 1.48
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.727
Constant 0.05021
Mean −0.1907
Sigma 1.346
pullQoverp
Std Dev 2.172
Constant 0.04744
Mean −0.04968
Sigma 1.356
pullQoverp
Std Dev 2.188
Constant 0.04405
Mean −0.172
Sigma 1.589
Ratio
DQM_CKF_TTbarPU
DQM_mkFit_TTbarPU-noDNN3
DQM_mkFit_TTbarPU-clonerfix3
pull of ϕ parameter
pullPhi
Std Dev 2.312
Constant 0.03774
Mean 0.1499
Sigma 1.477
pullPhi
Std Dev 2.61
Constant 0.06034
Mean −0.03916
Sigma 1.9663
pullPhi
Std Dev 2.626
Constant 0.04915
Mean 0.1097
Sigma 1.287
Ratio
pull of θ parameter
pullTheta
Std Dev 1.537
Constant 0.0473
Mean 0.1483
Sigma 1.316
pullTheta
Std Dev 2.177
Constant 0.05047
Mean −0.1719
Sigma 1.138
pullTheta
Std Dev 2.237
Constant 0.04965
Mean −0.03922
Sigma 1.222
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.561
Constant 0.03288
Mean −0.03429
Sigma 1.626
pullDxy
Std Dev 2.652
Constant 0.04314
Mean 0.3494
Sigma 1.544
pullDxy
Std Dev 2.637
Constant 0.04066
Mean 0.3461
Sigma 1.855
Ratio
pull of dz parameter
pullDz
Std Dev 1.949
Constant 0.05551
Mean 0.01536
Sigma 1.216
pullDz
Std Dev 2.254
Constant 0.04863
Mean 0.246
Sigma 1.265
pullDz
Std Dev 2.157
Constant 0.04575
Mean 0.2163
Sigma 1.358
Ratio