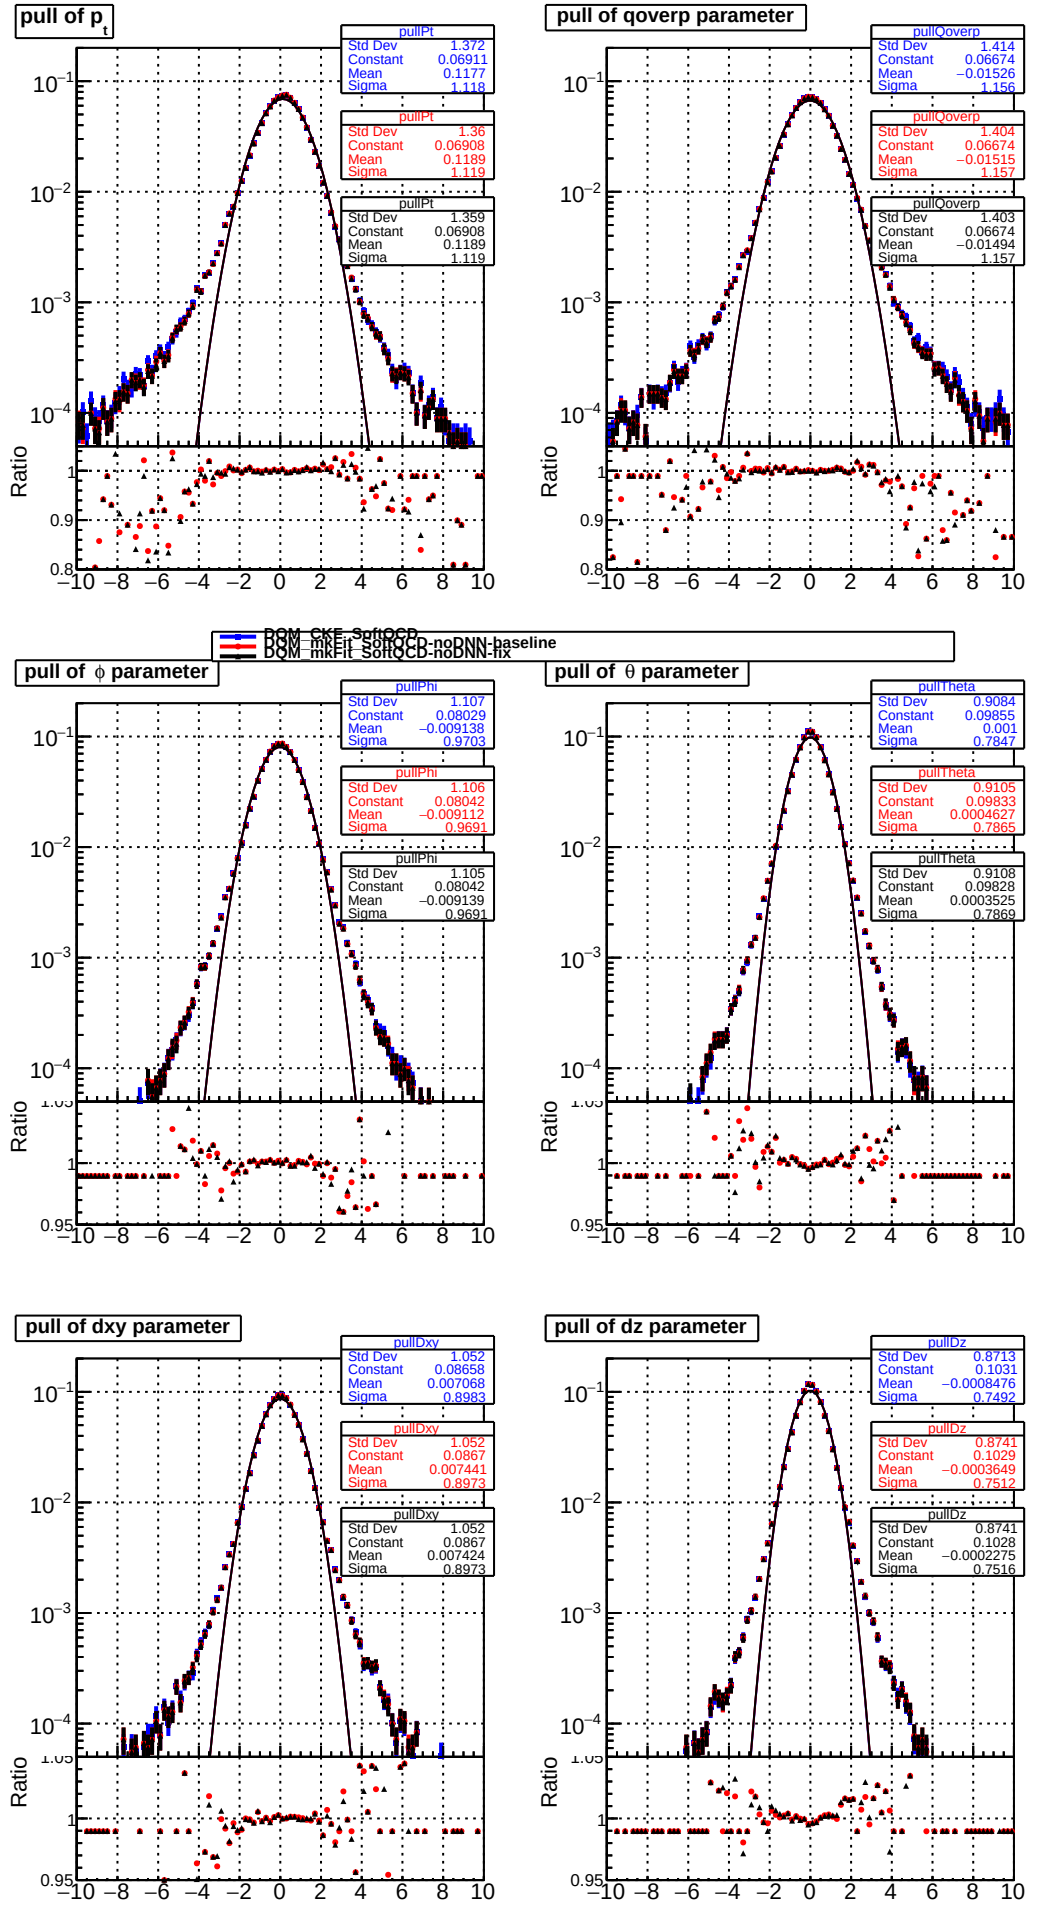
pull of p_t
pullPt
Std Dev 1.372
Constant 0.06911
Mean 0.1177
Sigma 1.118
pullPt
Std Dev 1.36
Constant 0.06908
Mean 0.1189
Sigma 1.119
pullPt
Std Dev 1.359
Constant 0.06908
Mean 0.1189
Sigma 1.119
pull of qoverp parameter
pullQoverp
Std Dev 1.414
Constant 0.06674
Mean −0.01526
Sigma 1.156
pullQoverp
Std Dev 1.404
Constant 0.06674
Mean −0.01515
Sigma 1.157
pullQoverp
Std Dev 1.403
Constant 0.06674
Mean −0.01494
Sigma 1.157
DQM_CKF_SoftQCD
DQM_mkFit_SoftQCD-noDNN-baseline
DQM_mkFit_SoftQCD-noDNN-fix
pull of ϕ parameter
pullPhi
Std Dev 1.107
Constant 0.08029
Mean −0.009138
Sigma 0.9703
pullPhi
Std Dev 1.106
Constant 0.08042
Mean −0.009112
Sigma 0.9691
pullPhi
Std Dev 1.105
Constant 0.08042
Mean −0.009139
Sigma 0.9691
pull of θ parameter
pullTheta
Std Dev 0.9084
Constant 0.09855
Mean 0.001
Sigma 0.7847
pullTheta
Std Dev 0.9105
Constant 0.09833
Mean 0.0004627
Sigma 0.7865
pullTheta
Std Dev 0.9108
Constant 0.09828
Mean 0.0003525
Sigma 0.7869
pull of dxy parameter
pullDxy
Std Dev 1.052
Constant 0.08658
Mean 0.007068
Sigma 0.8983
pullDxy
Std Dev 1.052
Constant 0.0867
Mean 0.007441
Sigma 0.8973
pullDxy
Std Dev 1.052
Constant 0.0867
Mean 0.007424
Sigma 0.8973
pull of dz parameter
pullDz
Std Dev 0.8713
Constant 0.1031
Mean −0.0008476
Sigma 0.7492
pullDz
Std Dev 0.8741
Constant 0.1029
Mean −0.0003649
Sigma 0.7512
pullDz
Std Dev 0.8741
Constant 0.1028
Mean −0.0002275
Sigma 0.7516
Ratio