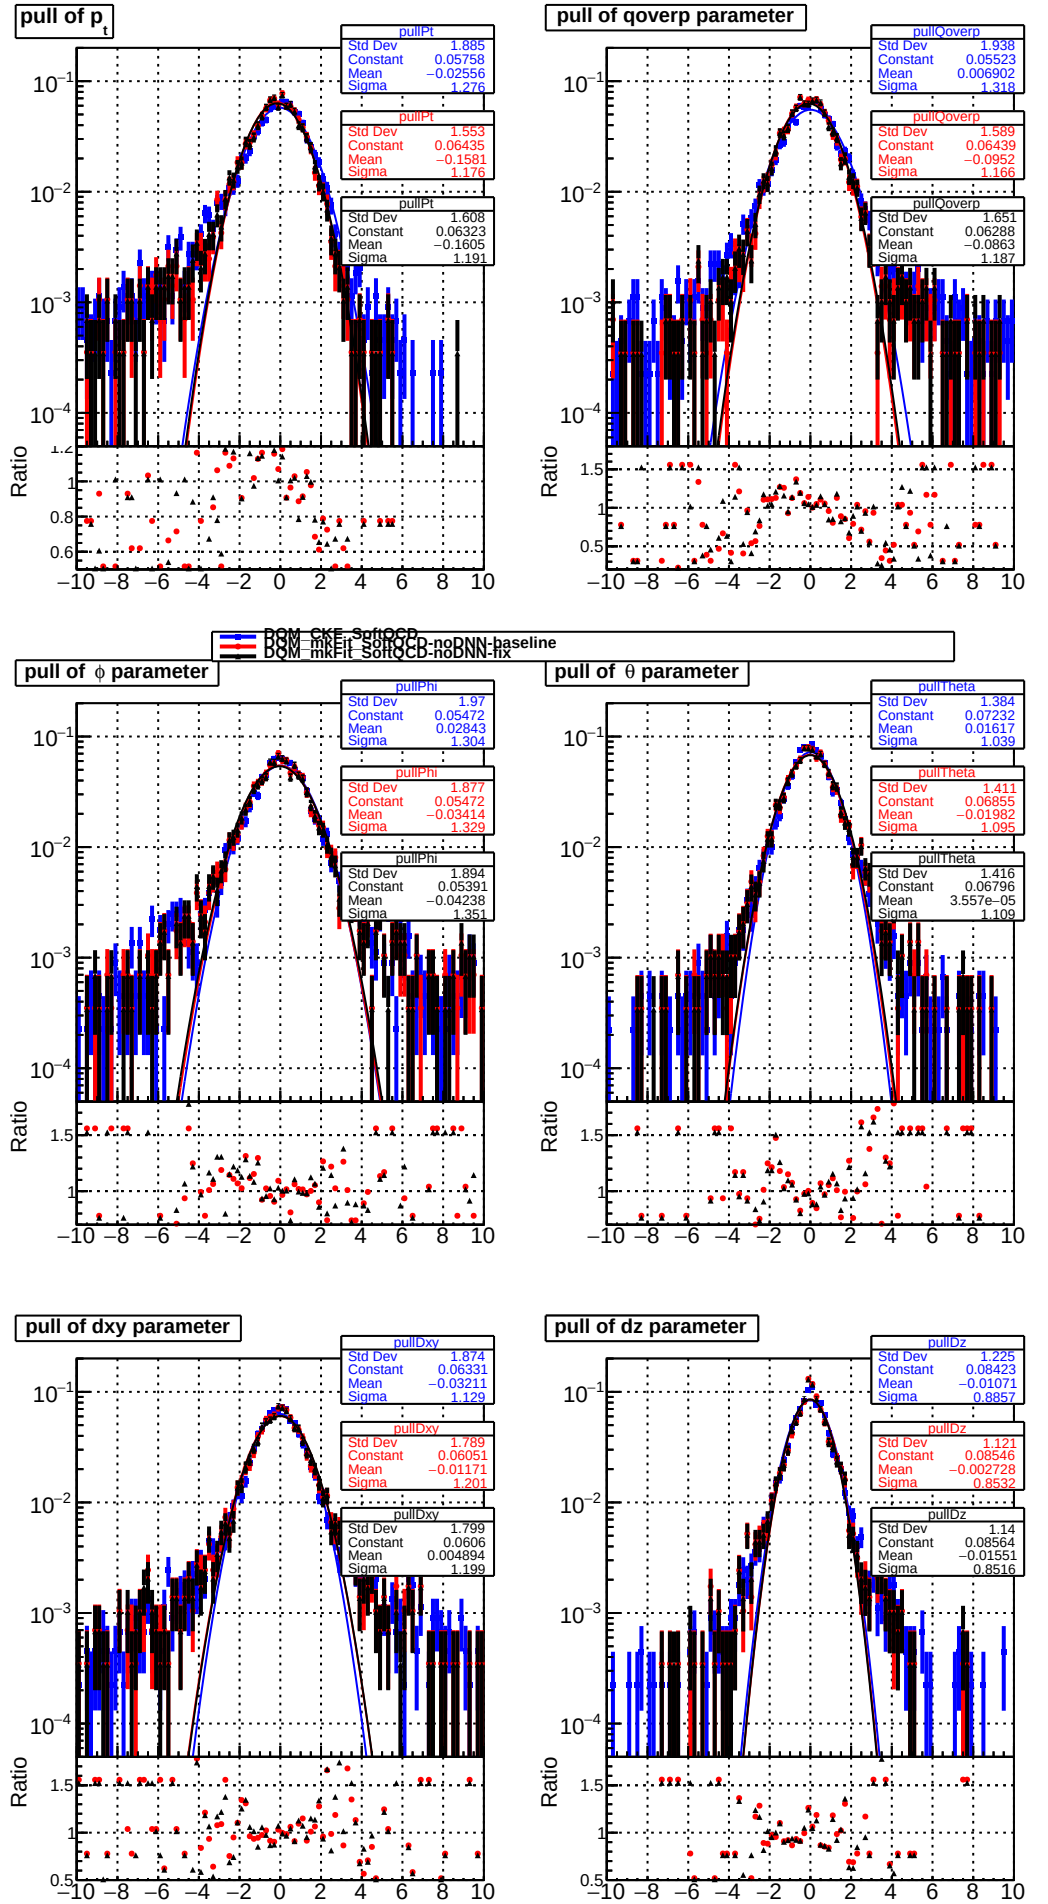
pull of p_t
pullPt
Std Dev 1.885
Constant 0.05758
Mean −0.02556
Sigma 1.276
pullPt
Std Dev 1.553
Constant 0.06435
Mean −0.1581
Sigma 1.176
pullPt
Std Dev 1.608
Constant 0.06323
Mean −0.1605
Sigma 1.191
pull of qoverp parameter
pullQoverp
Std Dev 1.938
Constant 0.05523
Mean 0.006902
Sigma 1.318
pullQoverp
Std Dev 1.589
Constant 0.06439
Mean −0.0952
Sigma 1.166
pullQoverp
Std Dev 1.651
Constant 0.06288
Mean −0.0863
Sigma 1.187
DQM_CKF_SoftQCD
DQM_mkFit_SoftQCD-noDNN-baseline
DQM_mkFit_SoftQCD-noDNN-fix
pull of ϕ parameter
pullPhi
Std Dev 1.97
Constant 0.05472
Mean 0.02843
Sigma 1.304
pullPhi
Std Dev 1.877
Constant 0.05472
Mean −0.03414
Sigma 1.329
pullPhi
Std Dev 1.894
Constant 0.05391
Mean −0.04238
Sigma 1.351
pull of θ parameter
pullTheta
Std Dev 1.384
Constant 0.07232
Mean 0.01617
Sigma 1.039
pullTheta
Std Dev 1.411
Constant 0.06855
Mean −0.01982
Sigma 1.095
pullTheta
Std Dev 1.416
Constant 0.06796
Mean 3.557e−05
Sigma 1.109
pull of dxy parameter
pullDxy
Std Dev 1.874
Constant 0.06331
Mean −0.03211
Sigma 1.129
pullDxy
Std Dev 1.789
Constant 0.06051
Mean −0.01171
Sigma 1.201
pullDxy
Std Dev 1.799
Constant 0.0606
Mean 0.004894
Sigma 1.199
pull of dz parameter
pullDz
Std Dev 1.225
Constant 0.08423
Mean −0.01071
Sigma 0.8857
pullDz
Std Dev 1.121
Constant 0.08546
Mean −0.002728
Sigma 0.8532
pullDz
Std Dev 1.14
Constant 0.08564
Mean −0.01551
Sigma 0.8516
Ratio