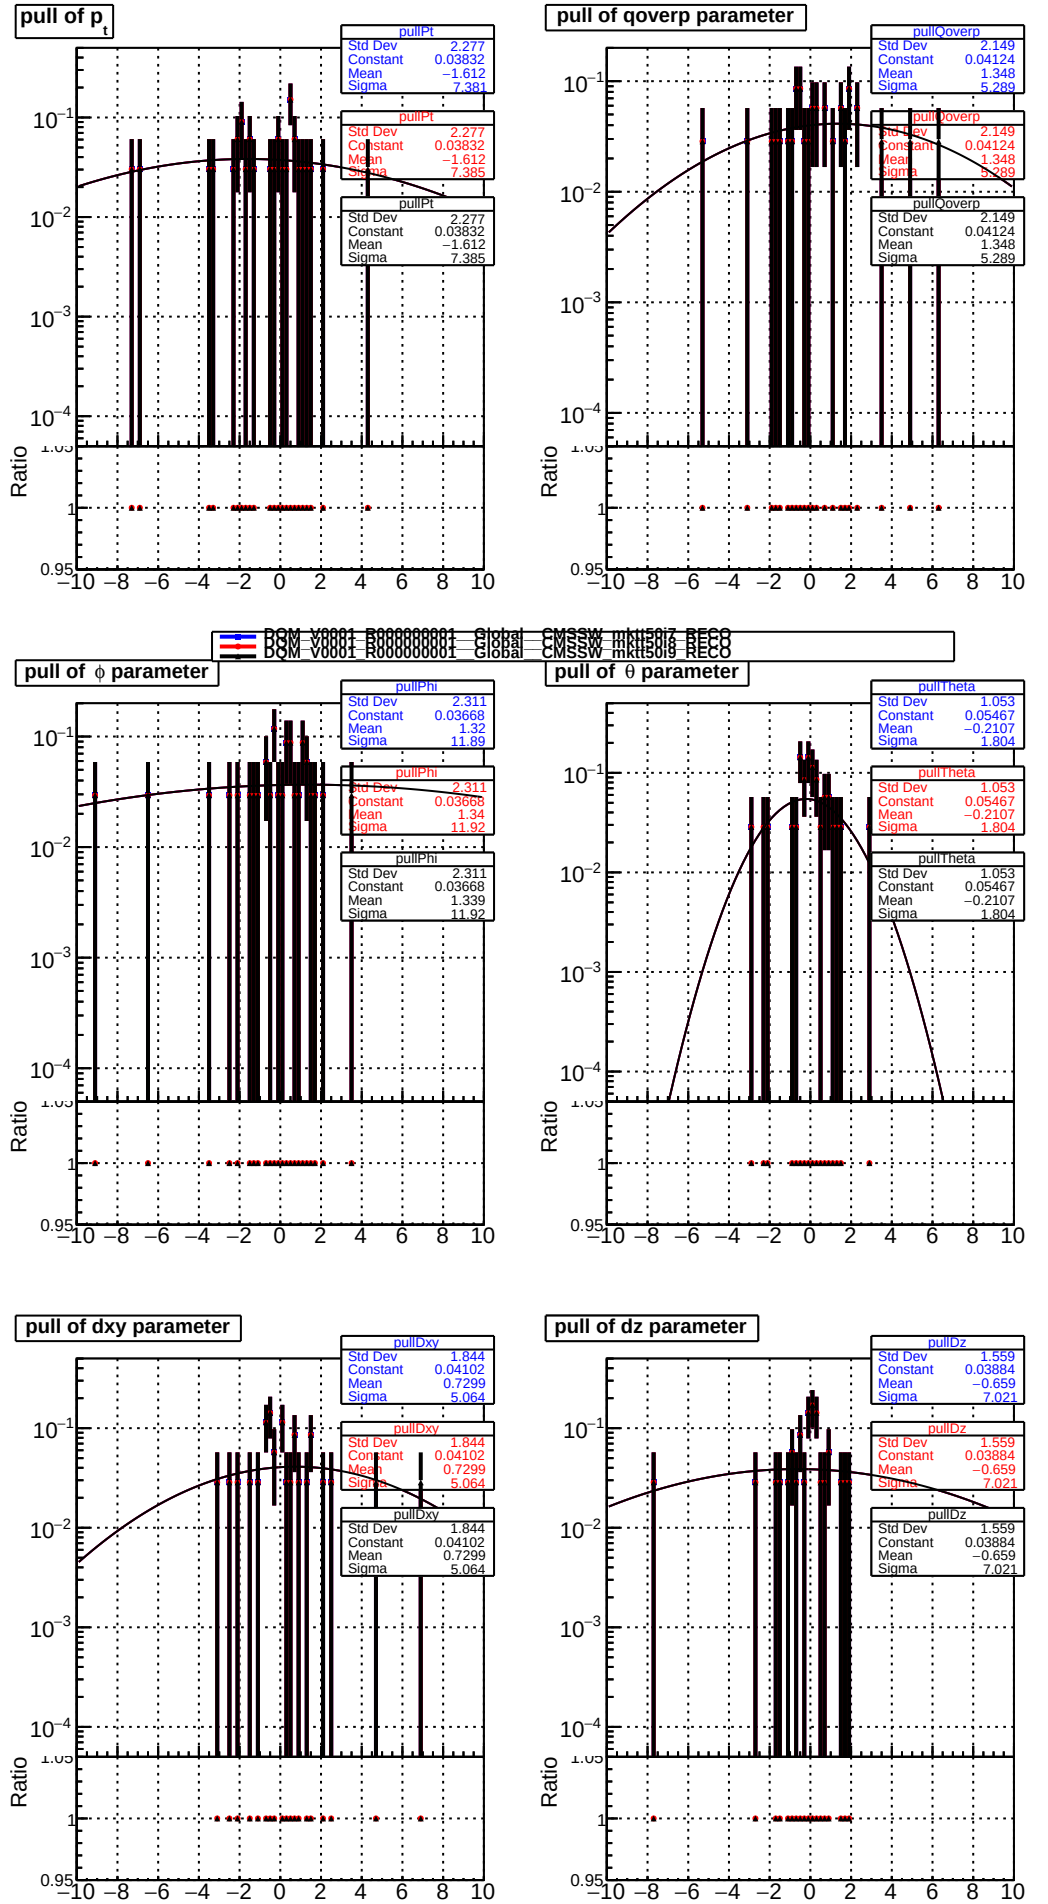
pull of p_t
pullPt
Std Dev 2.277
Constant 0.03832
Mean −1.612
Sigma 7.381
pullPt
Std Dev 2.277
Constant 0.03832
Mean −1.612
Sigma 7.385
pullPt
Std Dev 2.277
Constant 0.03832
Mean −1.612
Sigma 7.385
pull of qoverp parameter
pullQoverp
Std Dev 2.149
Constant 0.04124
Mean 1.348
Sigma 5.289
pullQoverp
Std Dev 2.149
Constant 0.04124
Mean 1.348
Sigma 5.289
pullQoverp
Std Dev 2.149
Constant 0.04124
Mean 1.348
Sigma 5.289
DQM_V0001_R000000001__Global__CMSSW_mkti50i7_RECO
DQM_V0001_R000000001__Global__CMSSW_mkti50i8_RECO
DQM_V0001_R000000001__Global__CMSSW_mktt50i9_RECO
pull of ϕ parameter
pullPhi
Std Dev 2.311
Constant 0.03668
Mean 1.32
Sigma 11.89
pullPhi
Std Dev 2.311
Constant 0.03668
Mean 1.34
Sigma 11.92
pullPhi
Std Dev 2.311
Constant 0.03668
Mean 1.339
Sigma 11.92
pull of θ parameter
pullTheta
Std Dev 1.053
Constant 0.05467
Mean −0.2107
Sigma 1.804
pullTheta
Std Dev 1.053
Constant 0.05467
Mean −0.2107
Sigma 1.804
pullTheta
Std Dev 1.053
Constant 0.05467
Mean −0.2107
Sigma 1.804
pull of dxy parameter
pullDxy
Std Dev 1.844
Constant 0.04102
Mean 0.7299
Sigma 5.064
pullDxy
Std Dev 1.844
Constant 0.04102
Mean 0.7299
Sigma 5.064
pullDxy
Std Dev 1.844
Constant 0.04102
Mean 0.7299
Sigma 5.064
pull of dz parameter
pullDz
Std Dev 1.559
Constant 0.03884
Mean −0.659
Sigma 7.021
pullDz
Std Dev 1.559
Constant 0.03884
Mean −0.659
Sigma 7.021
pullDz
Std Dev 1.559
Constant 0.03884
Mean −0.659
Sigma 7.021
Ratio