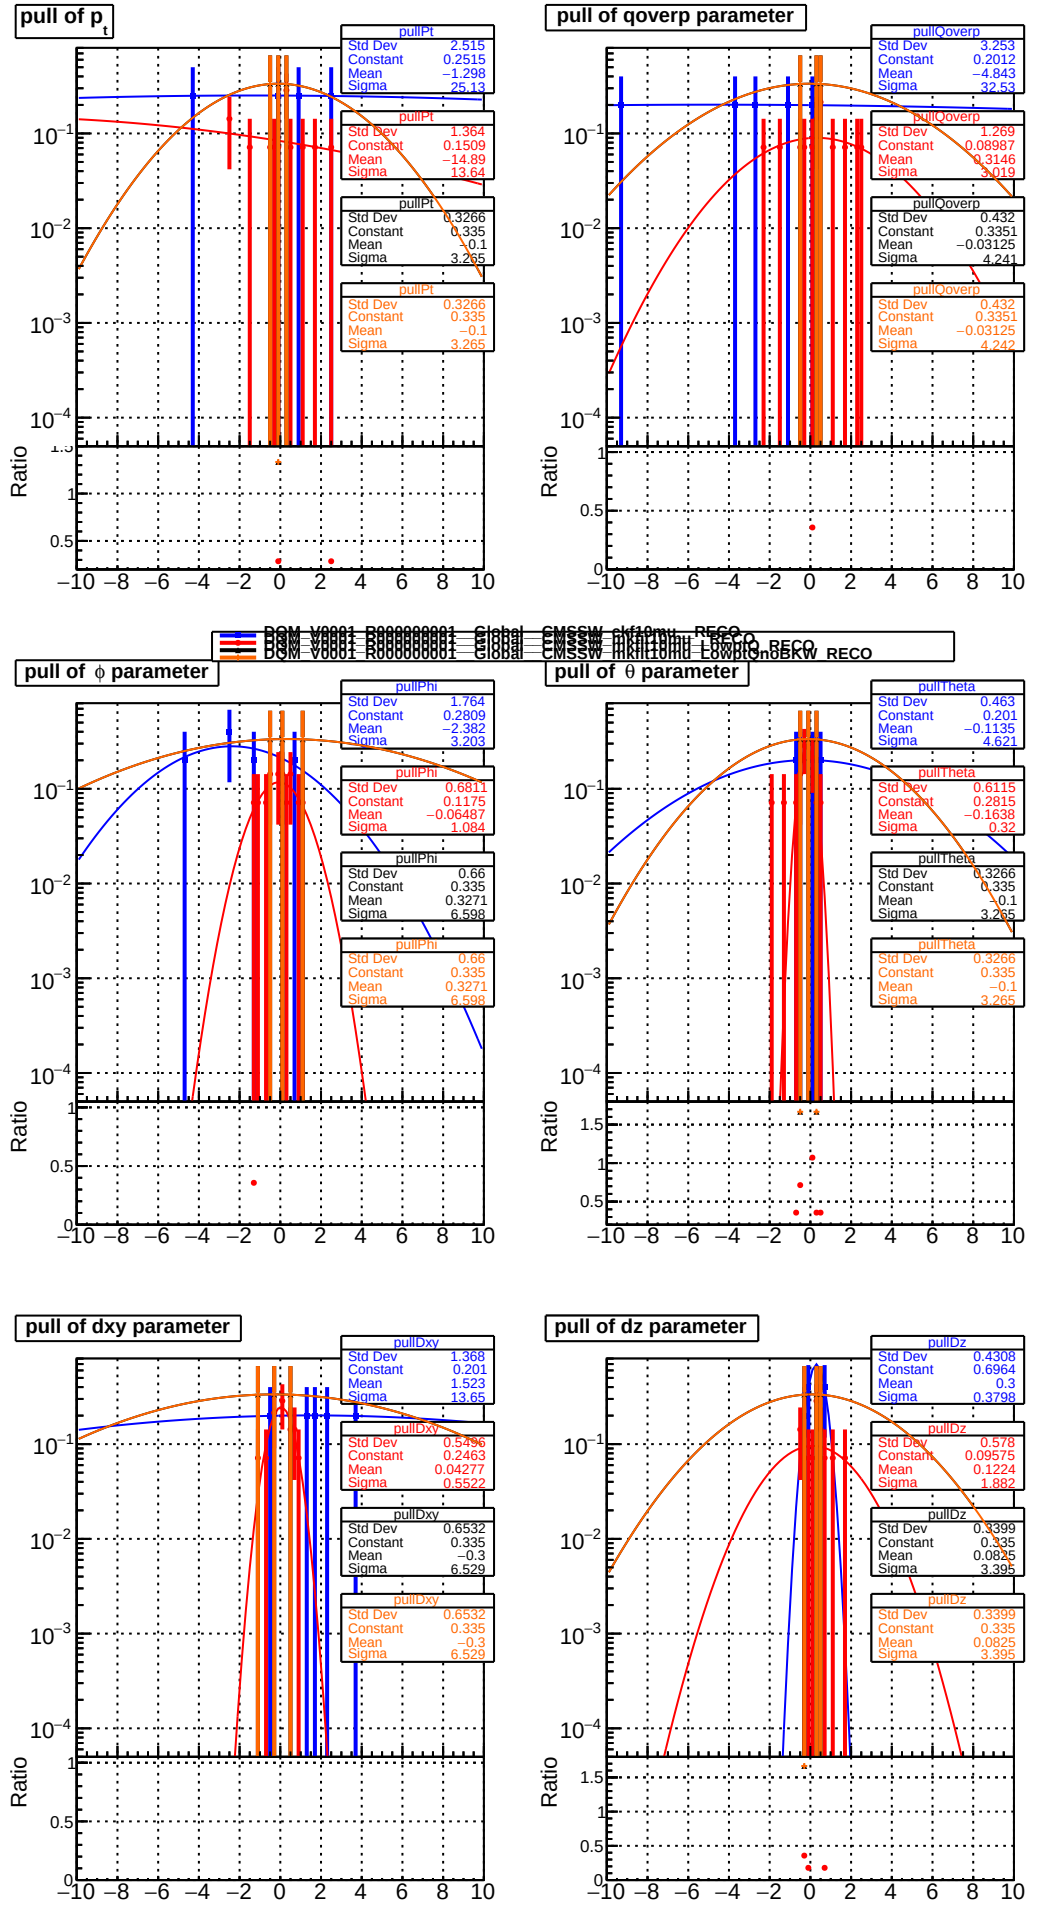
pull of p_t
pullPt
Std Dev 2.515
Constant 0.2515
Mean −1.298
Sigma 25.13
pullPt
Std Dev 1.364
Constant 0.1509
Mean −14.89
Sigma 13.64
pullPt
Std Dev 0.3266
Constant 0.335
Mean −0.1
Sigma 3.265
pullPt
Std Dev 0.3266
Constant 0.335
Mean −0.1
Sigma 3.265
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 3.253
Constant 0.2012
Mean −4.843
Sigma 32.53
pullQoverp
Std Dev 1.269
Constant 0.08987
Mean 0.3146
Sigma 3.019
pullQoverp
Std Dev 0.432
Constant 0.3351
Mean −0.03125
Sigma 4.241
pullQoverp
Std Dev 0.432
Constant 0.3351
Mean −0.03125
Sigma 4.242
Ratio
DQM V0001 R000000001 Global CMSSW_ckf10mu_RECO
DQM V0001 R000000001 Global CMSSW_mkfit10mu_LowPtOn0BKW_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.764
Constant 0.2809
Mean −2.382
Sigma 3.203
pullPhi
Std Dev 0.6811
Constant 0.1175
Mean −0.06487
Sigma 1.084
pullPhi
Std Dev 0.66
Constant 0.335
Mean 0.3271
Sigma 6.598
pullPhi
Std Dev 0.66
Constant 0.335
Mean 0.3271
Sigma 6.598
Ratio
pull of θ parameter
pullTheta
Std Dev 0.463
Constant 0.201
Mean −0.1135
Sigma 4.621
pullTheta
Std Dev 0.6115
Constant 0.2815
Mean −0.1638
Sigma 0.32
pullTheta
Std Dev 0.3266
Constant 0.335
Mean −0.1
Sigma 3.265
pullTheta
Std Dev 0.3266
Constant 0.335
Mean −0.1
Sigma 3.265
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.368
Constant 0.201
Mean 1.523
Sigma 13.65
pullDxy
Std Dev 0.5496
Constant 0.2463
Mean 0.04277
Sigma 0.5522
pullDxy
Std Dev 0.6532
Constant 0.335
Mean −0.3
Sigma 6.529
pullDxy
Std Dev 0.6532
Constant 0.335
Mean −0.3
Sigma 6.529
Ratio
pull of dz parameter
pullDz
Std Dev 0.4308
Constant 0.6964
Mean 0.3
Sigma 0.3798
pullDz
Std Dev 0.578
Constant 0.09575
Mean 0.1224
Sigma 1.882
pullDz
Std Dev 0.3399
Constant 0.335
Mean 0.0825
Sigma 3.395
pullDz
Std Dev 0.3399
Constant 0.335
Mean 0.0825
Sigma 3.395
Ratio