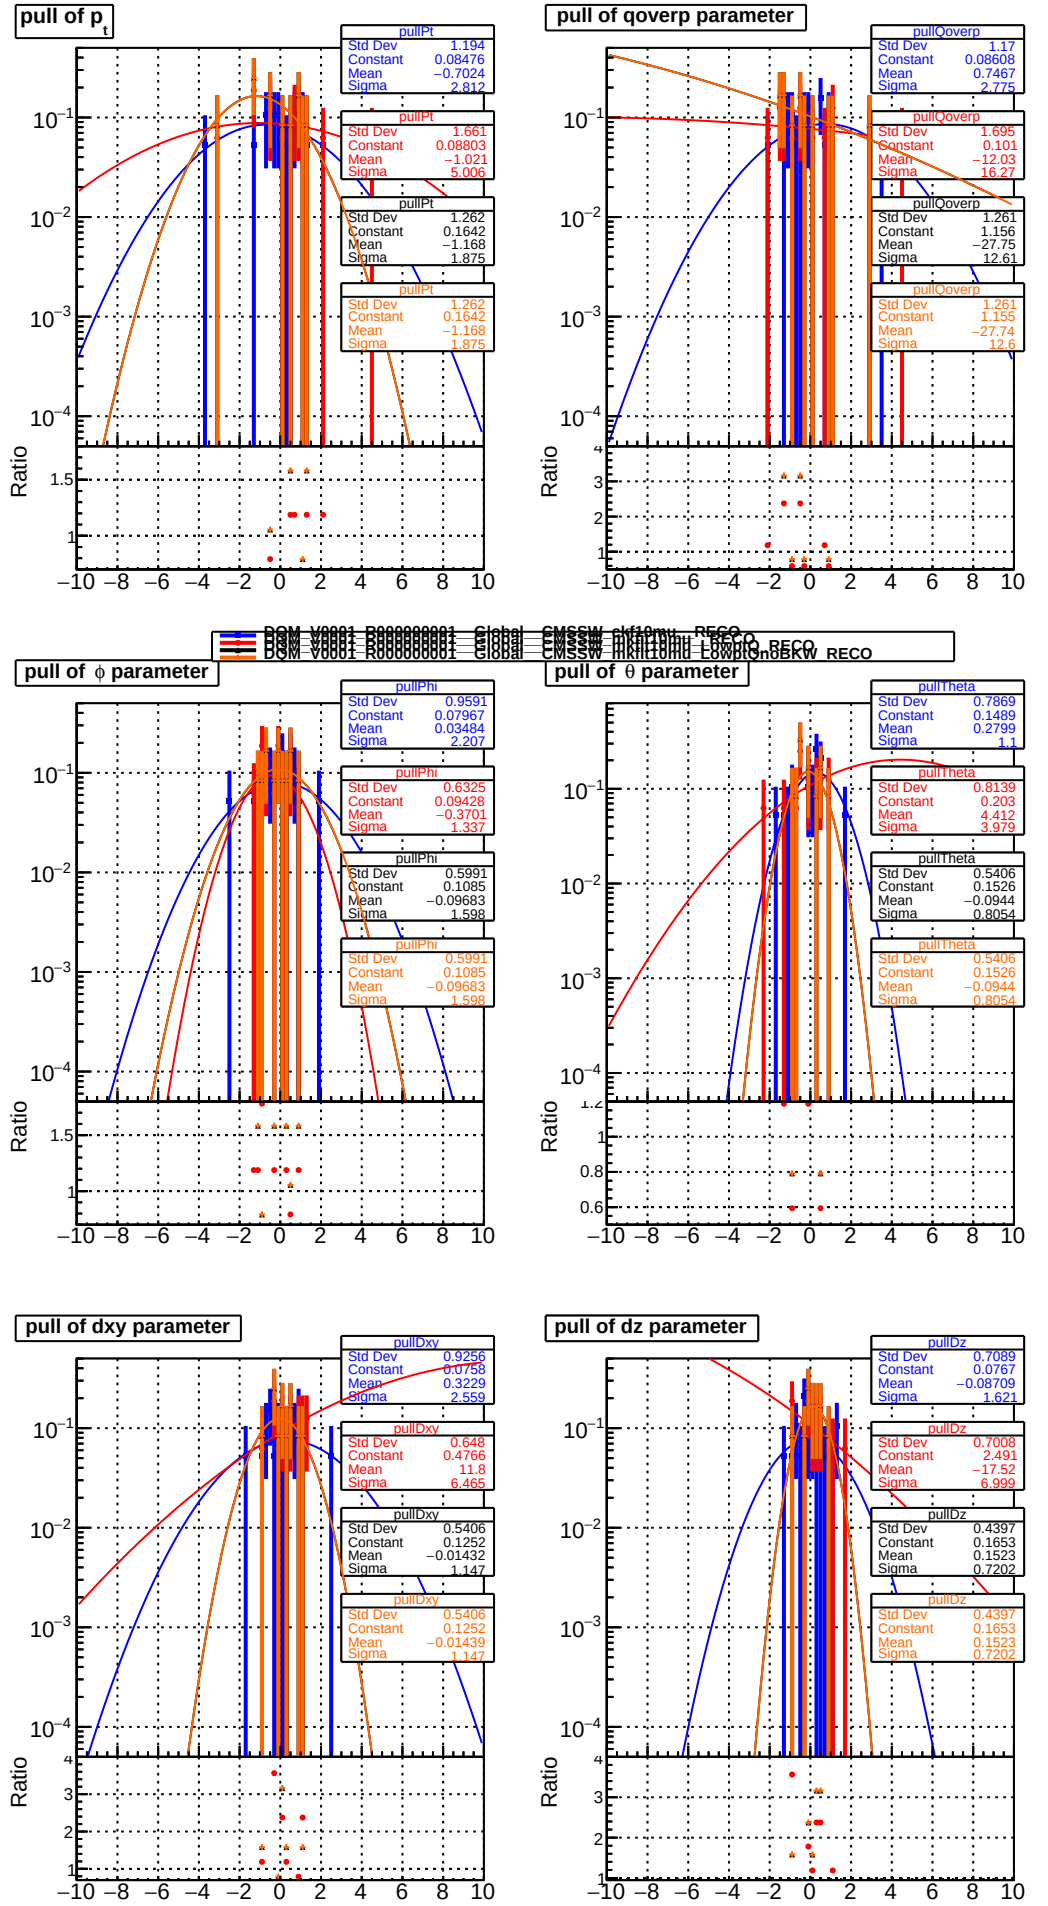
pull of p_t
pullPt
Std Dev 1.194
Constant 0.08476
Mean −0.7024
Sigma 2.812
pullPt
Std Dev 1.661
Constant 0.08803
Mean −1.021
Sigma 5.006
pullPt
Std Dev 1.262
Constant 0.1642
Mean −1.168
Sigma 1.875
pullPt
Std Dev 1.262
Constant 0.1642
Mean −1.168
Sigma 1.875
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.17
Constant 0.08608
Mean 0.7467
Sigma 2.775
pullQoverp
Std Dev 1.695
Constant 0.101
Mean −12.03
Sigma 16.27
pullQoverp
Std Dev 1.261
Constant 1.156
Mean −27.75
Sigma 12.61
pullQoverp
Std Dev 1.261
Constant 1.155
Mean −27.74
Sigma 12.6
Ratio
DQM V0001 R000000001 Global CMSSW_ckf10mu_ RECO
DQM V0001 R000000001 Global CMSSW_mkfit10mu_ RECO
DQM V0001 R000000001 Global CMSSW_mkfit10mu_LowPtOnoBKW_RECO
pull of ϕ parameter
pullPhi
Std Dev 0.9591
Constant 0.07967
Mean 0.03484
Sigma 2.207
pullPhi
Std Dev 0.6325
Constant 0.09428
Mean −0.3701
Sigma 1.337
pullPhi
Std Dev 0.5991
Constant 0.1085
Mean −0.09683
Sigma 1.598
pullPhi
Std Dev 0.5991
Constant 0.1085
Mean −0.09683
Sigma 1.598
Ratio
pull of θ parameter
pullTheta
Std Dev 0.7869
Constant 0.1489
Mean 0.2799
Sigma 1.1
pullTheta
Std Dev 0.8139
Constant 0.203
Mean 4.412
Sigma 3.979
pullTheta
Std Dev 0.5406
Constant 0.1526
Mean −0.0944
Sigma 0.8054
pullTheta
Std Dev 0.5406
Constant 0.1526
Mean −0.0944
Sigma 0.8054
Ratio
pull of dxy parameter
pullDxy
Std Dev 0.9256
Constant 0.0758
Mean 0.3229
Sigma 2.559
pullDxy
Std Dev 0.648
Constant 0.4766
Mean 11.8
Sigma 6.465
pullDxy
Std Dev 0.5406
Constant 0.1252
Mean −0.01432
Sigma 1.147
pullDxy
Std Dev 0.5406
Constant 0.1252
Mean −0.01439
Sigma 1.147
Ratio
pull of dz parameter
pullDz
Std Dev 0.7089
Constant 0.0767
Mean −0.08709
Sigma 1.621
pullDz
Std Dev 0.7008
Constant 2.491
Mean −17.52
Sigma 6.999
pullDz
Std Dev 0.4397
Constant 0.1653
Mean 0.1523
Sigma 0.7202
pullDz
Std Dev 0.4397
Constant 0.1653
Mean 0.1523
Sigma 0.7202
Ratio