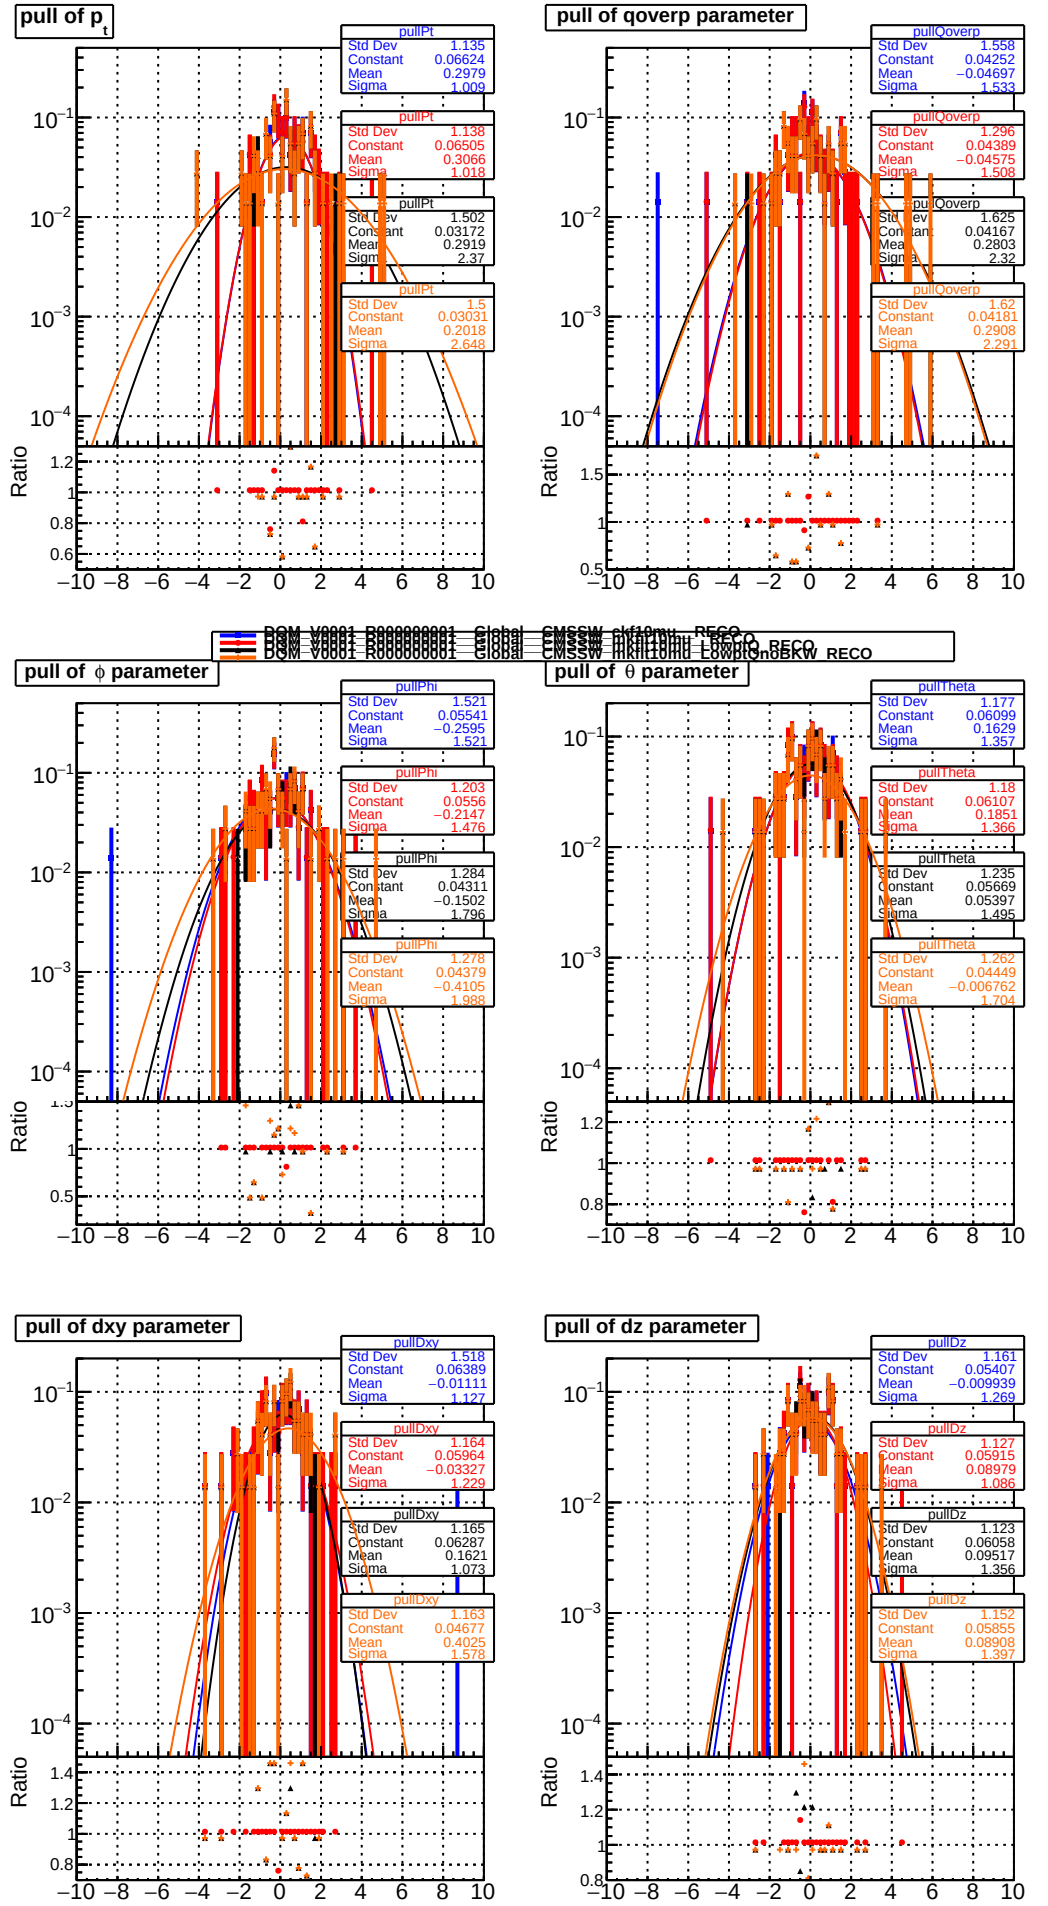
pull of p_t
pullPt
Std Dev 1.135
Constant 0.06624
Mean 0.2979
Sigma 1.009
pullPt
Std Dev 1.138
Constant 0.06505
Mean 0.3066
Sigma 1.018
pullPt
Std Dev 1.502
Constant 0.03172
Mean 0.2919
Sigma 2.37
pullPt
Std Dev 1.5
Constant 0.03031
Mean 0.2018
Sigma 2.648
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.558
Constant 0.04252
Mean −0.04697
Sigma 1.533
pullQoverp
Std Dev 1.296
Constant 0.04389
Mean −0.04575
Sigma 1.508
pullQoverp
Std Dev 1.625
Constant 0.04167
Mean 0.2803
Sigma 2.32
pullQoverp
Std Dev 1.62
Constant 0.04181
Mean 0.2908
Sigma 2.291
Ratio
DQM V0001 R000000001 Global CMSSW_ckf10mu_RECO
DQM V0001 R000000001 Global CMSSW_mkfit10mu_LowPtOnoBKW_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.521
Constant 0.05541
Mean −0.2595
Sigma 1.521
pullPhi
Std Dev 1.203
Constant 0.0556
Mean −0.2147
Sigma 1.476
pullPhi
Std Dev 1.284
Constant 0.04311
Mean −0.1502
Sigma 1.796
pullPhi
Std Dev 1.278
Constant 0.04379
Mean −0.4105
Sigma 1.988
Ratio
pull of θ parameter
pullTheta
Std Dev 1.177
Constant 0.06099
Mean 0.1629
Sigma 1.357
pullTheta
Std Dev 1.18
Constant 0.06107
Mean 0.1851
Sigma 1.366
pullTheta
Std Dev 1.235
Constant 0.05669
Mean 0.05397
Sigma 1.495
pullTheta
Std Dev 1.262
Constant 0.04449
Mean −0.006762
Sigma 1.704
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.518
Constant 0.06389
Mean −0.01111
Sigma 1.127
pullDxy
Std Dev 1.164
Constant 0.05964
Mean −0.03327
Sigma 1.229
pullDxy
Std Dev 1.165
Constant 0.06287
Mean 0.1621
Sigma 1.073
pullDxy
Std Dev 1.163
Constant 0.04677
Mean 0.4025
Sigma 1.578
Ratio
pull of dz parameter
pullDz
Std Dev 1.161
Constant 0.05407
Mean −0.009939
Sigma 1.269
pullDz
Std Dev 1.127
Constant 0.05915
Mean 0.08979
Sigma 1.086
pullDz
Std Dev 1.123
Constant 0.06058
Mean 0.09517
Sigma 1.356
pullDz
Std Dev 1.152
Constant 0.05855
Mean 0.08908
Sigma 1.397
Ratio