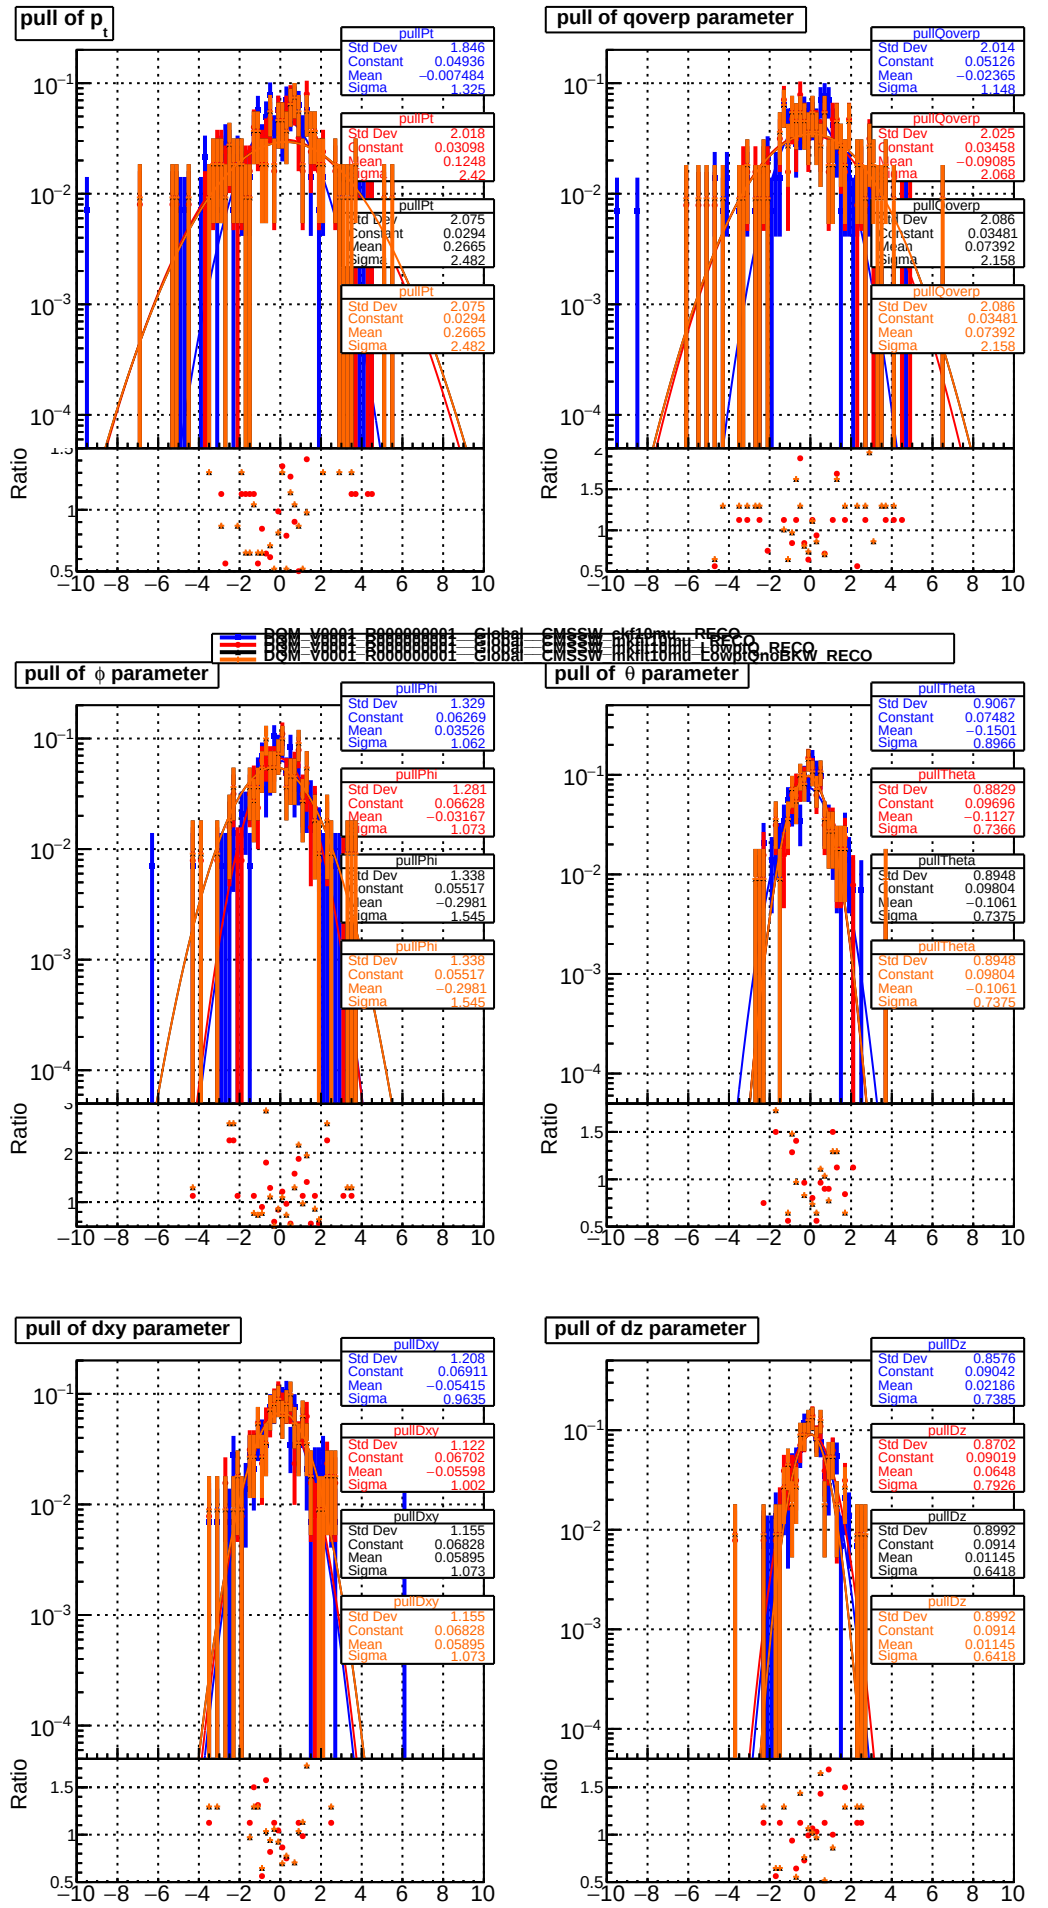
pull of p_t
pullPt
Std Dev 1.846
Constant 0.04936
Mean −0.007484
Sigma 1.325
pullPt
Std Dev 2.018
Constant 0.03098
Mean 0.1248
Sigma 2.42
pullPt
Std Dev 2.075
Constant 0.0294
Mean 0.2665
Sigma 2.482
pullPt
Std Dev 2.075
Constant 0.0294
Mean 0.2665
Sigma 2.482
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.014
Constant 0.05126
Mean −0.02365
Sigma 1.148
pullQoverp
Std Dev 2.025
Constant 0.03458
Mean −0.09085
Sigma 2.068
pullQoverp
Std Dev 2.086
Constant 0.03481
Mean 0.07392
Sigma 2.158
pullQoverp
Std Dev 2.086
Constant 0.03481
Mean 0.07392
Sigma 2.158
Ratio
DQM V0001 R000000001 Global CMSSW_ckf10mu_RECO
DQM V0001 R000000001 Global CMSSW_mkfit10mu_LowPtOnoBKW_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.329
Constant 0.06269
Mean 0.03526
Sigma 1.062
pullPhi
Std Dev 1.281
Constant 0.06628
Mean −0.03167
Sigma 1.073
pullPhi
Std Dev 1.338
Constant 0.05517
Mean −0.2981
Sigma 1.545
pullPhi
Std Dev 1.338
Constant 0.05517
Mean −0.2981
Sigma 1.545
Ratio
pull of θ parameter
pullTheta
Std Dev 0.9067
Constant 0.07482
Mean −0.1501
Sigma 0.8966
pullTheta
Std Dev 0.8829
Constant 0.09696
Mean −0.1127
Sigma 0.7366
pullTheta
Std Dev 0.8948
Constant 0.09804
Mean −0.1061
Sigma 0.7375
pullTheta
Std Dev 0.8948
Constant 0.09804
Mean −0.1061
Sigma 0.7375
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.208
Constant 0.06911
Mean −0.05415
Sigma 0.9635
pullDxy
Std Dev 1.122
Constant 0.06702
Mean −0.05598
Sigma 1.002
pullDxy
Std Dev 1.155
Constant 0.06828
Mean 0.05895
Sigma 1.073
pullDxy
Std Dev 1.155
Constant 0.06828
Mean 0.05895
Sigma 1.073
Ratio
pull of dz parameter
pullDz
Std Dev 0.8576
Constant 0.09042
Mean 0.02186
Sigma 0.7385
pullDz
Std Dev 0.8702
Constant 0.09019
Mean 0.0648
Sigma 0.7926
pullDz
Std Dev 0.8992
Constant 0.0914
Mean 0.01145
Sigma 0.6418
pullDz
Std Dev 0.8992
Constant 0.0914
Mean 0.01145
Sigma 0.6418
Ratio