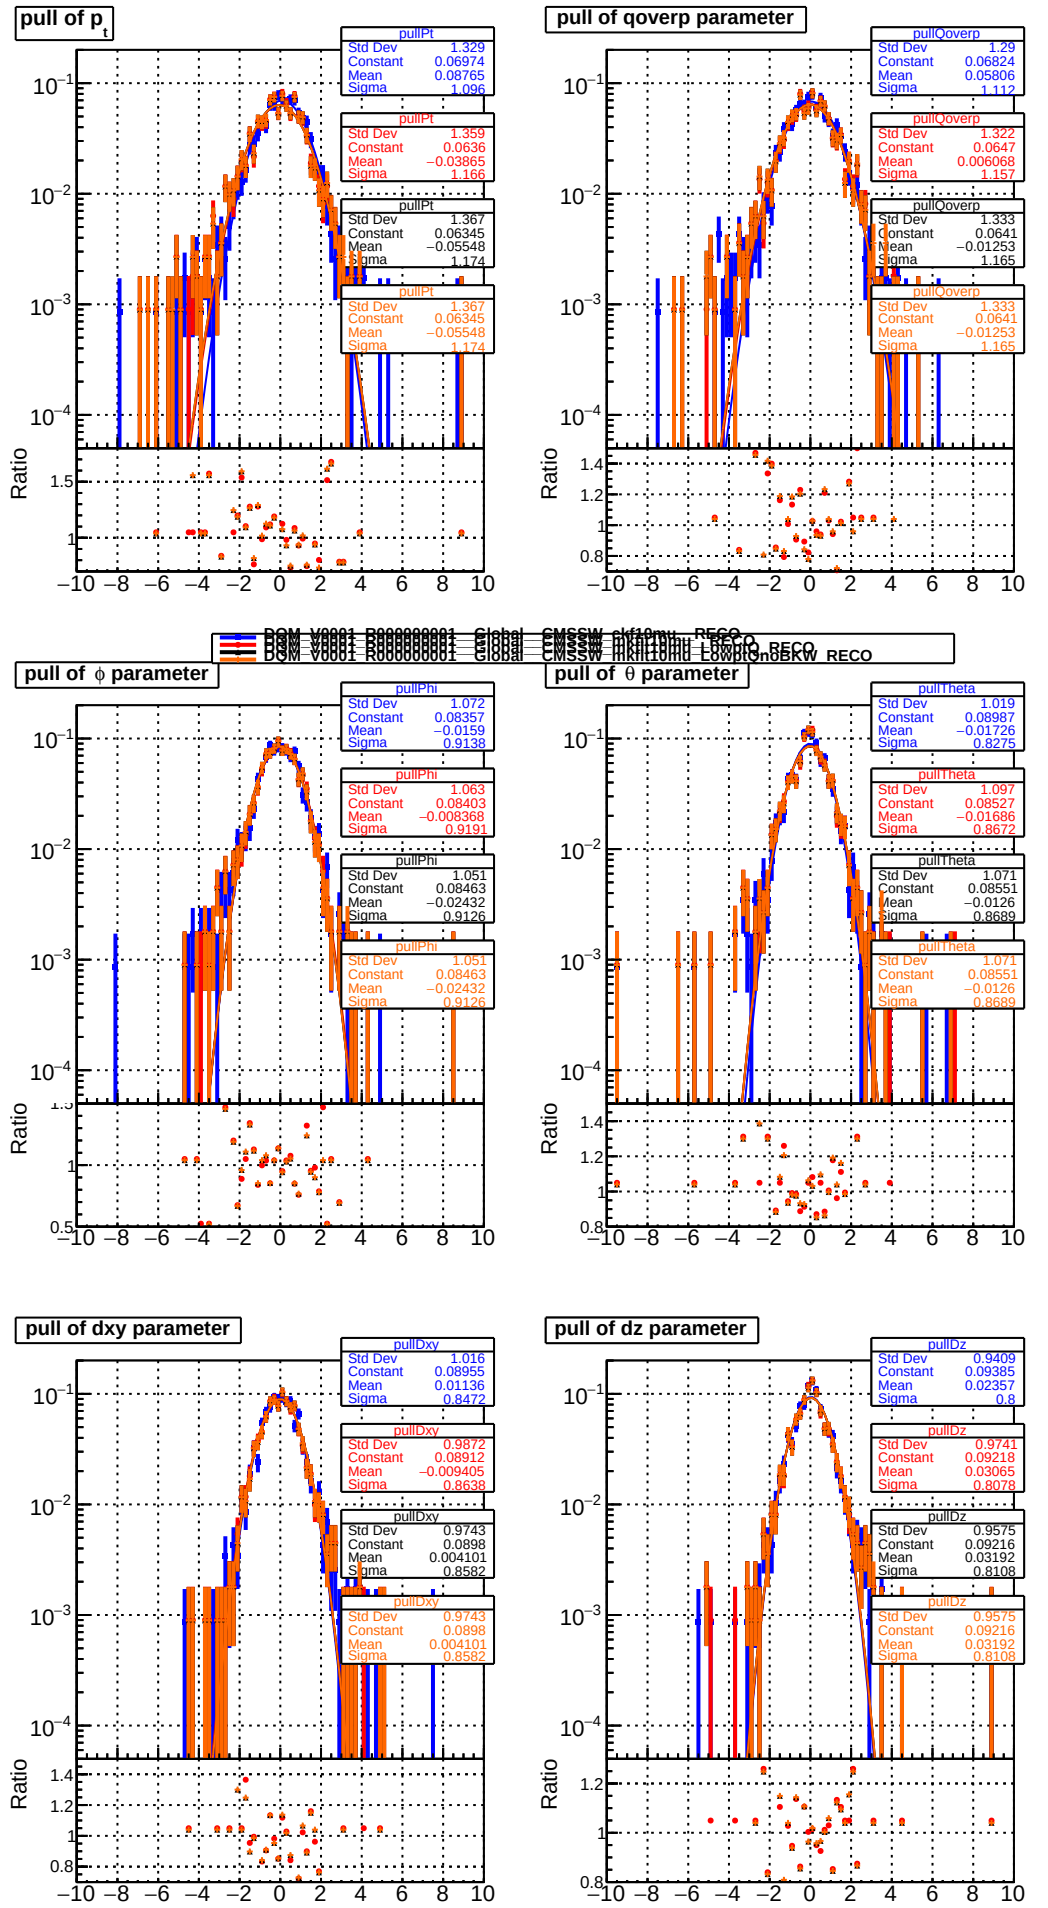
pull of p_t
pullPt
Std Dev 1.329
Constant 0.06974
Mean 0.08765
Sigma 1.096
pullPt
Std Dev 1.359
Constant 0.0636
Mean −0.03865
Sigma 1.166
pullPt
Std Dev 1.367
Constant 0.06345
Mean −0.05548
Sigma 1.174
pullPt
Std Dev 1.367
Constant 0.06345
Mean −0.05548
Sigma 1.174
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.29
Constant 0.06824
Mean 0.05806
Sigma 1.112
pullQoverp
Std Dev 1.322
Constant 0.0647
Mean 0.006068
Sigma 1.157
pullQoverp
Std Dev 1.333
Constant 0.0641
Mean −0.01253
Sigma 1.165
pullQoverp
Std Dev 1.333
Constant 0.0641
Mean −0.01253
Sigma 1.165
Ratio
DQM V0001 R000000001 Global CMSSW_ckf10mu_RECO
DQM V0001 R000000001 Global CMSSW_mkfit10mu_LowPtOnoBKW_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.072
Constant 0.08357
Mean −0.0159
Sigma 0.9138
pullPhi
Std Dev 1.063
Constant 0.08403
Mean −0.008368
Sigma 0.9191
pullPhi
Std Dev 1.051
Constant 0.08463
Mean −0.02432
Sigma 0.9126
pullPhi
Std Dev 1.051
Constant 0.08463
Mean −0.02432
Sigma 0.9126
Ratio
pull of θ parameter
pullTheta
Std Dev 1.019
Constant 0.08987
Mean −0.01726
Sigma 0.8275
pullTheta
Std Dev 1.097
Constant 0.08527
Mean −0.01686
Sigma 0.8672
pullTheta
Std Dev 1.071
Constant 0.08551
Mean −0.0126
Sigma 0.8689
pullTheta
Std Dev 1.071
Constant 0.08551
Mean −0.0126
Sigma 0.8689
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.016
Constant 0.08955
Mean 0.01136
Sigma 0.8472
pullDxy
Std Dev 0.9872
Constant 0.08912
Mean −0.009405
Sigma 0.8638
pullDxy
Std Dev 0.9743
Constant 0.0898
Mean 0.004101
Sigma 0.8582
pullDxy
Std Dev 0.9743
Constant 0.0898
Mean 0.004101
Sigma 0.8582
Ratio
pull of dz parameter
pullDz
Std Dev 0.9409
Constant 0.09385
Mean 0.02357
Sigma 0.8
pullDz
Std Dev 0.9741
Constant 0.09218
Mean 0.03065
Sigma 0.8078
pullDz
Std Dev 0.9575
Constant 0.09216
Mean 0.03192
Sigma 0.8108
pullDz
Std Dev 0.9575
Constant 0.09216
Mean 0.03192
Sigma 0.8108
Ratio