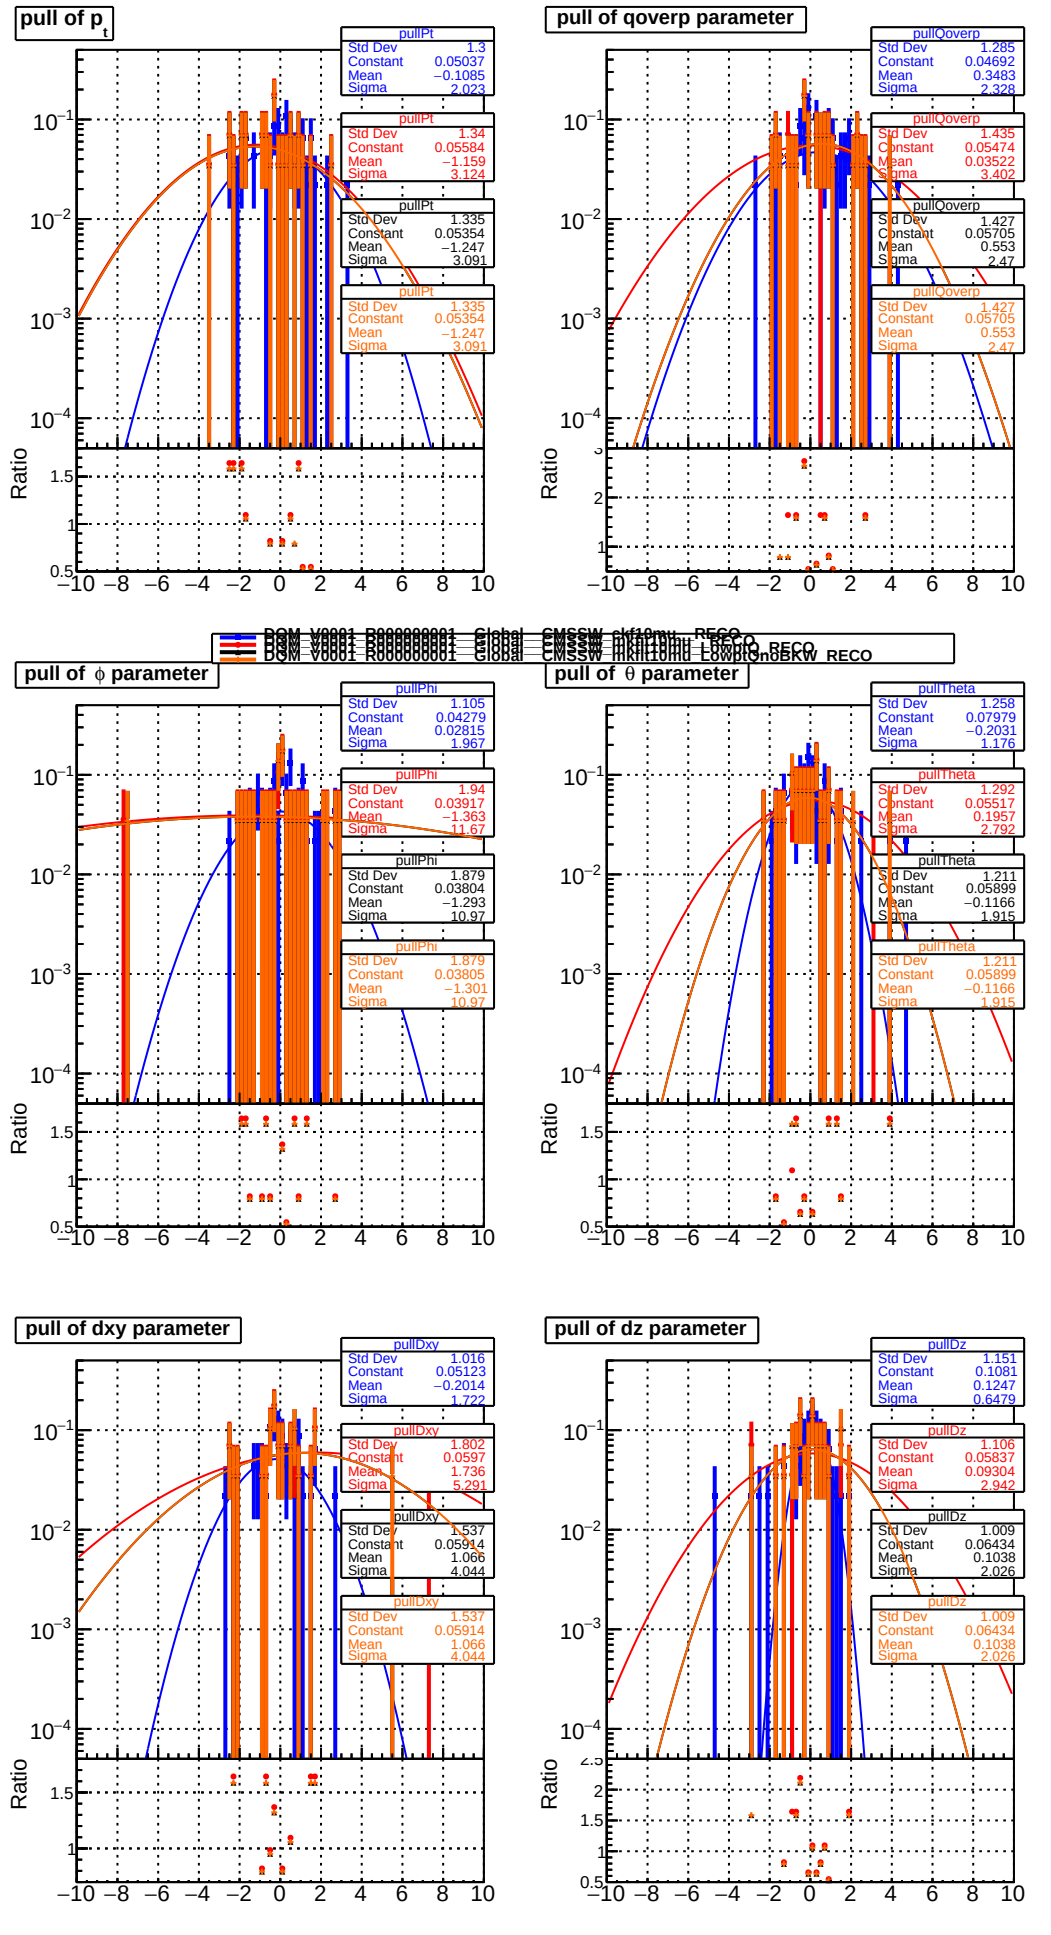
pull of p_t
pullPt
Std Dev 1.3
Constant 0.05037
Mean −0.1085
Sigma 2.023
pullPt
Std Dev 1.34
Constant 0.05584
Mean −1.159
Sigma 3.124
pullPt
Std Dev 1.335
Constant 0.05354
Mean −1.247
Sigma 3.091
pullPt
Std Dev 1.335
Constant 0.05354
Mean −1.247
Sigma 3.091
pull of qoverp parameter
pullQoverp
Std Dev 1.285
Constant 0.04692
Mean 0.3483
Sigma 2.328
pullQoverp
Std Dev 1.435
Constant 0.05474
Mean 0.03522
Sigma 3.402
pullQoverp
Std Dev 1.427
Constant 0.05705
Mean 0.553
Sigma 2.47
pullQoverp
Std Dev 1.427
Constant 0.05705
Mean 0.553
Sigma 2.47
DQM V0001 R000000001 Global CMSSW_ckf10mu_RECO
DQM V0001 R000000001 Global CMSSW_mkfit10mu_LowPtOnoBKW_RECO
DQM V0001 R000000001 Global CMSSW_mkfit10mu_LowPtOnoBKW_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.105
Constant 0.04279
Mean 0.02815
Sigma 1.967
pullPhi
Std Dev 1.94
Constant 0.03917
Mean −1.363
Sigma 11.67
pullPhi
Std Dev 1.879
Constant 0.03804
Mean −1.293
Sigma 10.97
pullPhi
Std Dev 1.879
Constant 0.03805
Mean −1.301
Sigma 10.97
pull of θ parameter
pullTheta
Std Dev 1.258
Constant 0.07979
Mean −0.2031
Sigma 1.176
pullTheta
Std Dev 1.292
Constant 0.05517
Mean 0.1957
Sigma 2.792
pullTheta
Std Dev 1.211
Constant 0.05899
Mean −0.1166
Sigma 1.915
pullTheta
Std Dev 1.211
Constant 0.05899
Mean −0.1166
Sigma 1.915
pull of dxy parameter
pullDxy
Std Dev 1.016
Constant 0.05123
Mean −0.2014
Sigma 1.722
pullDxy
Std Dev 1.802
Constant 0.0597
Mean 1.736
Sigma 5.291
pullDxy
Std Dev 1.537
Constant 0.05914
Mean 1.066
Sigma 4.044
pullDxy
Std Dev 1.537
Constant 0.05914
Mean 1.066
Sigma 4.044
pull of dz parameter
pullDz
Std Dev 1.151
Constant 0.1081
Mean 0.1247
Sigma 0.6479
pullDz
Std Dev 1.106
Constant 0.05837
Mean 0.09304
Sigma 2.942
pullDz
Std Dev 1.009
Constant 0.06434
Mean 0.1038
Sigma 2.026
pullDz
Std Dev 1.009
Constant 0.06434
Mean 0.1038
Sigma 2.026
Ratio