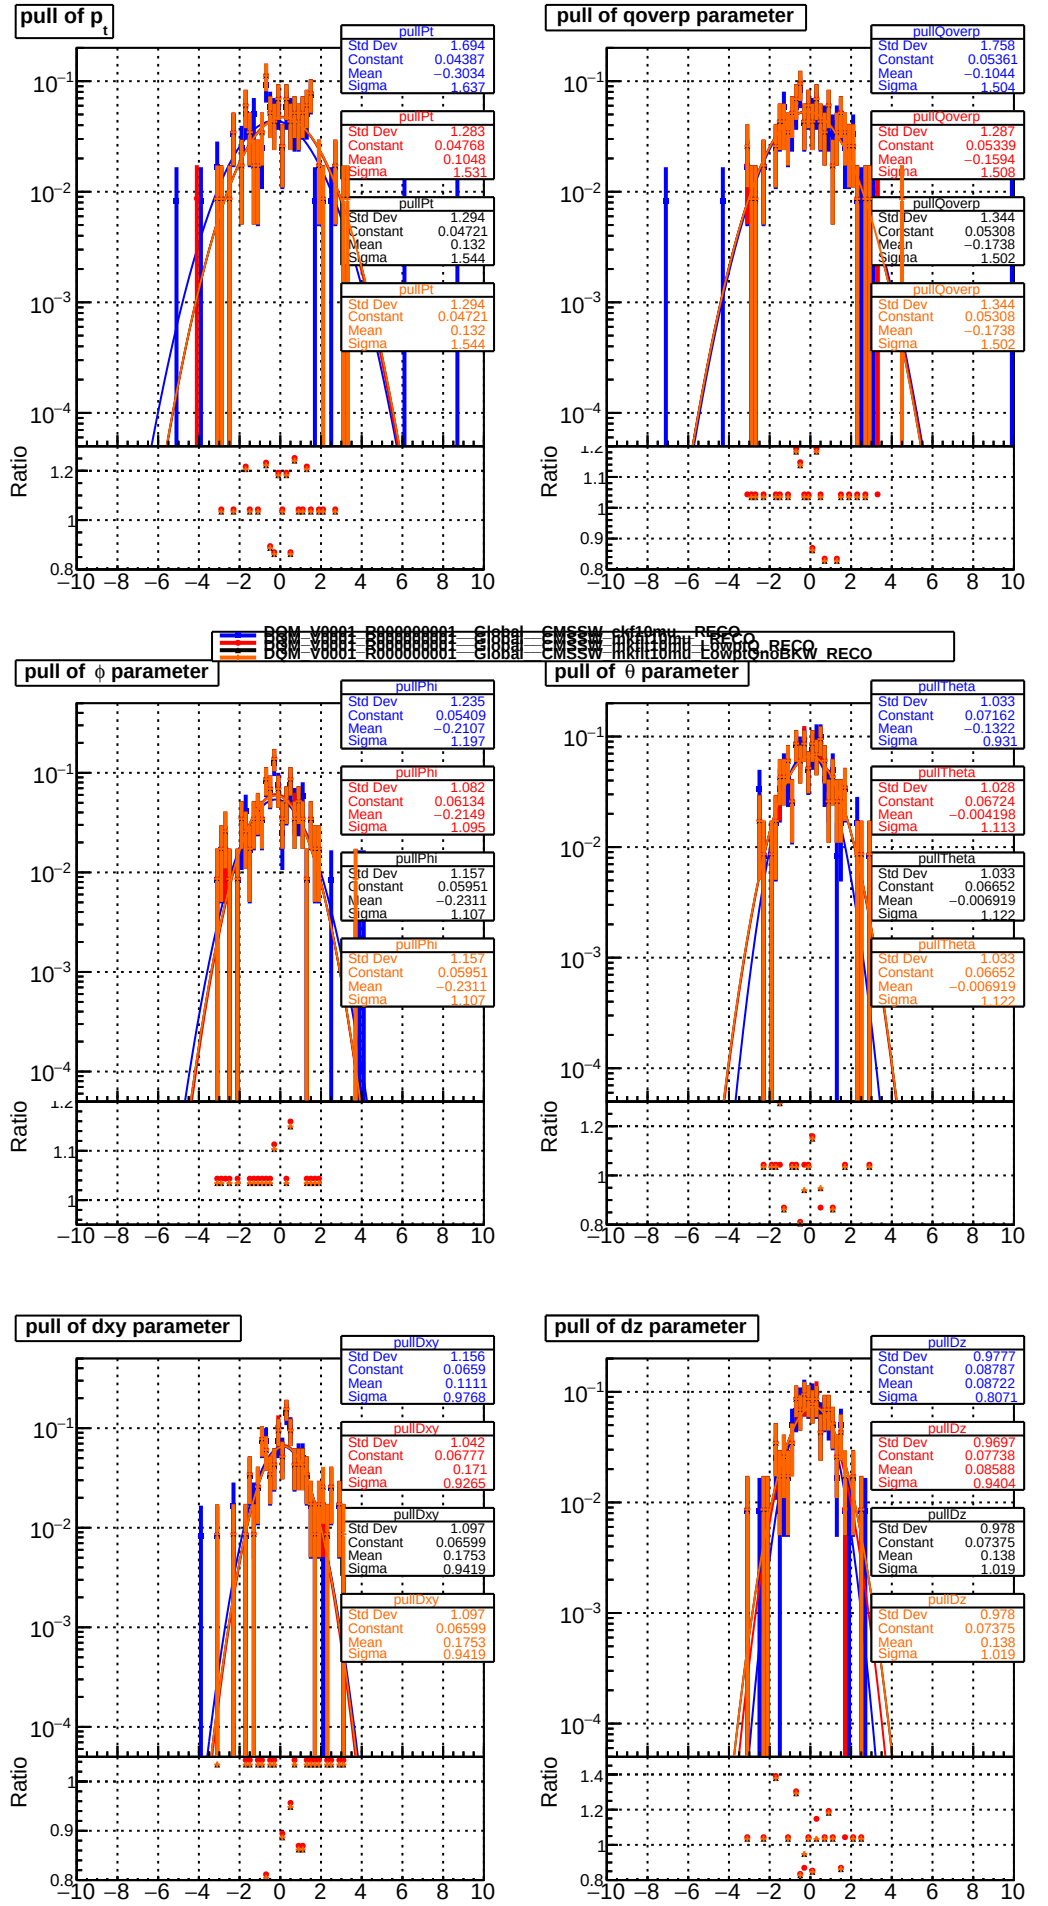
pull of p_t
pullPt
Std Dev 1.694
Constant 0.04387
Mean −0.3034
Sigma 1.637
pullPt
Std Dev 1.283
Constant 0.04768
Mean 0.1048
Sigma 1.531
pullPt
Std Dev 1.294
Constant 0.04721
Mean 0.132
Sigma 1.544
pullPt
Std Dev 1.294
Constant 0.04721
Mean 0.132
Sigma 1.544
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.758
Constant 0.05361
Mean −0.1044
Sigma 1.504
pullQoverp
Std Dev 1.287
Constant 0.05339
Mean −0.1594
Sigma 1.508
pullQoverp
Std Dev 1.344
Constant 0.05308
Mean −0.1738
Sigma 1.502
pullQoverp
Std Dev 1.344
Constant 0.05308
Mean −0.1738
Sigma 1.502
Ratio
DQM V0001 R000000001 Global CMSSW mkfit10mu_RECO
DQM V0001 R000000001 Global CMSSW mkfit10mu_LowPtOnoBKW_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.235
Constant 0.05409
Mean −0.2107
Sigma 1.197
pullPhi
Std Dev 1.082
Constant 0.06134
Mean −0.2149
Sigma 1.095
pullPhi
Std Dev 1.157
Constant 0.05951
Mean −0.2311
Sigma 1.107
pullPhi
Std Dev 1.157
Constant 0.05951
Mean −0.2311
Sigma 1.107
Ratio
pull of θ parameter
pullTheta
Std Dev 1.033
Constant 0.07162
Mean −0.1322
Sigma 0.931
pullTheta
Std Dev 1.028
Constant 0.06724
Mean −0.004198
Sigma 1.113
pullTheta
Std Dev 1.033
Constant 0.06652
Mean −0.006919
Sigma 1.122
pullTheta
Std Dev 1.033
Constant 0.06652
Mean −0.006919
Sigma 1.122
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.156
Constant 0.0659
Mean 0.1111
Sigma 0.9768
pullDxy
Std Dev 1.042
Constant 0.06777
Mean 0.171
Sigma 0.9265
pullDxy
Std Dev 1.097
Constant 0.06599
Mean 0.1753
Sigma 0.9419
pullDxy
Std Dev 1.097
Constant 0.06599
Mean 0.1753
Sigma 0.9419
Ratio
pull of dz parameter
pullDz
Std Dev 0.9777
Constant 0.08787
Mean 0.08722
Sigma 0.8071
pullDz
Std Dev 0.9697
Constant 0.07738
Mean 0.08588
Sigma 0.9404
pullDz
Std Dev 0.978
Constant 0.07375
Mean 0.138
Sigma 1.019
pullDz
Std Dev 0.978
Constant 0.07375
Mean 0.138
Sigma 1.019
Ratio