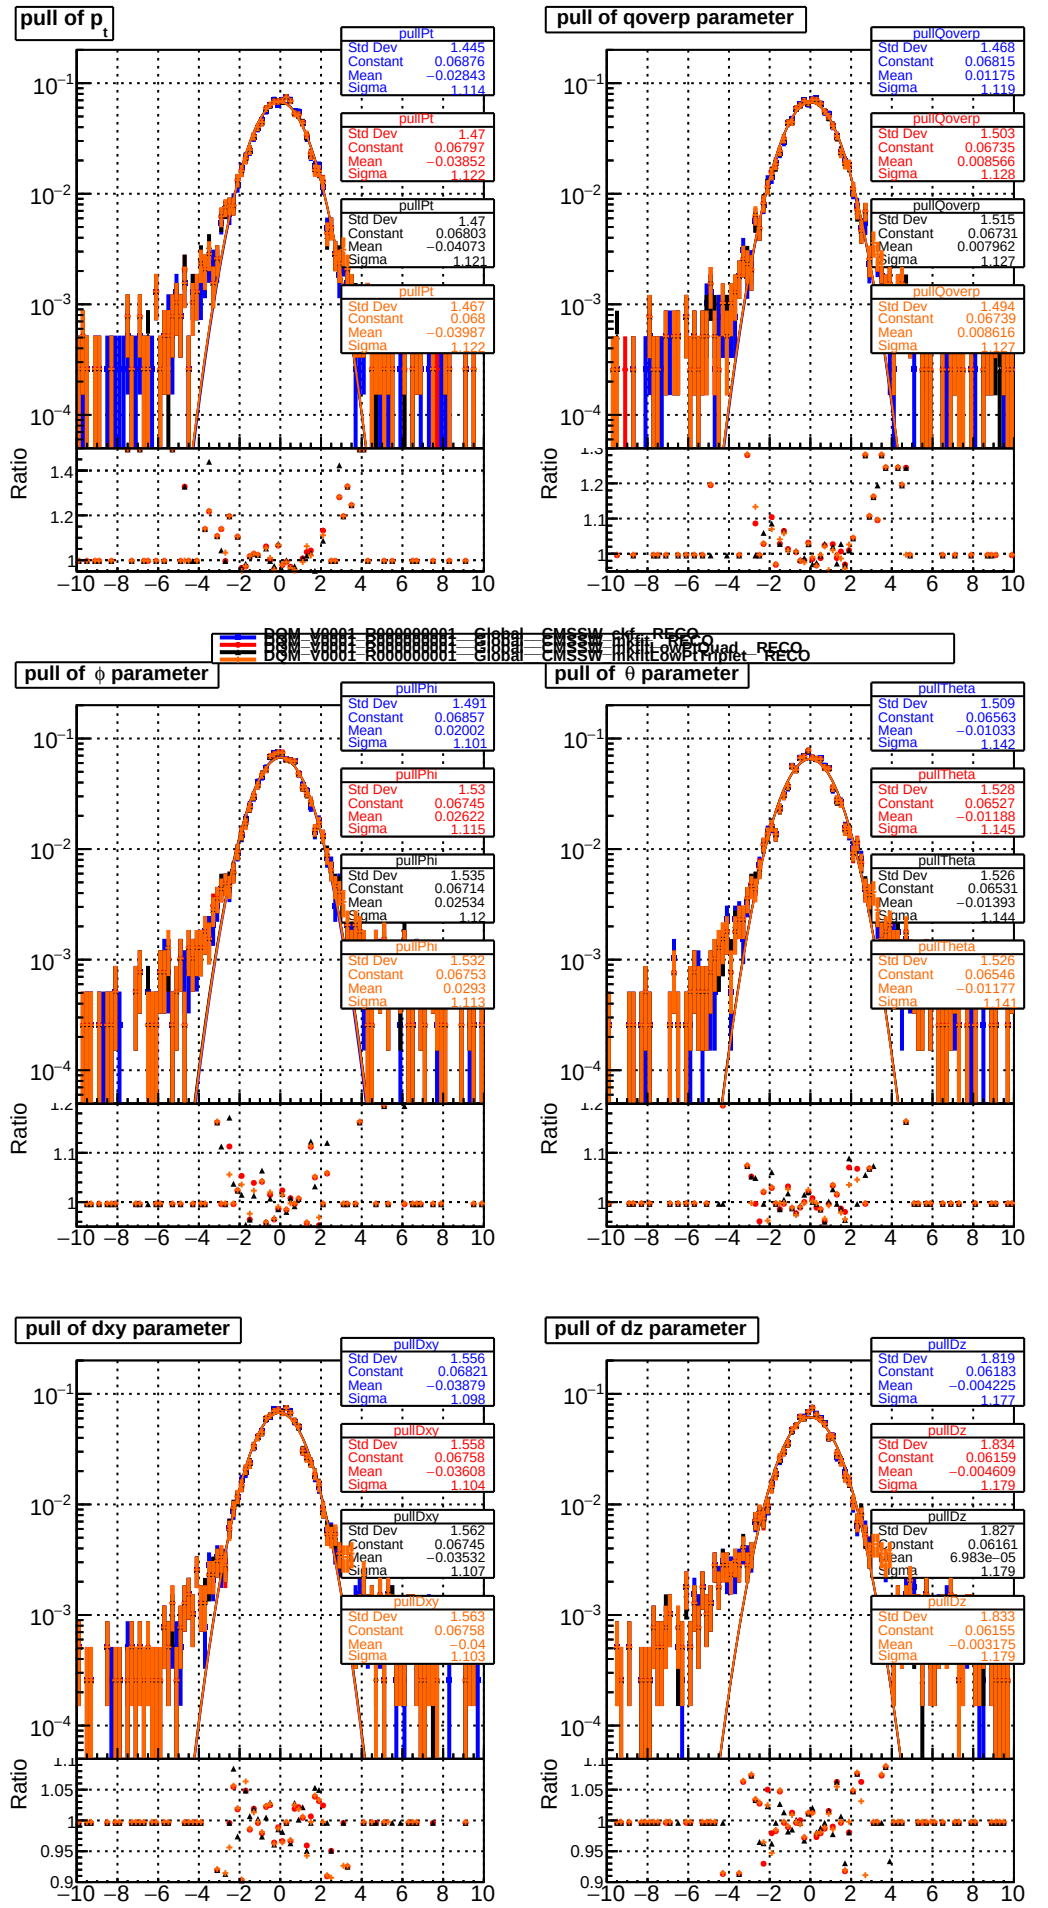
pull of p_t
pullPt
Std Dev 1.445
Constant 0.06876
Mean −0.02843
Sigma 1.114
pullPt
Std Dev 1.47
Constant 0.06797
Mean −0.03852
Sigma 1.122
pullPt
Std Dev 1.47
Constant 0.06803
Mean −0.04073
Sigma 1.121
pullPt
Std Dev 1.467
Constant 0.068
Mean −0.03987
Sigma 1.122
pull of qoverp parameter
pullQoverp
Std Dev 1.468
Constant 0.06815
Mean 0.01175
Sigma 1.119
pullQoverp
Std Dev 1.503
Constant 0.06735
Mean 0.008566
Sigma 1.128
pullQoverp
Std Dev 1.515
Constant 0.06731
Mean 0.007962
Sigma 1.127
pullQoverp
Std Dev 1.494
Constant 0.06739
Mean 0.008616
Sigma 1.127
DQM V0001 R000000001 Global CMSSW clf RECO
DQM V0001 R000000001 Global CMSSW hfilt RECO
DQM V0001 R000000001 Global CMSSW hfilt LowPtQuad RECO
DQM V0001 R000000001 Global CMSSW hfilt LowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 1.491
Constant 0.06857
Mean 0.02002
Sigma 1.101
pullPhi
Std Dev 1.53
Constant 0.06745
Mean 0.02622
Sigma 1.115
pullPhi
Std Dev 1.535
Constant 0.06714
Mean 0.02534
Sigma 1.12
pullPhi
Std Dev 1.532
Constant 0.06753
Mean 0.0293
Sigma 1.113
pull of θ parameter
pullTheta
Std Dev 1.509
Constant 0.06563
Mean −0.01033
Sigma 1.142
pullTheta
Std Dev 1.528
Constant 0.06527
Mean −0.01188
Sigma 1.145
pullTheta
Std Dev 1.526
Constant 0.06531
Mean −0.01393
Sigma 1.144
pullTheta
Std Dev 1.526
Constant 0.06546
Mean −0.01177
Sigma 1.141
pull of dxy parameter
pullDxy
Std Dev 1.556
Constant 0.06821
Mean −0.03879
Sigma 1.098
pullDxy
Std Dev 1.558
Constant 0.06758
Mean −0.03608
Sigma 1.104
pullDxy
Std Dev 1.562
Constant 0.06745
Mean −0.03532
Sigma 1.107
pullDxy
Std Dev 1.563
Constant 0.06758
Mean −0.04
Sigma 1.103
pull of dz parameter
pullDz
Std Dev 1.819
Constant 0.06183
Mean −0.004225
Sigma 1.177
pullDz
Std Dev 1.834
Constant 0.06159
Mean −0.004609
Sigma 1.179
pullDz
Std Dev 1.827
Constant 0.06161
Mean 6.983e−05
Sigma 1.179
pullDz
Std Dev 1.833
Constant 0.06155
Mean −0.003175
Sigma 1.179
Ratio