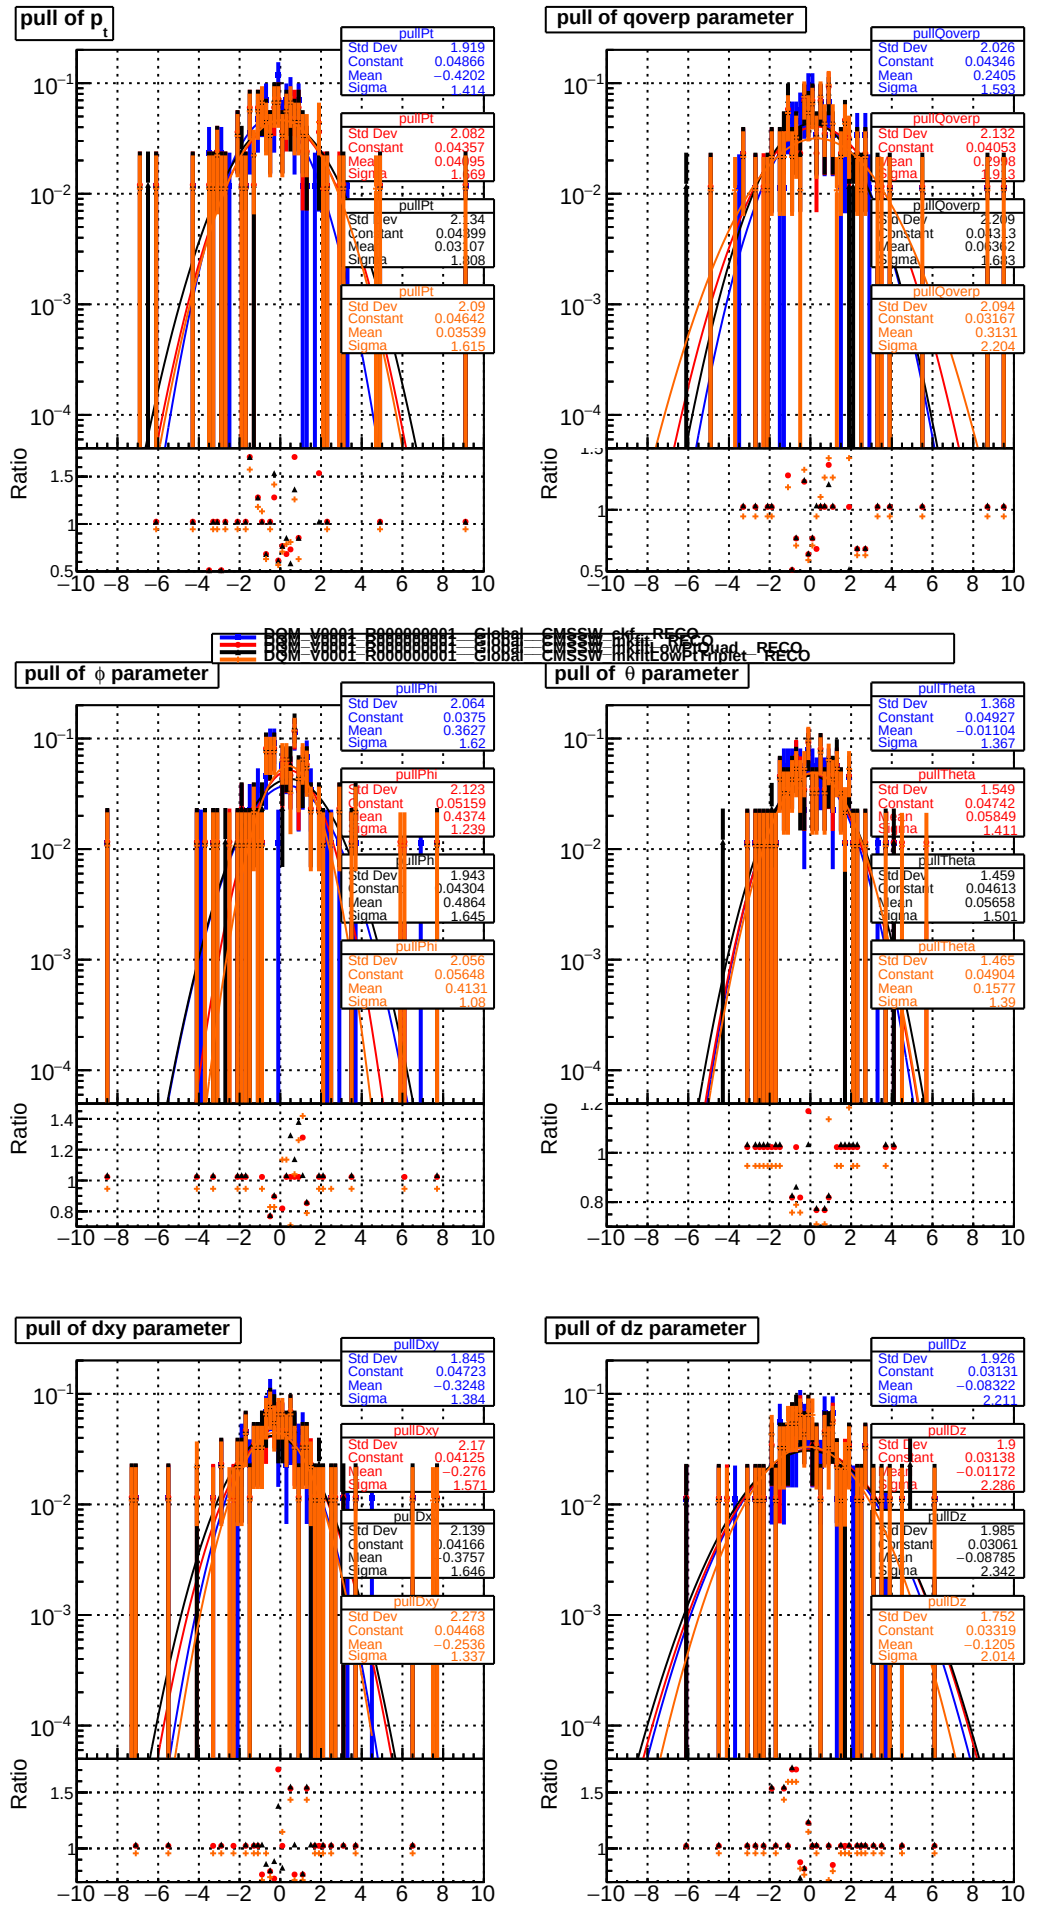
pull of p_t
pullPt
Std Dev 1.919
Constant 0.04866
Mean −0.4202
Sigma 1.414
pullPt
Std Dev 2.082
Constant 0.04357
Mean 0.04095
Sigma 1.669
pullPt
Std Dev 2.34
Constant 0.04399
Mean 0.03107
Sigma 1.808
pullPt
Std Dev 2.09
Constant 0.04642
Mean 0.03539
Sigma 1.615
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.026
Constant 0.04346
Mean 0.2405
Sigma 1.593
pullQoverp
Std Dev 2.132
Constant 0.04053
Mean 0.2998
Sigma 1.613
pullQoverp
Std Dev 2.209
Constant 0.04313
Mean 0.06362
Sigma 1.633
pullQoverp
Std Dev 2.094
Constant 0.03167
Mean 0.3131
Sigma 2.204
Ratio
DQM V0001 R000000001 Global CMSSW clf RECO
DQM V0001 R000000001 Global CMSSW hfilt RECO
DQM V0001 R000000001 Global CMSSW hfilt LowPtQuad RECO
DQM V0001 R000000001 Global CMSSW hfilt LowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 2.064
Constant 0.0375
Mean 0.3627
Sigma 1.62
pullPhi
Std Dev 2.123
Constant 0.05159
Mean 0.4374
Sigma 1.239
pullPhi
Std Dev 1.943
Constant 0.04304
Mean 0.4864
Sigma 1.645
pullPhi
Std Dev 2.056
Constant 0.05648
Mean 0.4131
Sigma 1.08
Ratio
pull of θ parameter
pullTheta
Std Dev 1.368
Constant 0.04927
Mean −0.01104
Sigma 1.367
pullTheta
Std Dev 1.549
Constant 0.04742
Mean 0.05849
Sigma 1.411
pullTheta
Std Dev 1.459
Constant 0.04613
Mean 0.05658
Sigma 1.501
pullTheta
Std Dev 1.465
Constant 0.04904
Mean 0.1577
Sigma 1.39
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.845
Constant 0.04723
Mean −0.3248
Sigma 1.384
pullDxy
Std Dev 2.17
Constant 0.04125
Mean −0.276
Sigma 1.571
pullDxy
Std Dev 2.139
Constant 0.04166
Mean −0.3757
Sigma 1.646
pullDxy
Std Dev 2.273
Constant 0.04468
Mean −0.2536
Sigma 1.337
Ratio
pull of dz parameter
pullDz
Std Dev 1.926
Constant 0.03131
Mean −0.08322
Sigma 2.211
pullDz
Std Dev 1.9
Constant 0.03138
Mean −0.01172
Sigma 2.286
pullDz
Std Dev 1.985
Constant 0.03061
Mean −0.08785
Sigma 2.342
pullDz
Std Dev 1.752
Constant 0.03319
Mean −0.1205
Sigma 2.014
Ratio