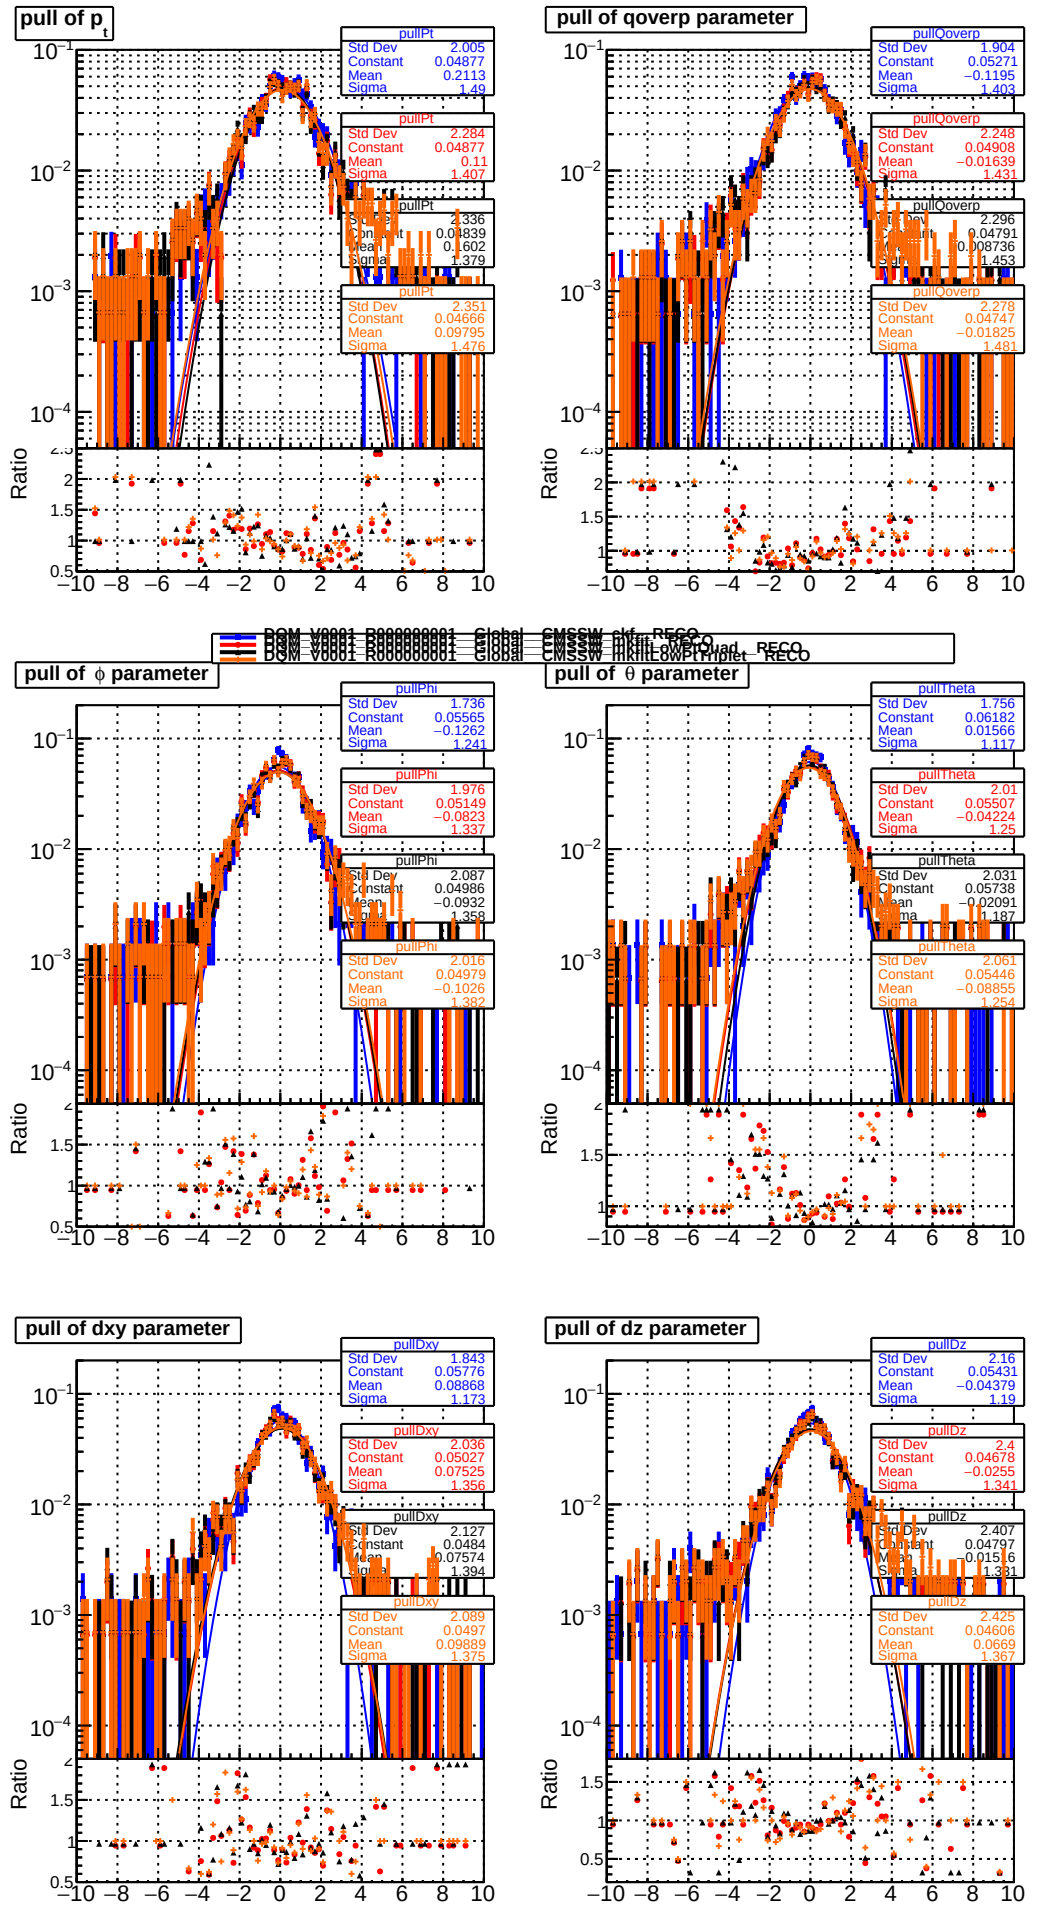
pull of p_t
pullPt
Std Dev 2.005
Constant 0.04877
Mean 0.2113
Sigma 1.49
pullPt
Std Dev 2.284
Constant 0.04877
Mean 0.11
Sigma 1.407
pullPt
Std Dev 2.336
Constant 0.04839
Mean 0.1602
Sigma 1.379
pullPt
Std Dev 2.351
Constant 0.04666
Mean 0.09795
Sigma 1.476
pull of qoverp parameter
pullQoverp
Std Dev 1.904
Constant 0.05271
Mean −0.1195
Sigma 1.403
pullQoverp
Std Dev 2.248
Constant 0.04908
Mean −0.01639
Sigma 1.431
pullQoverp
Std Dev 2.296
Constant 0.04791
Mean −0.008736
Sigma 1.453
pullQoverp
Std Dev 2.278
Constant 0.04747
Mean −0.01825
Sigma 1.481
Ratio
DQM V0001 R000000001 Global CMSSW clkf RECO
DQM V0001 R000000001 Global CMSSW mkfit RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtQuad RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 1.736
Constant 0.05565
Mean −0.1262
Sigma 1.241
pullPhi
Std Dev 1.976
Constant 0.05149
Mean −0.0823
Sigma 1.337
pullPhi
Std Dev 2.087
Constant 0.04986
Mean −0.0932
Sigma 1.358
pullPhi
Std Dev 2.016
Constant 0.04979
Mean −0.1026
Sigma 1.382
pull of θ parameter
pullTheta
Std Dev 1.756
Constant 0.06182
Mean 0.01566
Sigma 1.117
pullTheta
Std Dev 2.01
Constant 0.05507
Mean −0.04224
Sigma 1.25
pullTheta
Std Dev 2.031
Constant 0.05738
Mean −0.02091
Sigma 1.187
pullTheta
Std Dev 2.061
Constant 0.05446
Mean −0.08855
Sigma 1.254
pull of dxy parameter
pullDxy
Std Dev 1.843
Constant 0.05776
Mean 0.08868
Sigma 1.173
pullDxy
Std Dev 2.036
Constant 0.05027
Mean 0.07525
Sigma 1.356
pullDxy
Std Dev 2.127
Constant 0.0484
Mean 0.07574
Sigma 1.394
pullDxy
Std Dev 2.089
Constant 0.0497
Mean 0.09889
Sigma 1.375
pull of dz parameter
pullDz
Std Dev 2.16
Constant 0.05431
Mean −0.04379
Sigma 1.19
pullDz
Std Dev 2.4
Constant 0.04678
Mean −0.0255
Sigma 1.341
pullDz
Std Dev 2.407
Constant 0.04797
Mean 0.01516
Sigma 1.331
pullDz
Std Dev 2.425
Constant 0.04606
Mean 0.0669
Sigma 1.367