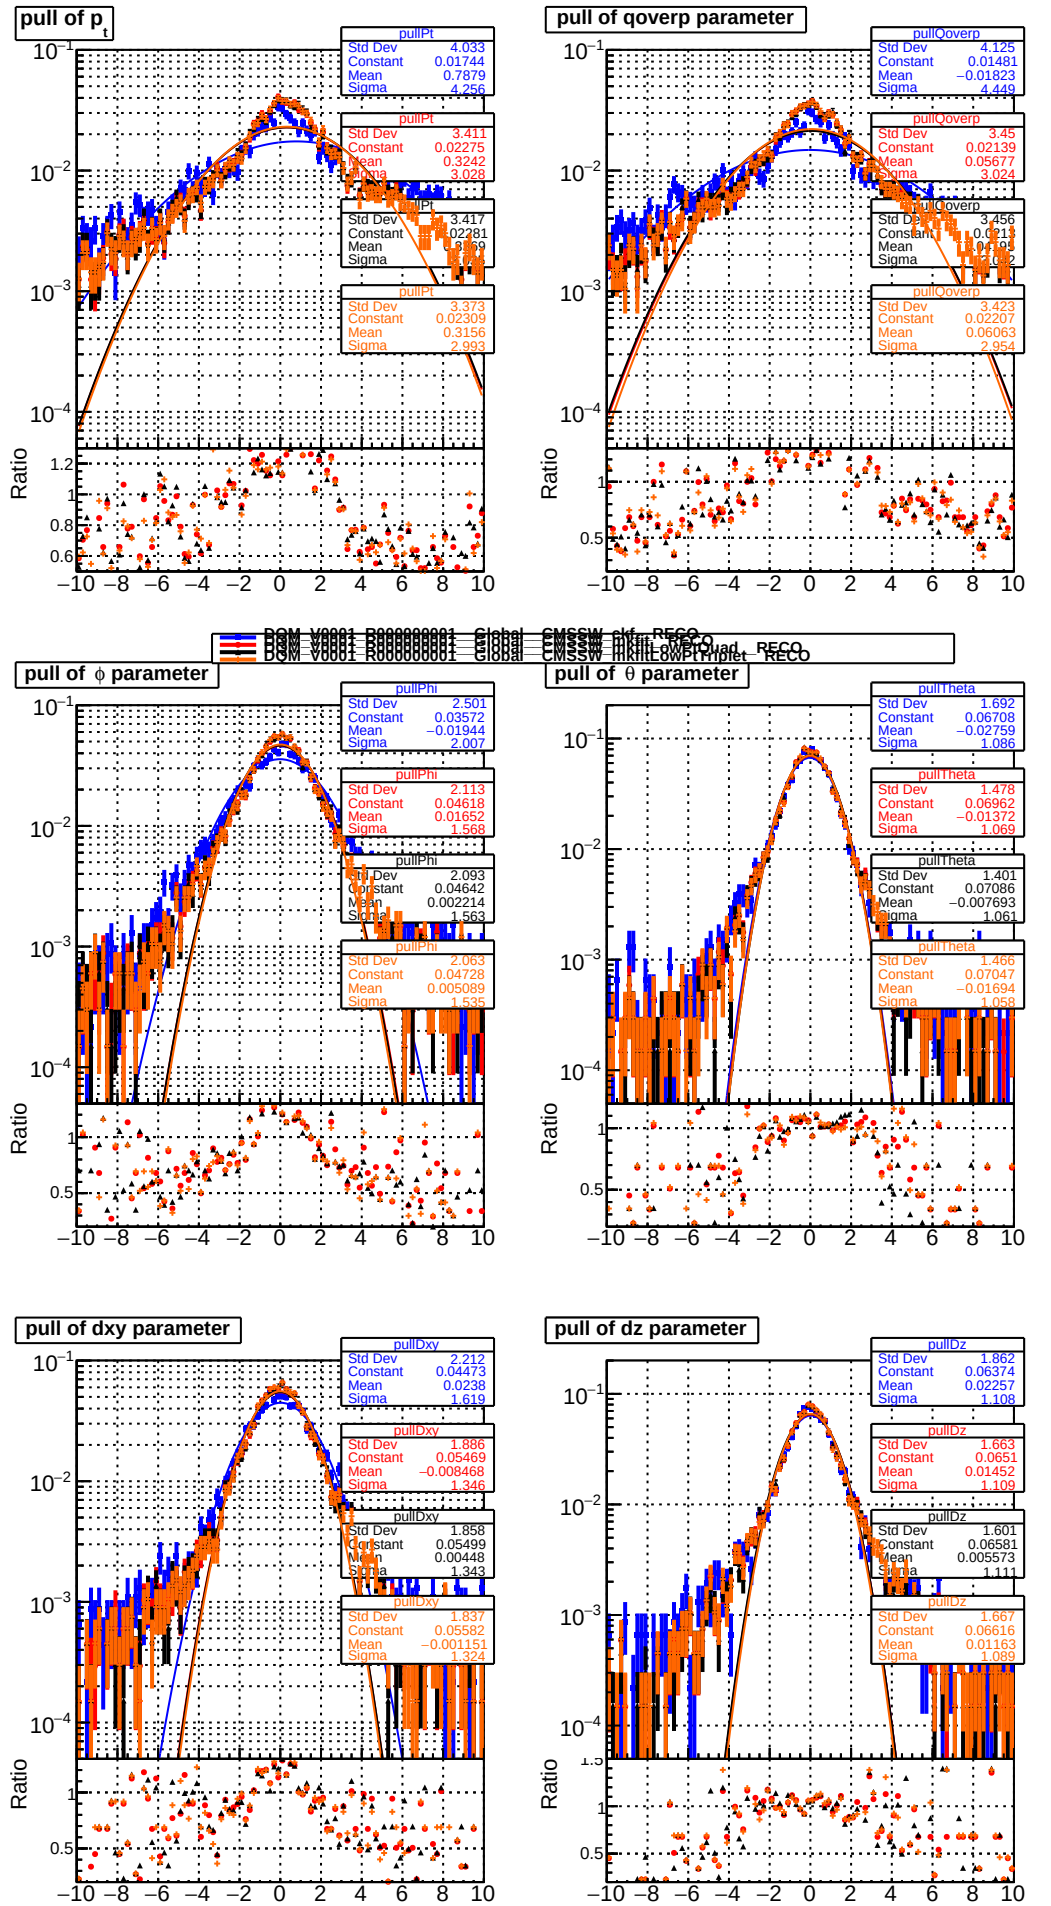
pull of p_t
pullPt
Std Dev 4.033
Constant 0.01744
Mean 0.7879
Sigma 4.256
pullPt
Std Dev 3.411
Constant 0.02275
Mean 0.3242
Sigma 3.028
pullPt
Std Dev 3.417
Constant 0.02281
Mean 0.3169
Sigma 3.029
pullPt
Std Dev 3.373
Constant 0.02309
Mean 0.3156
Sigma 2.993
pull of qoverp parameter
pullQoverp
Std Dev 4.125
Constant 0.01481
Mean −0.01823
Sigma 4.449
pullQoverp
Std Dev 3.45
Constant 0.02139
Mean 0.05677
Sigma 3.024
pullQoverp
Std Dev 3.456
Constant 0.0211
Mean 0.04191
Sigma 3.002
pullQoverp
Std Dev 3.423
Constant 0.02207
Mean 0.06063
Sigma 2.954
Ratio
DQM V0001 R000000001 Global CMSSW clf RECO
DQM V0001 R000000001 Global CMSSW mkfit RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtQuad RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 2.501
Constant 0.03572
Mean −0.01944
Sigma 2.007
pullPhi
Std Dev 2.113
Constant 0.04618
Mean 0.01652
Sigma 1.568
pullPhi
Std Dev 2.093
Constant 0.04642
Mean 0.002214
Sigma 1.563
pullPhi
Std Dev 2.063
Constant 0.04728
Mean 0.005089
Sigma 1.535
pull of θ parameter
pullTheta
Std Dev 1.692
Constant 0.06708
Mean −0.02759
Sigma 1.086
pullTheta
Std Dev 1.478
Constant 0.06962
Mean −0.01372
Sigma 1.069
pullTheta
Std Dev 1.401
Constant 0.07086
Mean −0.007693
Sigma 1.061
pullTheta
Std Dev 1.466
Constant 0.07047
Mean −0.01694
Sigma 1.058
pull of dxy parameter
pullDxy
Std Dev 2.212
Constant 0.04473
Mean 0.0238
Sigma 1.619
pullDxy
Std Dev 1.886
Constant 0.05469
Mean −0.008468
Sigma 1.346
pullDxy
Std Dev 1.858
Constant 0.05499
Mean 0.00448
Sigma 1.343
pullDxy
Std Dev 1.837
Constant 0.05582
Mean −0.001151
Sigma 1.324
pull of dz parameter
pullDz
Std Dev 1.862
Constant 0.06374
Mean 0.02257
Sigma 1.108
pullDz
Std Dev 1.663
Constant 0.0651
Mean 0.01452
Sigma 1.109
pullDz
Std Dev 1.601
Constant 0.06581
Mean 0.005573
Sigma 1.111
pullDz
Std Dev 1.667
Constant 0.06616
Mean 0.01163
Sigma 1.089