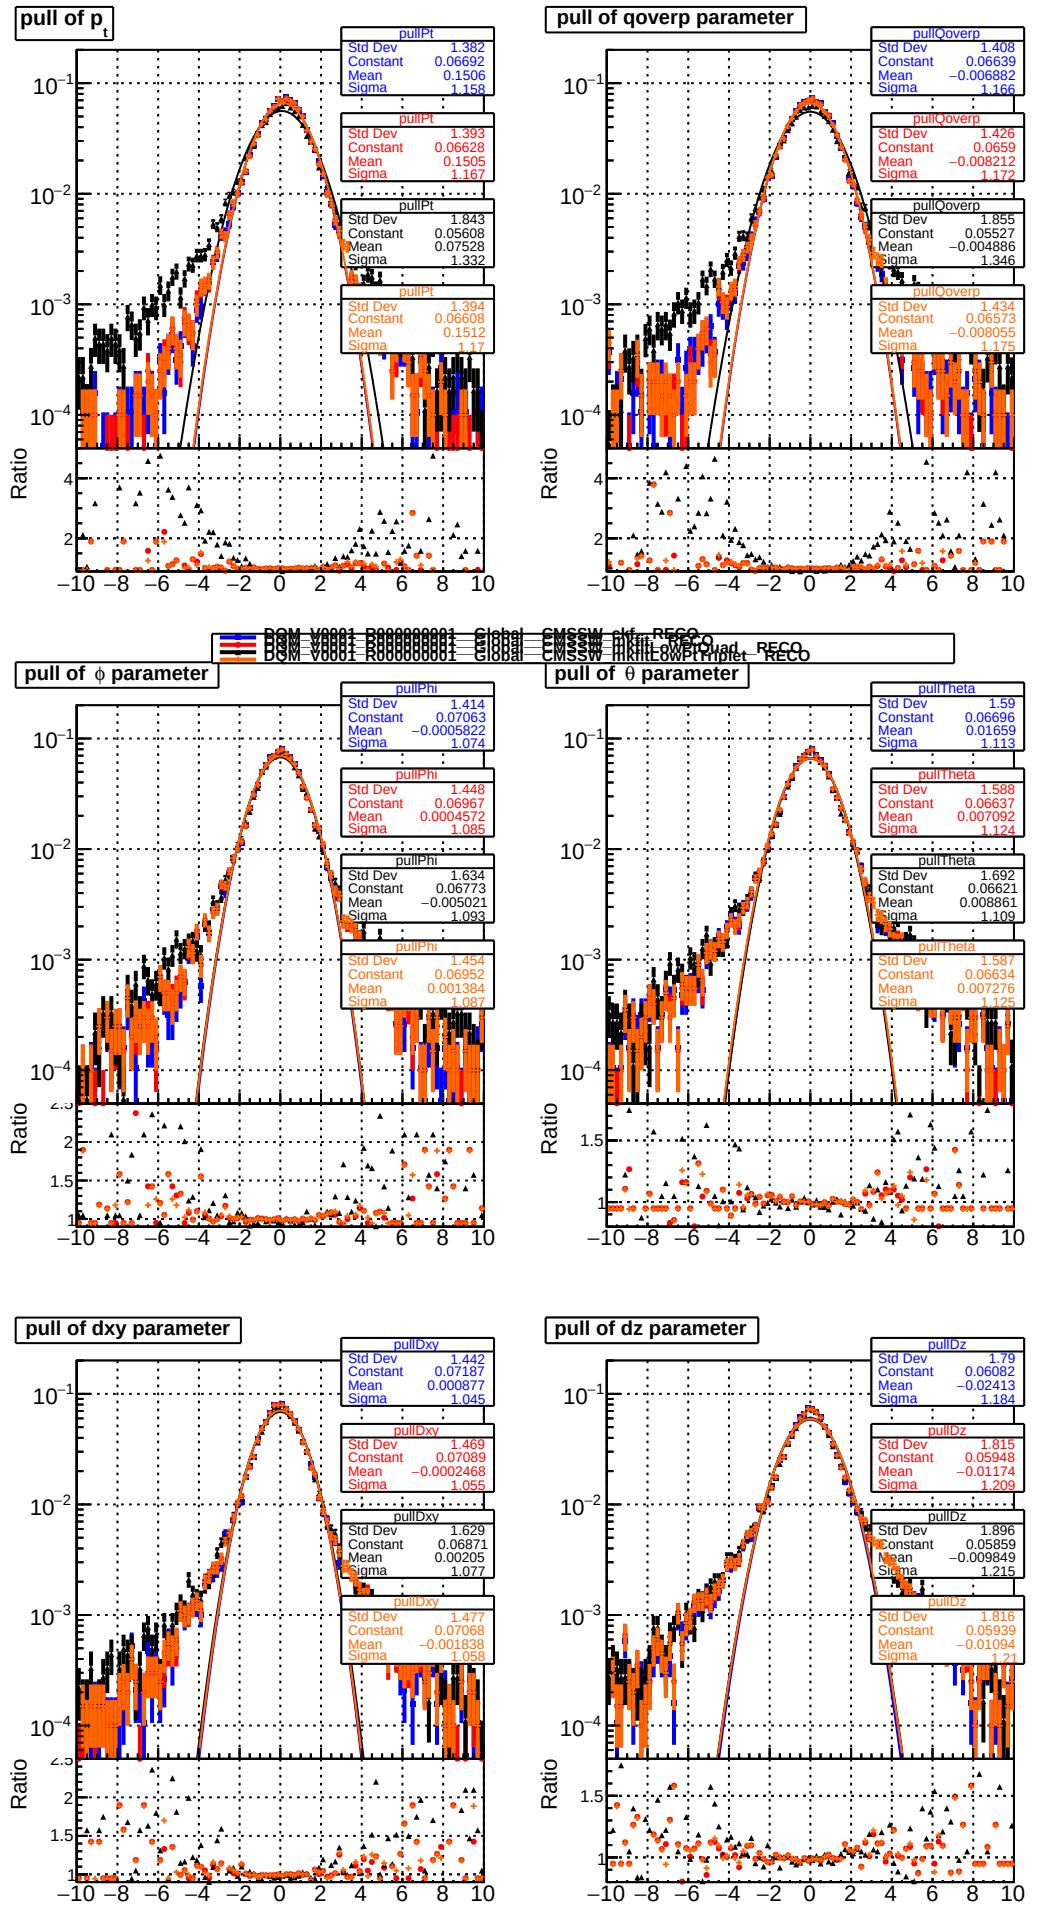
pull of p_t
pullPt
Std Dev 1.382
Constant 0.06692
Mean 0.1506
Sigma 1.158
pullPt
Std Dev 1.393
Constant 0.06628
Mean 0.1505
Sigma 1.167
pullPt
Std Dev 1.843
Constant 0.05608
Mean 0.07528
Sigma 1.332
pullPt
Std Dev 1.394
Constant 0.06608
Mean 0.1512
Sigma 1.17
pull of qoverp parameter
pullQoverp
Std Dev 1.408
Constant 0.06639
Mean −0.006882
Sigma 1.166
pullQoverp
Std Dev 1.426
Constant 0.0659
Mean −0.008212
Sigma 1.172
pullQoverp
Std Dev 1.855
Constant 0.05527
Mean −0.004886
Sigma 1.346
pullQoverp
Std Dev 1.434
Constant 0.06573
Mean −0.008055
Sigma 1.175
DQM V0001 R000000001 Global CMSSW ckf RECO
DQM V0001 R000000001 Global CMSSW ckfTrackCandidates RECO
DQM V0001 R000000001 Global CMSSW ckfTrackCandidates RECO
DQM V0001 R000000001 Global CMSSW ckfTrackCandidates RECO
pull of ϕ parameter
pullPhi
Std Dev 1.414
Constant 0.07063
Mean −0.0005822
Sigma 1.074
pullPhi
Std Dev 1.448
Constant 0.06967
Mean 0.0004572
Sigma 1.085
pullPhi
Std Dev 1.634
Constant 0.06773
Mean −0.005021
Sigma 1.093
pullPhi
Std Dev 1.454
Constant 0.06952
Mean 0.001384
Sigma 1.087
pull of θ parameter
pullTheta
Std Dev 1.59
Constant 0.06696
Mean 0.01659
Sigma 1.113
pullTheta
Std Dev 1.588
Constant 0.06637
Mean 0.007092
Sigma 1.124
pullTheta
Std Dev 1.692
Constant 0.06621
Mean 0.008861
Sigma 1.109
pullTheta
Std Dev 1.587
Constant 0.06634
Mean 0.007276
Sigma 1.125
pull of dxy parameter
pullDxy
Std Dev 1.442
Constant 0.07187
Mean 0.000877
Sigma 1.045
pullDxy
Std Dev 1.469
Constant 0.07089
Mean −0.0002468
Sigma 1.055
pullDxy
Std Dev 1.629
Constant 0.06871
Mean 0.00205
Sigma 1.077
pullDxy
Std Dev 1.477
Constant 0.07068
Mean −0.001838
Sigma 1.058
pull of dz parameter
pullDz
Std Dev 1.79
Constant 0.06082
Mean −0.02413
Sigma 1.184
pullDz
Std Dev 1.815
Constant 0.05948
Mean −0.01174
Sigma 1.209
pullDz
Std Dev 1.896
Constant 0.05859
Mean −0.009849
Sigma 1.215
pullDz
Std Dev 1.816
Constant 0.05939
Mean −0.01094
Sigma 1.21
Ratio