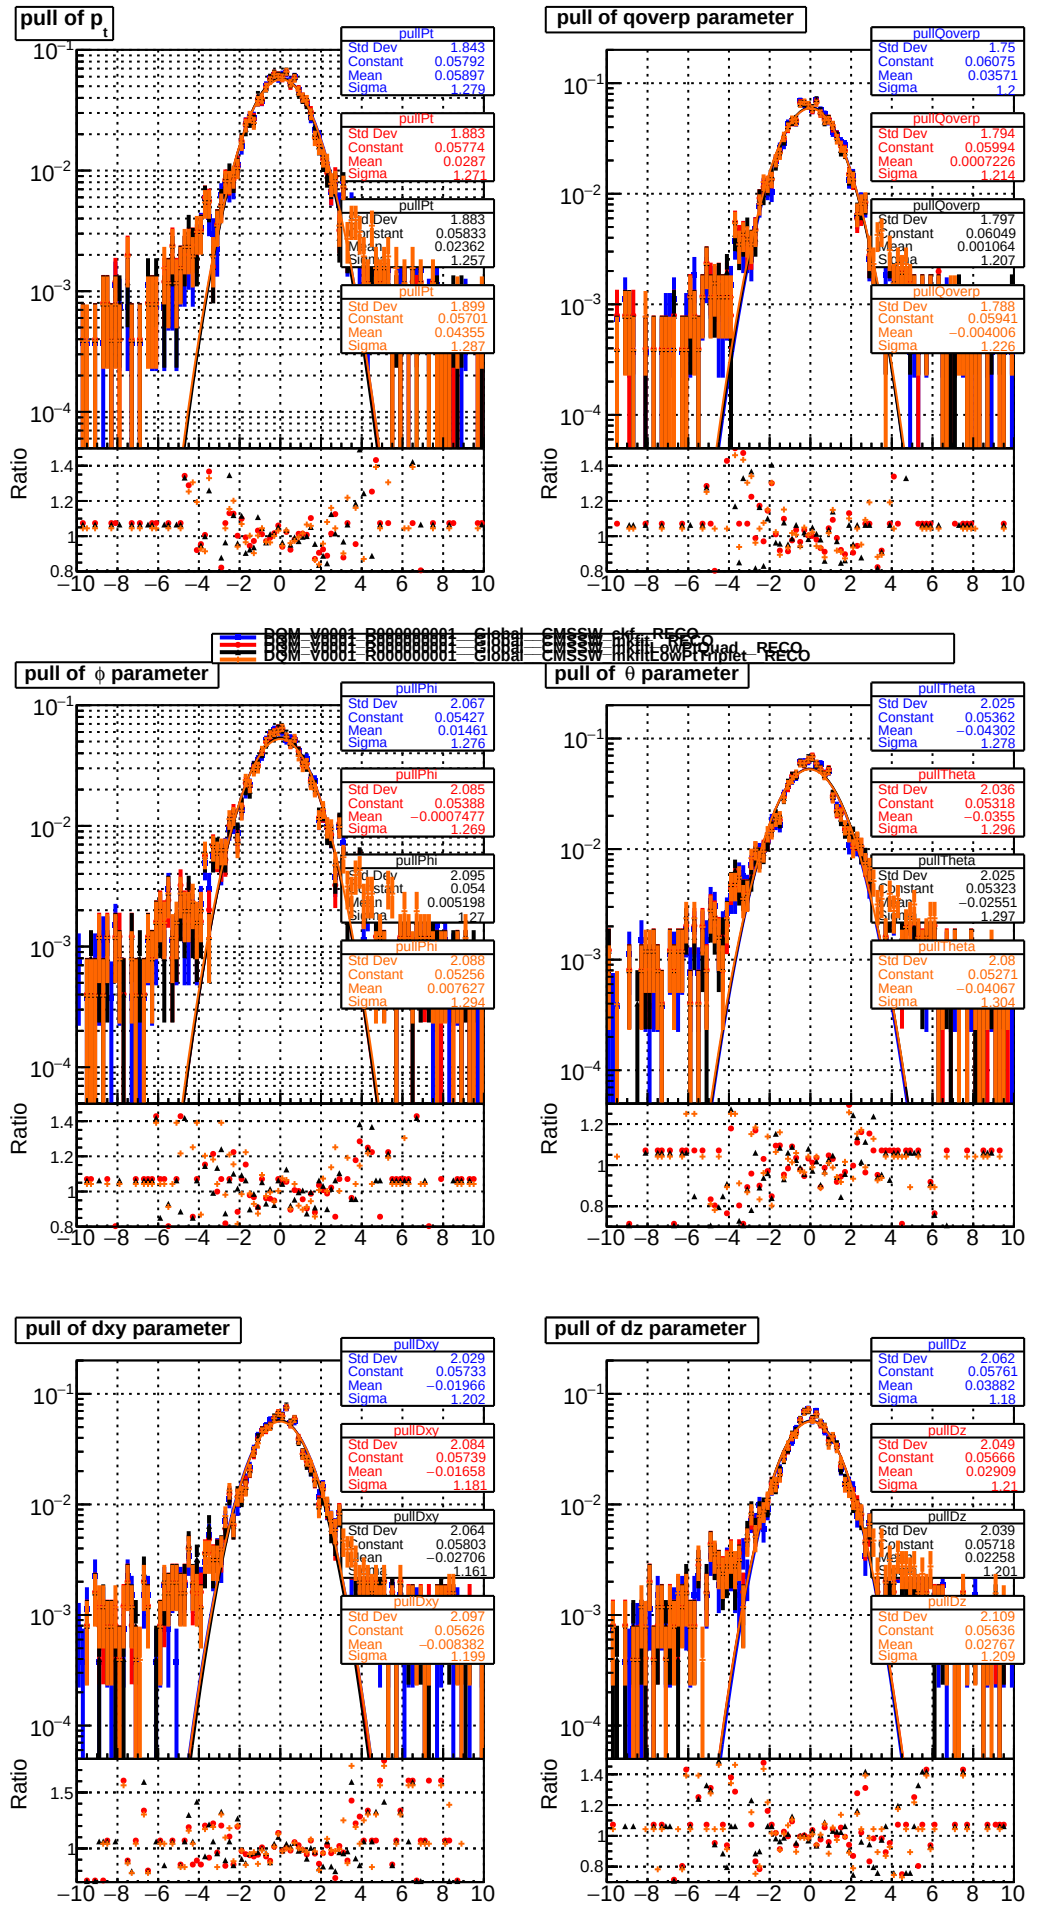
pull of p_t
pullPt
Std Dev 1.843
Constant 0.05792
Mean 0.05897
Sigma 1.279
pullPt
Std Dev 1.883
Constant 0.05774
Mean 0.0287
Sigma 1.271
pullPt
Std Dev 1.883
Constant 0.05833
Mean 0.02362
Sigma 1.257
pullPt
Std Dev 1.899
Constant 0.05701
Mean 0.04355
Sigma 1.287
pull of qoverp parameter
pullQoverp
Std Dev 1.75
Constant 0.06075
Mean 0.03571
Sigma 1.2
pullQoverp
Std Dev 1.794
Constant 0.05994
Mean 0.0007226
Sigma 1.214
pullQoverp
Std Dev 1.797
Constant 0.06049
Mean 0.001064
Sigma 1.207
pullQoverp
Std Dev 1.788
Constant 0.05941
Mean −0.004006
Sigma 1.226
DQM V0001 R000000001 Global CMSSW clf RECO
DQM V0001 R000000001 Global CMSSW hfilt RECO
DQM V0001 R000000001 Global CMSSW hfilt_lowPtQuad RECO
DQM V0001 R000000001 Global CMSSW hfilt_lowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 2.067
Constant 0.05427
Mean 0.01461
Sigma 1.276
pullPhi
Std Dev 2.085
Constant 0.05388
Mean −0.0007477
Sigma 1.269
pullPhi
Std Dev 2.095
Constant 0.054
Mean 0.005198
Sigma 1.27
pullPhi
Std Dev 2.088
Constant 0.05256
Mean 0.007627
Sigma 1.294
pull of θ parameter
pullTheta
Std Dev 2.025
Constant 0.05362
Mean −0.04302
Sigma 1.278
pullTheta
Std Dev 2.036
Constant 0.05318
Mean −0.0355
Sigma 1.296
pullTheta
Std Dev 2.025
Constant 0.05323
Mean −0.02551
Sigma 1.297
pullTheta
Std Dev 2.08
Constant 0.05271
Mean −0.04067
Sigma 1.304
pull of dxy parameter
pullDxy
Std Dev 2.029
Constant 0.05733
Mean −0.01966
Sigma 1.202
pullDxy
Std Dev 2.084
Constant 0.05739
Mean −0.01658
Sigma 1.181
pullDxy
Std Dev 2.064
Constant 0.05803
Mean −0.02706
Sigma 1.161
pullDxy
Std Dev 2.097
Constant 0.05626
Mean −0.008382
Sigma 1.199
pull of dz parameter
pullDz
Std Dev 2.062
Constant 0.05761
Mean 0.03882
Sigma 1.18
pullDz
Std Dev 2.049
Constant 0.05666
Mean 0.02909
Sigma 1.21
pullDz
Std Dev 2.039
Constant 0.05718
Mean 0.02258
Sigma 1.201
pullDz
Std Dev 2.109
Constant 0.05636
Mean 0.02767
Sigma 1.209
Ratio