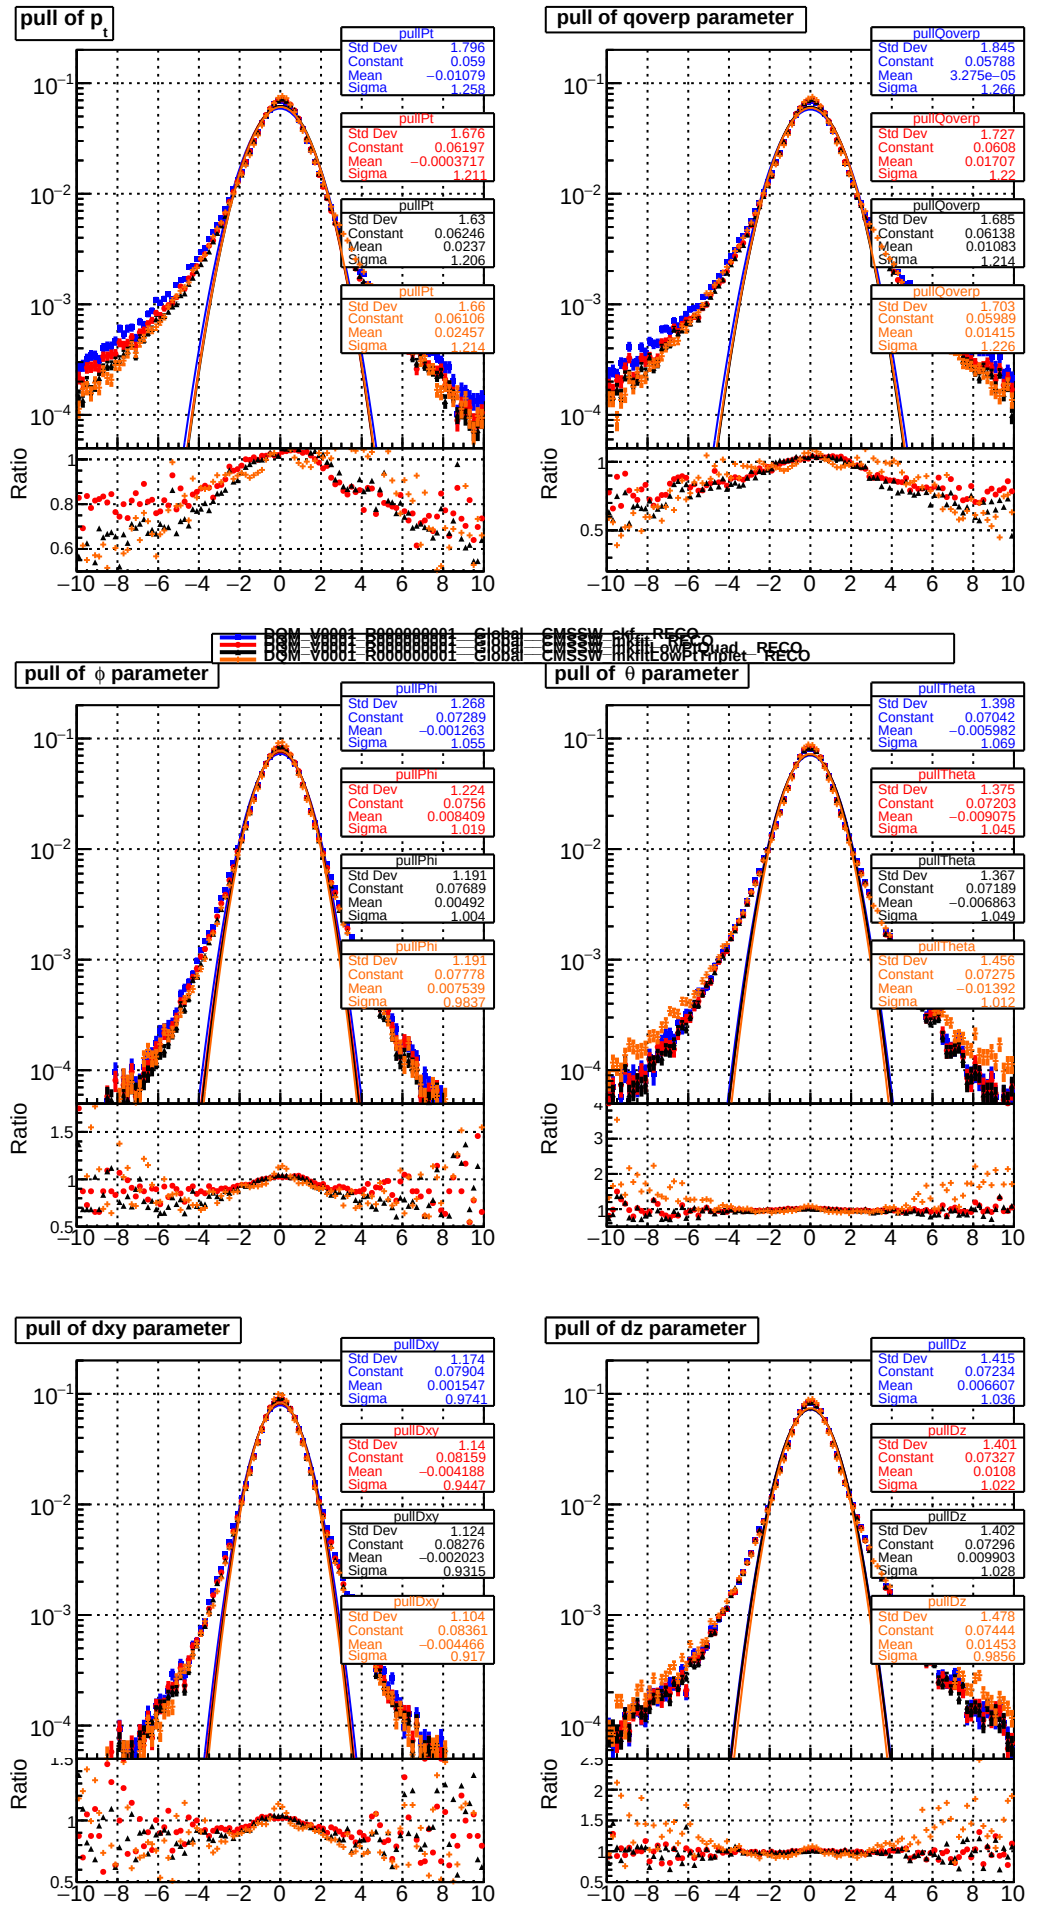
pull of p_t
pullPt
Std Dev 1.796
Constant 0.059
Mean −0.01079
Sigma 1.258
pullPt
Std Dev 1.676
Constant 0.06197
Mean −0.0003717
Sigma 1.211
pullPt
Std Dev 1.63
Constant 0.06246
Mean 0.0237
Sigma 1.206
pullPt
Std Dev 1.66
Constant 0.06106
Mean 0.02457
Sigma 1.214
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.845
Constant 0.05788
Mean 3.275e−05
Sigma 1.266
pullQoverp
Std Dev 1.727
Constant 0.0608
Mean 0.01707
Sigma 1.22
pullQoverp
Std Dev 1.685
Constant 0.06138
Mean 0.01083
Sigma 1.214
pullQoverp
Std Dev 1.703
Constant 0.05989
Mean 0.01415
Sigma 1.226
Ratio
DQM V0001 R000000001 Global CMSSW clkf RECO
DQM V0001 R000000001 Global CMSSW mkfit RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtQuad RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 1.268
Constant 0.07289
Mean −0.001263
Sigma 1.055
pullPhi
Std Dev 1.224
Constant 0.0756
Mean 0.008409
Sigma 1.019
pullPhi
Std Dev 1.191
Constant 0.07689
Mean 0.00492
Sigma 1.004
pullPhi
Std Dev 1.191
Constant 0.07778
Mean 0.007539
Sigma 0.9837
Ratio
pull of θ parameter
pullTheta
Std Dev 1.398
Constant 0.07042
Mean −0.005982
Sigma 1.069
pullTheta
Std Dev 1.375
Constant 0.07203
Mean −0.009075
Sigma 1.045
pullTheta
Std Dev 1.367
Constant 0.07189
Mean −0.006863
Sigma 1.049
pullTheta
Std Dev 1.456
Constant 0.07275
Mean −0.01392
Sigma 1.012
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.174
Constant 0.07904
Mean 0.001547
Sigma 0.9741
pullDxy
Std Dev 1.14
Constant 0.08159
Mean −0.004188
Sigma 0.9447
pullDxy
Std Dev 1.124
Constant 0.08276
Mean −0.002023
Sigma 0.9315
pullDxy
Std Dev 1.104
Constant 0.08361
Mean −0.004466
Sigma 0.917
Ratio
pull of dz parameter
pullDz
Std Dev 1.415
Constant 0.07234
Mean 0.006607
Sigma 1.036
pullDz
Std Dev 1.401
Constant 0.07327
Mean 0.0108
Sigma 1.022
pullDz
Std Dev 1.402
Constant 0.07296
Mean 0.009903
Sigma 1.028
pullDz
Std Dev 1.478
Constant 0.07444
Mean 0.01453
Sigma 0.9856
Ratio