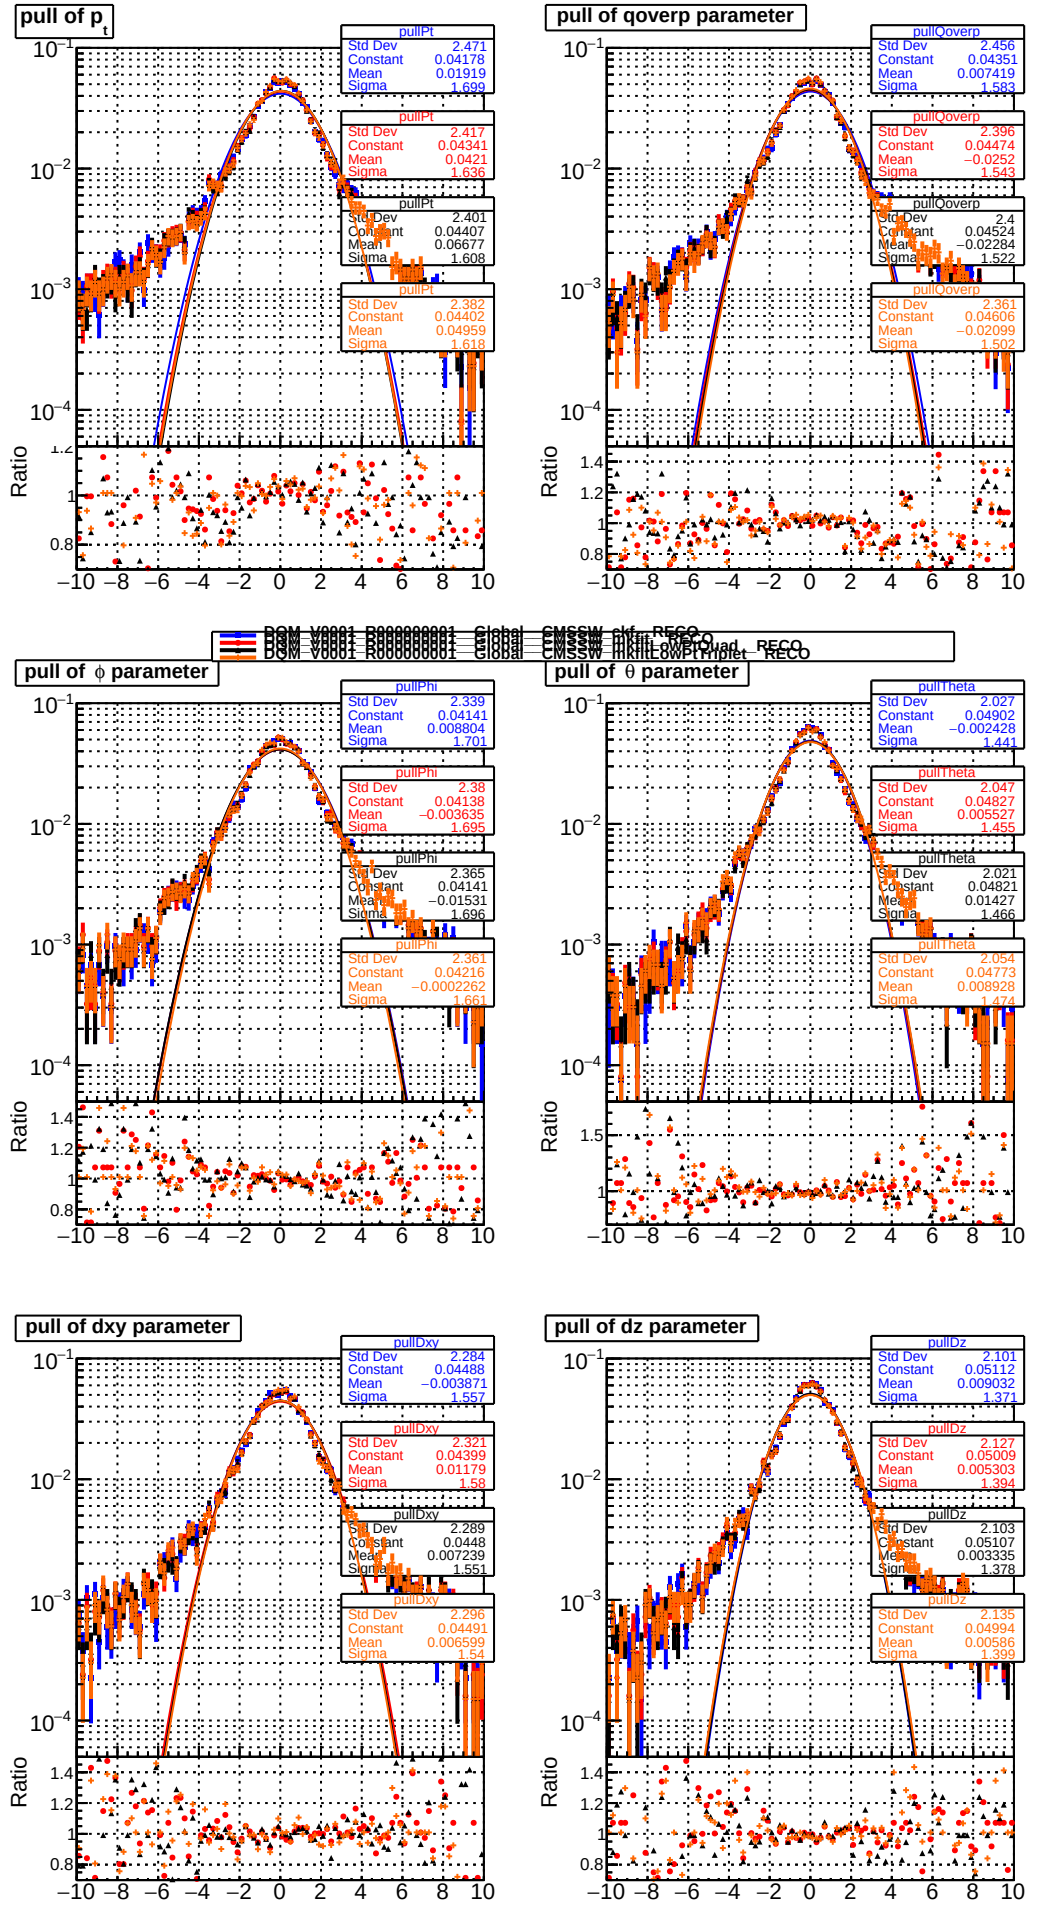
pull of p_t
pullPt
Std Dev 2.471
Constant 0.04178
Mean 0.01919
Sigma 1.699
pullPt
Std Dev 2.417
Constant 0.04341
Mean 0.0421
Sigma 1.636
pullPt
Std Dev 2.401
Constant 0.04407
Mean 0.06677
Sigma 1.608
pullPt
Std Dev 2.382
Constant 0.04402
Mean 0.04959
Sigma 1.618
pull of qoverp parameter
pullQoverp
Std Dev 2.456
Constant 0.04351
Mean 0.007419
Sigma 1.583
pullQoverp
Std Dev 2.396
Constant 0.04474
Mean −0.0252
Sigma 1.543
pullQoverp
Std Dev 2.4
Constant 0.04524
Mean −0.02284
Sigma 1.522
pullQoverp
Std Dev 2.361
Constant 0.04606
Mean −0.02099
Sigma 1.502
DQM V0001 R000000001 Global CMSSW clf RECO
DQM V0001 R000000001 Global CMSSW mkfit RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtQuad RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 2.339
Constant 0.04141
Mean 0.008804
Sigma 1.701
pullPhi
Std Dev 2.38
Constant 0.04138
Mean −0.003635
Sigma 1.695
pullPhi
Std Dev 2.365
Constant 0.04141
Mean −0.01531
Sigma 1.696
pullPhi
Std Dev 2.361
Constant 0.04216
Mean −0.0002262
Sigma 1.661
pull of θ parameter
pullTheta
Std Dev 2.027
Constant 0.04902
Mean −0.002428
Sigma 1.441
pullTheta
Std Dev 2.047
Constant 0.04827
Mean 0.005527
Sigma 1.455
pullTheta
Std Dev 2.021
Constant 0.04821
Mean 0.01427
Sigma 1.466
pullTheta
Std Dev 2.054
Constant 0.04773
Mean 0.008928
Sigma 1.474
pull of dxy parameter
pullDxy
Std Dev 2.284
Constant 0.04488
Mean −0.003871
Sigma 1.557
pullDxy
Std Dev 2.321
Constant 0.04399
Mean 0.01179
Sigma 1.58
pullDxy
Std Dev 2.289
Constant 0.0448
Mean 0.007239
Sigma 1.551
pullDxy
Std Dev 2.296
Constant 0.04491
Mean 0.006599
Sigma 1.54
pull of dz parameter
pullDz
Std Dev 2.101
Constant 0.05112
Mean 0.009032
Sigma 1.371
pullDz
Std Dev 2.127
Constant 0.05009
Mean 0.005303
Sigma 1.394
pullDz
Std Dev 2.103
Constant 0.05107
Mean 0.003335
Sigma 1.378
pullDz
Std Dev 2.135
Constant 0.04994
Mean 0.00586
Sigma 1.399
Ratio