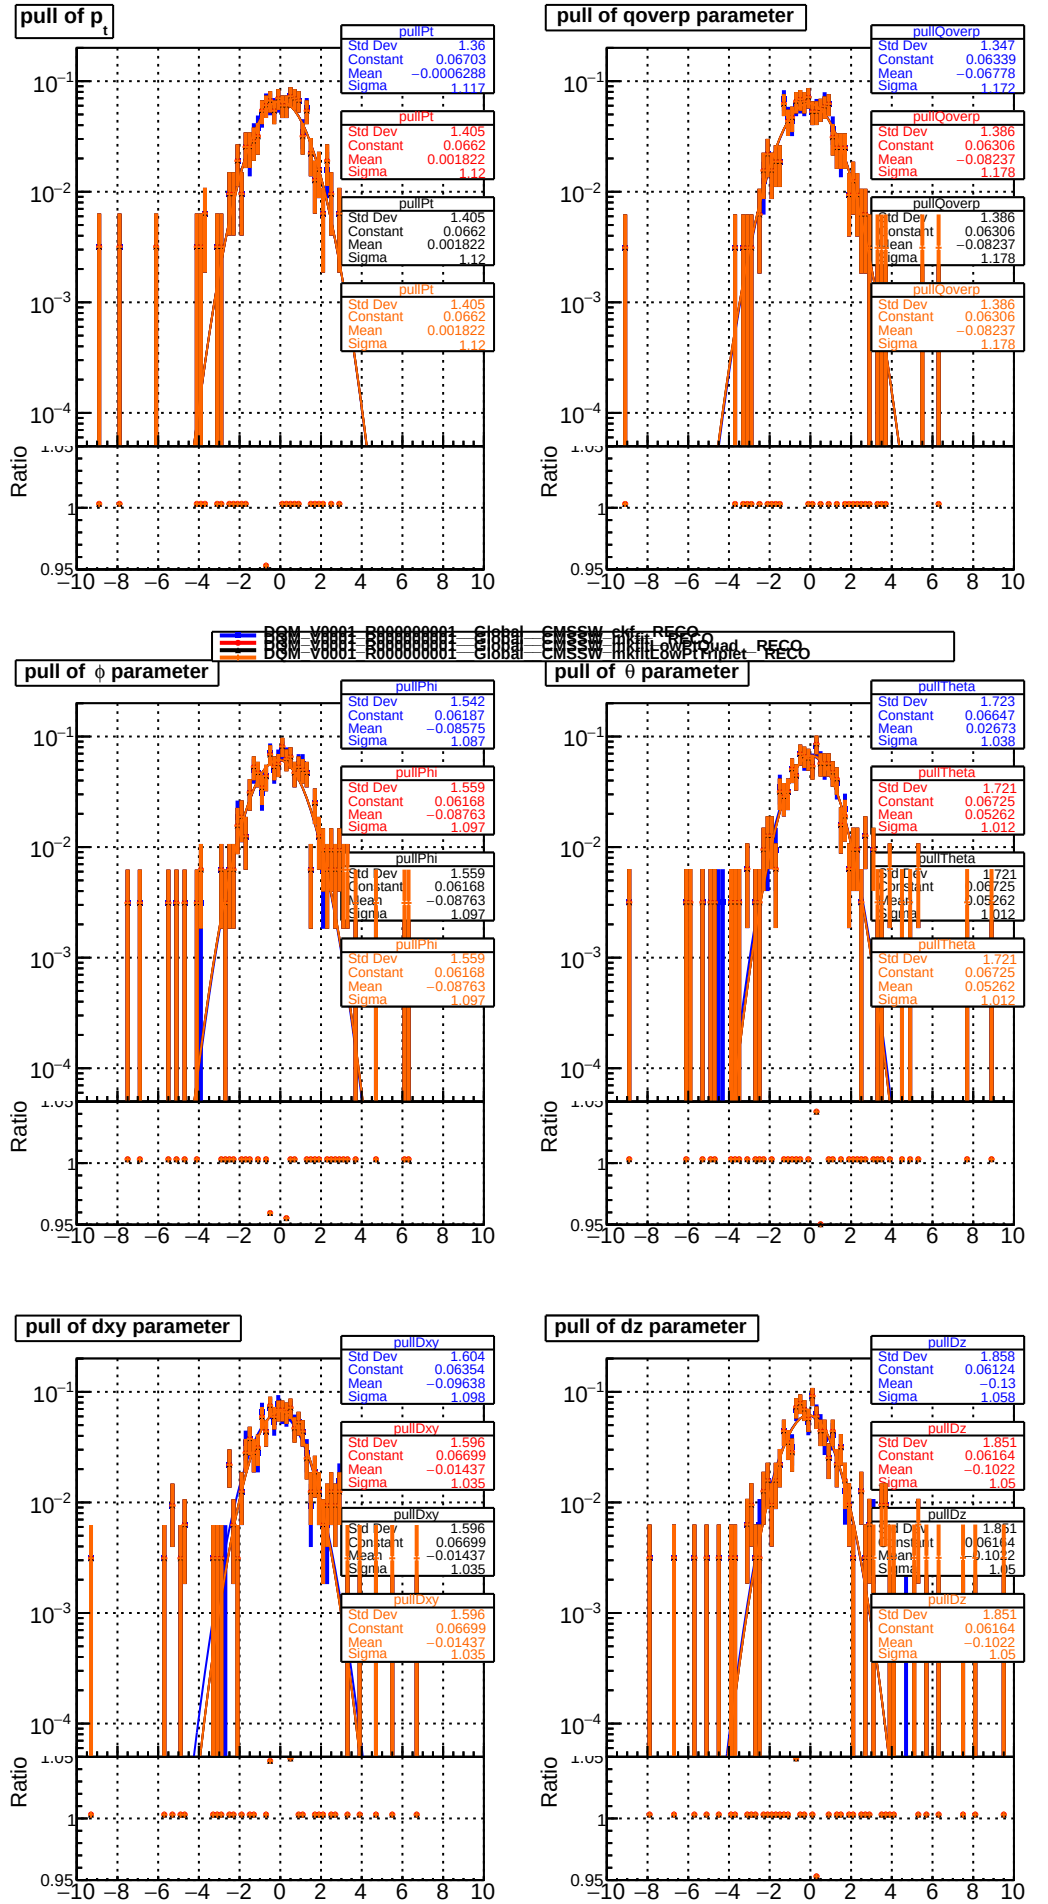
pull of p_t
pullPt
Std Dev 1.36
Constant 0.06703
Mean −0.0006288
Sigma 1.117
pullPt
Std Dev 1.405
Constant 0.0662
Mean 0.001822
Sigma 1.12
pullPt
Std Dev 1.405
Constant 0.0662
Mean 0.001822
Sigma 1.12
pullPt
Std Dev 1.405
Constant 0.0662
Mean 0.001822
Sigma 1.12
pull of qoverp parameter
pullQoverp
Std Dev 1.347
Constant 0.06339
Mean −0.06778
Sigma 1.172
pullQoverp
Std Dev 1.386
Constant 0.06306
Mean −0.08237
Sigma 1.178
pullQoverp
Std Dev 1.386
Constant 0.06306
Mean −0.08237
Sigma 1.178
pullQoverp
Std Dev 1.386
Constant 0.06306
Mean −0.08237
Sigma 1.178
DQM V0001 R000000001 Global CMSSW_ckf_RECO
DQM V0001 R000000001 Global CMSSW_hiInit_RECO
DQM V0001 R000000001 Global CMSSW_hiInit_LowPtQuad_RECO
DQM V0001 R000000001 Global CMSSW_hiInitLowPtTriplet_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.542
Constant 0.06187
Mean −0.08575
Sigma 1.087
pullPhi
Std Dev 1.559
Constant 0.06168
Mean −0.08763
Sigma 1.097
pullPhi
Std Dev 1.559
Constant 0.06168
Mean −0.08763
Sigma 1.097
pullPhi
Std Dev 1.559
Constant 0.06168
Mean −0.08763
Sigma 1.097
pull of θ parameter
pullTheta
Std Dev 1.723
Constant 0.06647
Mean 0.02673
Sigma 1.038
pullTheta
Std Dev 1.721
Constant 0.06725
Mean 0.05262
Sigma 1.012
pullTheta
Std Dev 1.721
Constant 0.06725
Mean 0.05262
Sigma 1.012
pullTheta
Std Dev 1.721
Constant 0.06725
Mean 0.05262
Sigma 1.012
pull of dxy parameter
pullDxy
Std Dev 1.604
Constant 0.06354
Mean −0.09638
Sigma 1.098
pullDxy
Std Dev 1.596
Constant 0.06699
Mean −0.01437
Sigma 1.035
pullDxy
Std Dev 1.596
Constant 0.06699
Mean −0.01437
Sigma 1.035
pullDxy
Std Dev 1.596
Constant 0.06699
Mean −0.01437
Sigma 1.035
pull of dz parameter
pullDz
Std Dev 1.858
Constant 0.06124
Mean −0.13
Sigma 1.058
pullDz
Std Dev 1.851
Constant 0.06164
Mean −0.1022
Sigma 1.05
pullDz
Std Dev 1.851
Constant 0.06164
Mean −0.1022
Sigma 1.05
pullDz
Std Dev 1.851
Constant 0.06164
Mean −0.1022
Sigma 1.05
Ratio
1.05
1
0.95
−10 −8 −6 −4 −2 0 2 4 6 8 10