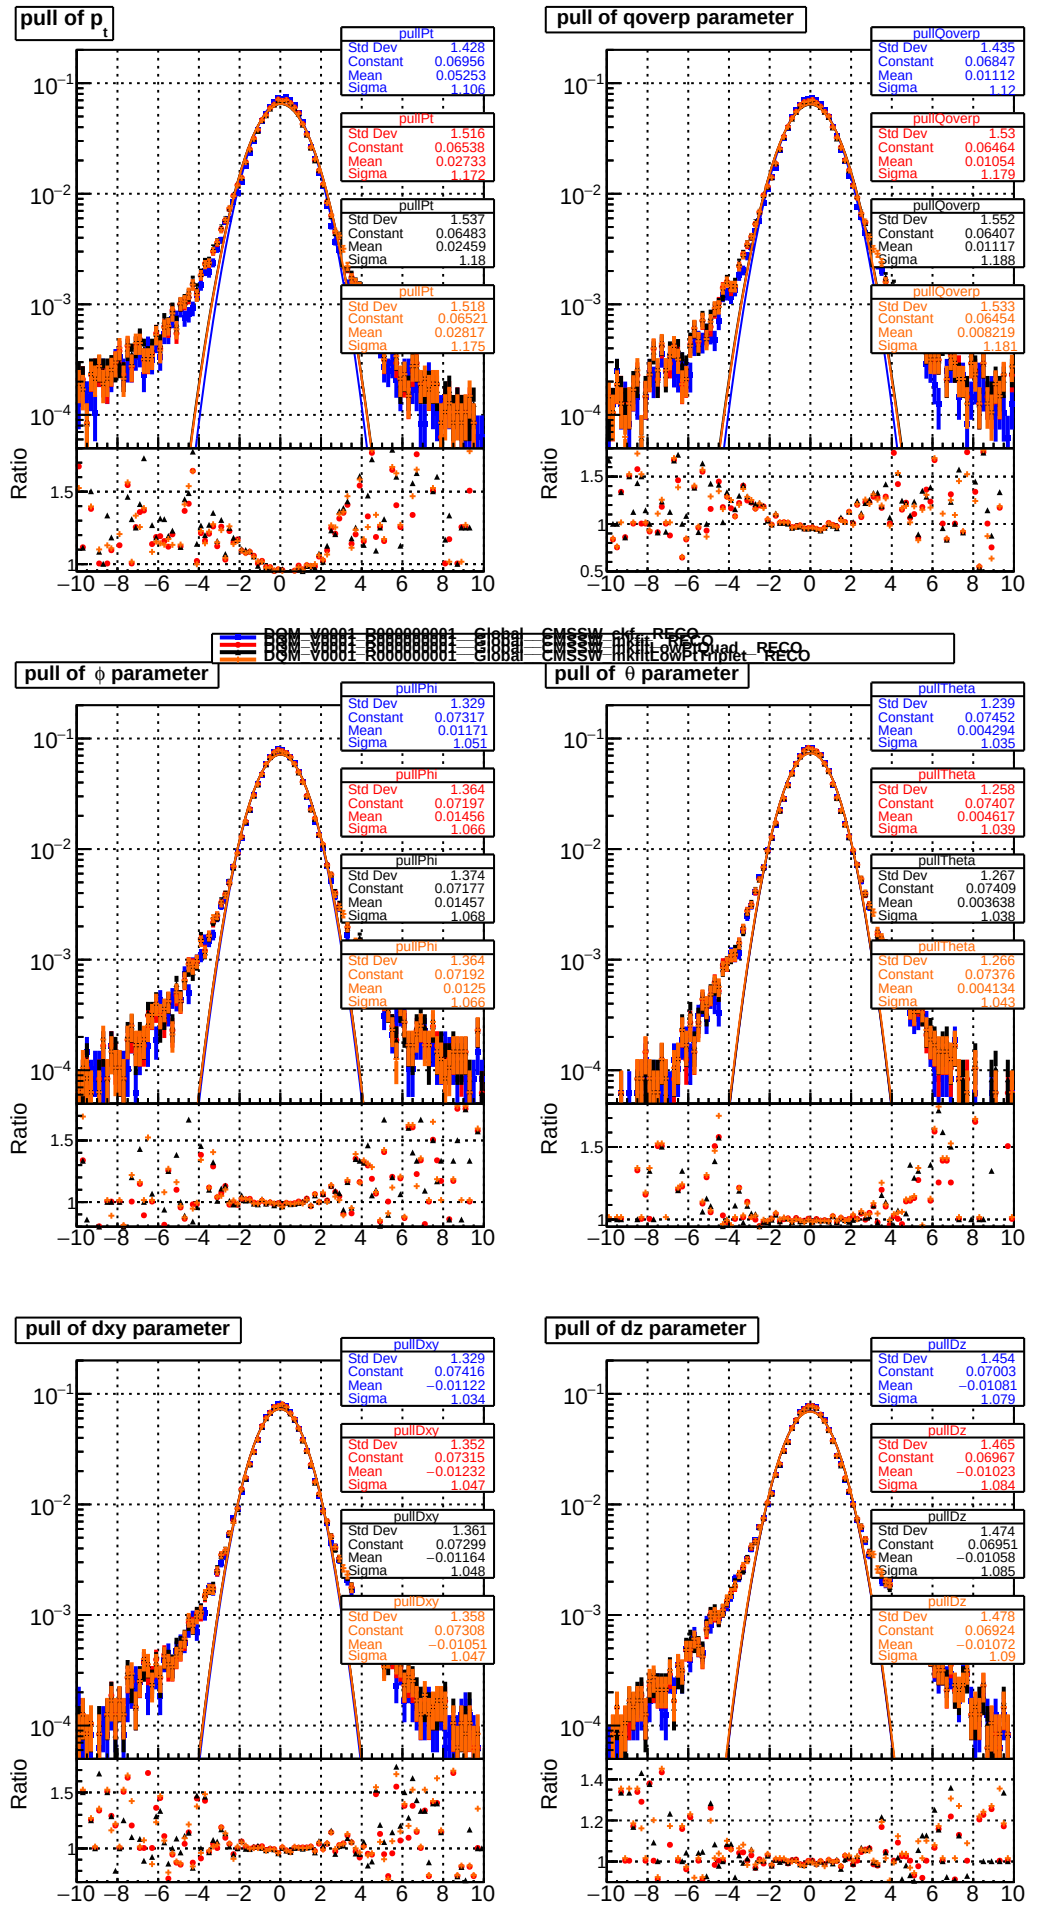
pull of p_t
pullPt
Std Dev 1.428
Constant 0.06956
Mean 0.05253
Sigma 1.106
pullPt
Std Dev 1.516
Constant 0.06538
Mean 0.02733
Sigma 1.172
pullPt
Std Dev 1.537
Constant 0.06483
Mean 0.02459
Sigma 1.18
pullPt
Std Dev 1.518
Constant 0.06521
Mean 0.02817
Sigma 1.175
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.435
Constant 0.06847
Mean 0.01112
Sigma 1.12
pullQoverp
Std Dev 1.53
Constant 0.06464
Mean 0.01054
Sigma 1.179
pullQoverp
Std Dev 1.552
Constant 0.06407
Mean 0.01117
Sigma 1.188
pullQoverp
Std Dev 1.533
Constant 0.06454
Mean 0.008219
Sigma 1.181
Ratio
DQM V0001 R000000001 Global CMSSW clkf RECO
DQM V0001 R000000001 Global CMSSW hlkfit RECO
DQM V0001 R000000001 Global CMSSW hlkfitLowPtQuad RECO
DQM V0001 R000000001 Global CMSSW hlkfitLowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 1.329
Constant 0.07317
Mean 0.01171
Sigma 1.051
pullPhi
Std Dev 1.364
Constant 0.07197
Mean 0.01456
Sigma 1.066
pullPhi
Std Dev 1.374
Constant 0.07177
Mean 0.01457
Sigma 1.068
pullPhi
Std Dev 1.364
Constant 0.07192
Mean 0.0125
Sigma 1.066
Ratio
pull of θ parameter
pullTheta
Std Dev 1.239
Constant 0.07452
Mean 0.004294
Sigma 1.035
pullTheta
Std Dev 1.258
Constant 0.07407
Mean 0.004617
Sigma 1.039
pullTheta
Std Dev 1.267
Constant 0.07409
Mean 0.003638
Sigma 1.038
pullTheta
Std Dev 1.266
Constant 0.07376
Mean 0.004134
Sigma 1.043
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.329
Constant 0.07416
Mean −0.01122
Sigma 1.034
pullDxy
Std Dev 1.352
Constant 0.07315
Mean −0.01232
Sigma 1.047
pullDxy
Std Dev 1.361
Constant 0.07299
Mean −0.01164
Sigma 1.048
pullDxy
Std Dev 1.358
Constant 0.07308
Mean −0.01051
Sigma 1.047
Ratio
pull of dz parameter
pullDz
Std Dev 1.454
Constant 0.07003
Mean −0.01081
Sigma 1.079
pullDz
Std Dev 1.465
Constant 0.06967
Mean −0.01023
Sigma 1.084
pullDz
Std Dev 1.474
Constant 0.06951
Mean −0.01058
Sigma 1.085
pullDz
Std Dev 1.478
Constant 0.06924
Mean −0.01072
Sigma 1.09
Ratio