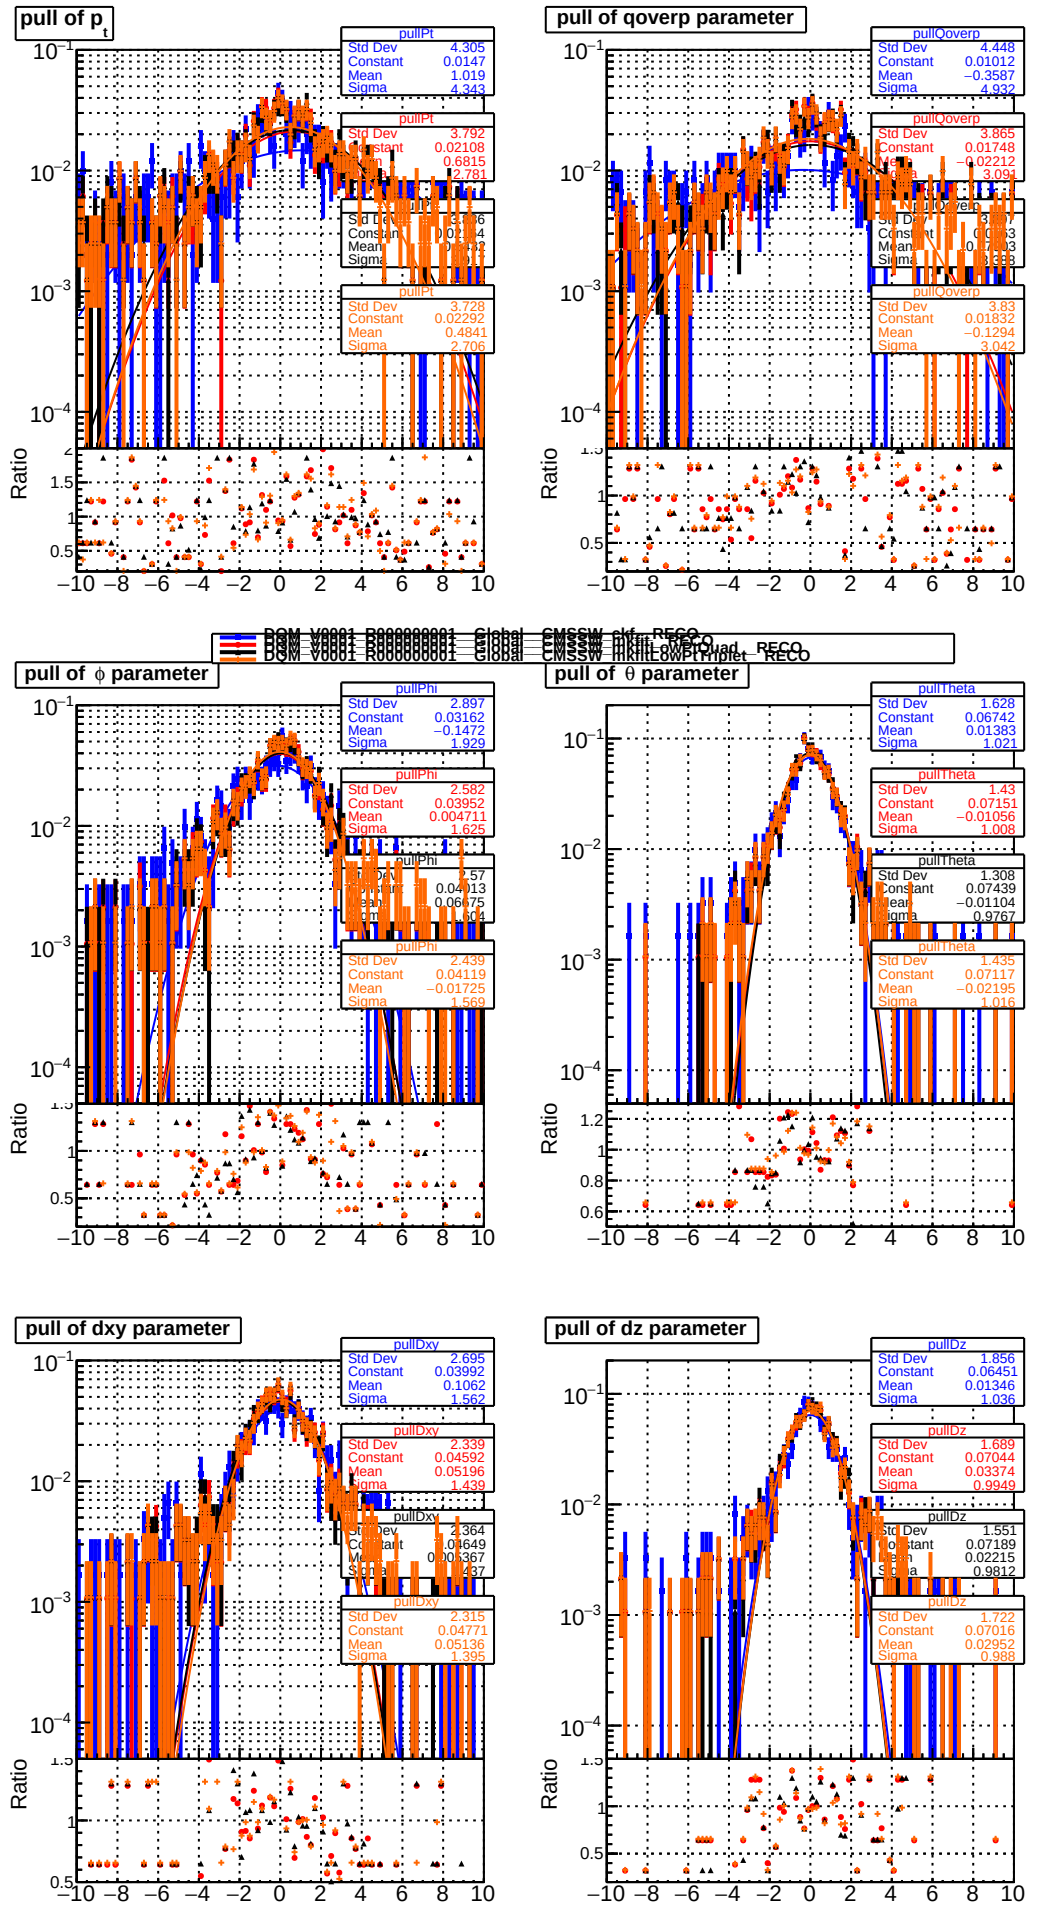
pull of p_t
pullPt
Std Dev 4.305
Constant 0.0147
Mean 1.019
Sigma 4.343
pullPt
Std Dev 3.792
Constant 0.02108
Mean 0.6815
Sigma 2.781
pullPt
Std Dev 3.728
Constant 0.02292
Mean 0.4841
Sigma 2.706
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 4.448
Constant 0.01012
Mean −0.3587
Sigma 4.932
pullQoverp
Std Dev 3.865
Constant 0.01748
Mean −0.02212
Sigma 3.094
pullQoverp
Std Dev 3.83
Constant 0.01832
Mean −0.1294
Sigma 3.042
Ratio
DQM V0001 R000000001 Global CMSSW_ckf_RECO
DQM V0001 R000000001 Global CMSSW_mkFit_RECO
DQM V0001 R000000001 Global CMSSW_mkFitLowPtQuad_RECO
DQM V0001 R000000001 Global CMSSW_mkFitLowPtTriplet_RECO
pull of ϕ parameter
pullPhi
Std Dev 2.897
Constant 0.03162
Mean −0.1472
Sigma 1.929
pullPhi
Std Dev 2.582
Constant 0.03952
Mean 0.004711
Sigma 1.625
pullPhi
Std Dev 2.439
Constant 0.04119
Mean −0.01725
Sigma 1.569
Ratio
pull of θ parameter
pullTheta
Std Dev 1.628
Constant 0.06742
Mean 0.01383
Sigma 1.021
pullTheta
Std Dev 1.43
Constant 0.07151
Mean −0.01056
Sigma 1.008
pullTheta
Std Dev 1.308
Constant 0.07439
Mean −0.01104
Sigma 0.9767
pullTheta
Std Dev 1.435
Constant 0.07117
Mean −0.02195
Sigma 1.016
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.695
Constant 0.03992
Mean 0.1062
Sigma 1.562
pullDxy
Std Dev 2.339
Constant 0.04592
Mean 0.05196
Sigma 1.439
pullDxy
Std Dev 2.364
Constant 0.01649
Mean 0.005367
Sigma 1.437
pullDxy
Std Dev 2.315
Constant 0.04771
Mean 0.05136
Sigma 1.395
Ratio
pull of dz parameter
pullDz
Std Dev 1.856
Constant 0.06451
Mean 0.01346
Sigma 1.036
pullDz
Std Dev 1.689
Constant 0.07044
Mean 0.03374
Sigma 0.9949
pullDz
Std Dev 1.551
Constant 0.07189
Mean 0.02215
Sigma 0.9812
pullDz
Std Dev 1.722
Constant 0.07016
Mean 0.02952
Sigma 0.988
Ratio