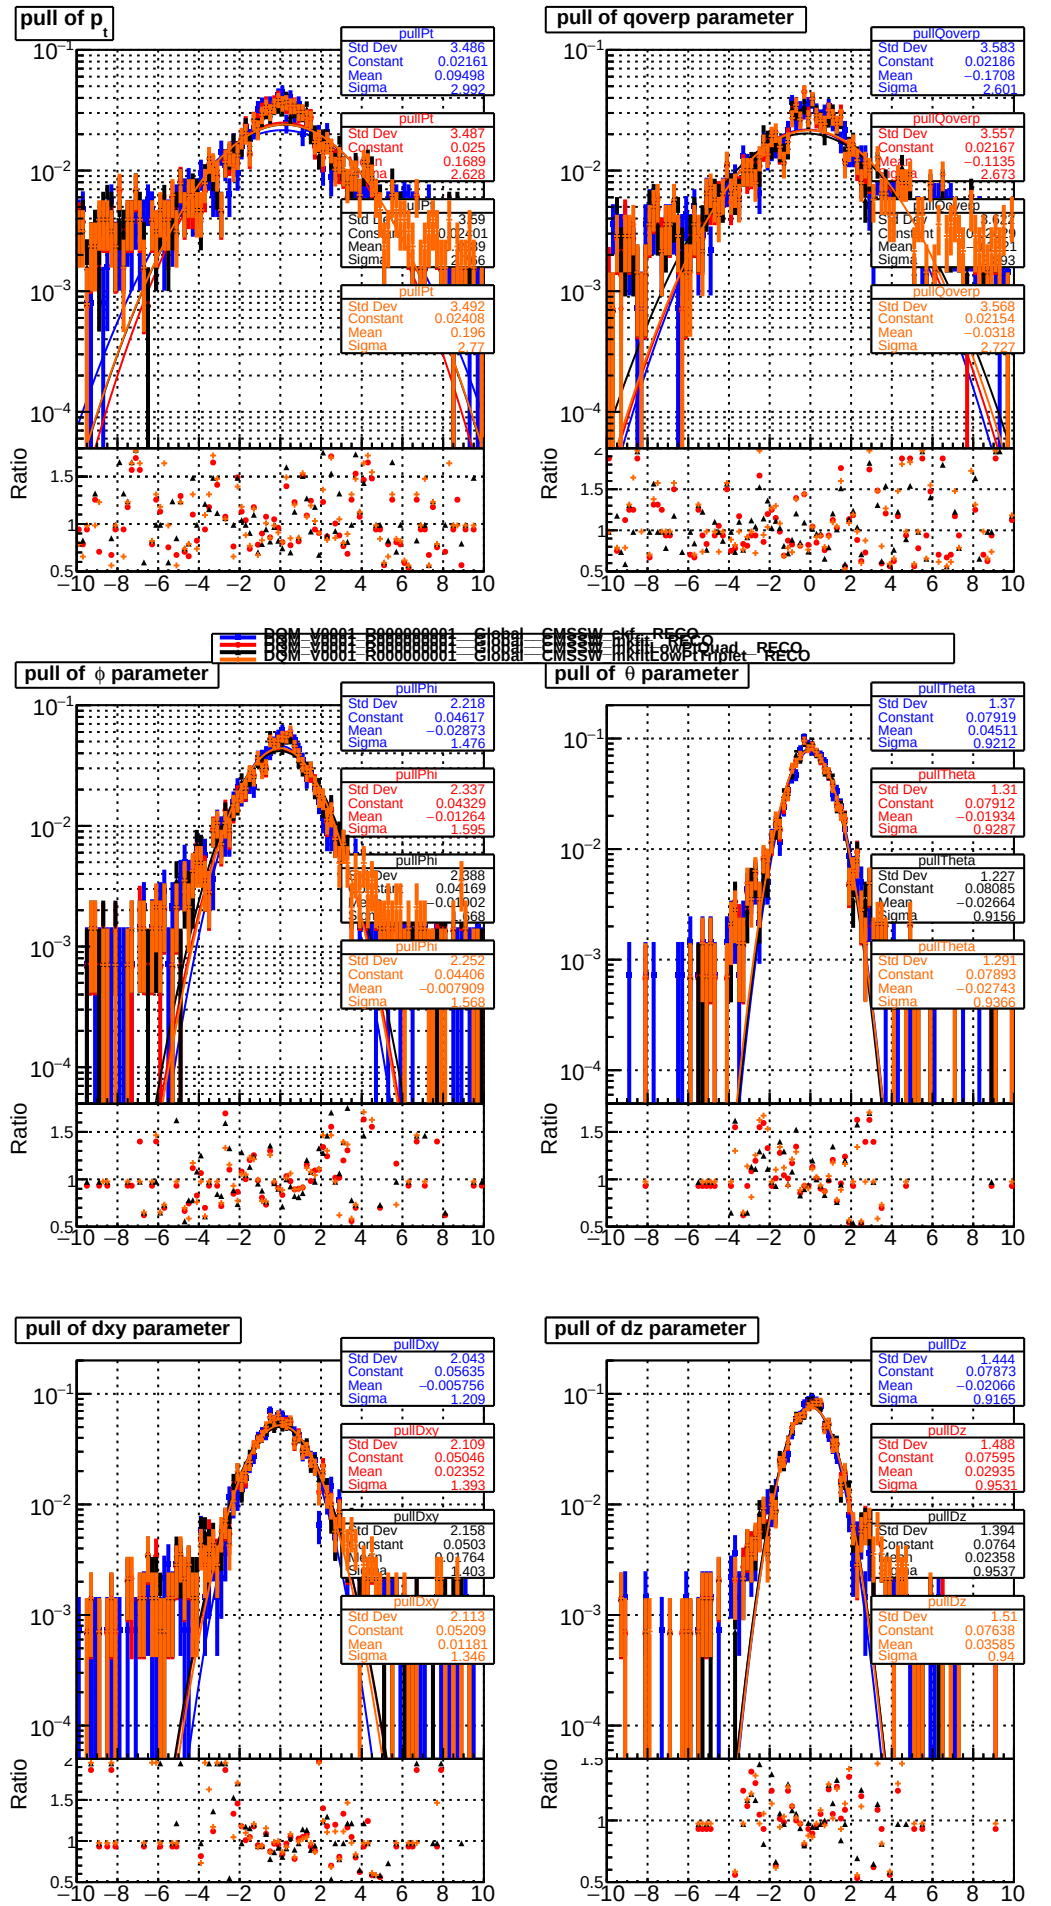
pull of p_t
pullPt
Std Dev 3.486
Constant 0.02161
Mean 0.09498
Sigma 2.992
pullPt
Std Dev 3.487
Constant 0.025
Mean 0.1689
Sigma 2.628
pullPt
Std Dev 3.492
Constant 0.02408
Mean 0.196
Sigma 2.77
pull of qoverp parameter
pullQoverp
Std Dev 3.583
Constant 0.02186
Mean −0.1708
Sigma 2.601
pullQoverp
Std Dev 3.557
Constant 0.02167
Mean −0.1135
Sigma 2.673
pullQoverp
Std Dev 3.568
Constant 0.02154
Mean −0.0318
Sigma 2.727
DQM V0001 R000000001 Global CMSSW clf RECO
DQM V0001 R000000001 Global CMSSW hlkIterLowPtQuad RECO
DQM V0001 R000000001 Global CMSSW hlkIterLowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 2.218
Constant 0.04617
Mean −0.02873
Sigma 1.476
pullPhi
Std Dev 2.337
Constant 0.04329
Mean −0.01264
Sigma 1.595
pullPhi
Std Dev 2.252
Constant 0.04406
Mean −0.007909
Sigma 1.568
pull of θ parameter
pullTheta
Std Dev 1.37
Constant 0.07919
Mean 0.04511
Sigma 0.9212
pullTheta
Std Dev 1.31
Constant 0.07912
Mean −0.01934
Sigma 0.9287
pullTheta
Std Dev 1.227
Constant 0.08085
Mean −0.02664
Sigma 0.9156
pullTheta
Std Dev 1.291
Constant 0.07893
Mean −0.02743
Sigma 0.9366
pull of dxy parameter
pullDxy
Std Dev 2.043
Constant 0.05635
Mean −0.005756
Sigma 1.209
pullDxy
Std Dev 2.109
Constant 0.05046
Mean 0.02352
Sigma 1.393
pullDxy
Std Dev 2.158
Constant 0.0503
Mean 0.01764
Sigma 1.403
pullDxy
Std Dev 2.113
Constant 0.05209
Mean 0.01181
Sigma 1.346
pull of dz parameter
pullDz
Std Dev 1.444
Constant 0.07873
Mean −0.02066
Sigma 0.9165
pullDz
Std Dev 1.488
Constant 0.07595
Mean 0.02935
Sigma 0.9531
pullDz
Std Dev 1.394
Constant 0.0764
Mean 0.02358
Sigma 0.9537
pullDz
Std Dev 1.51
Constant 0.07638
Mean 0.03585
Sigma 0.94
Ratio