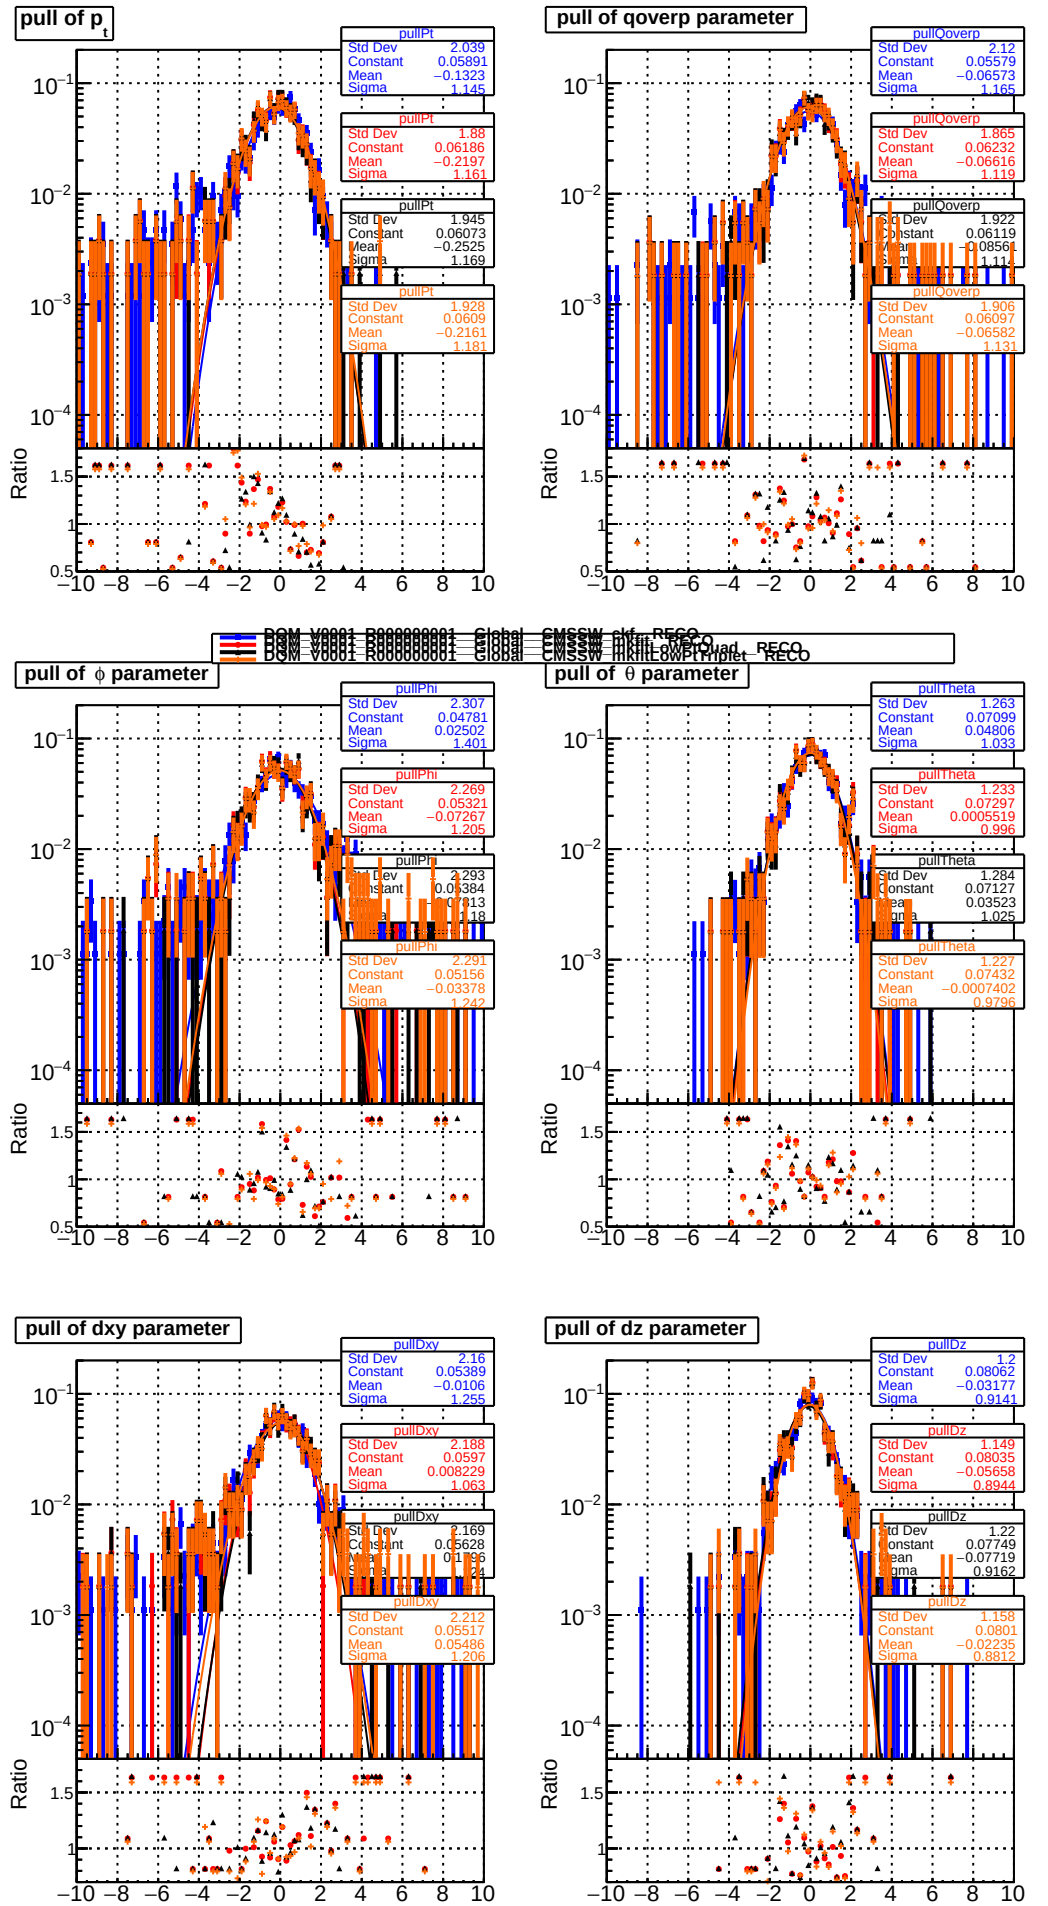
pull of p_t
pullPt
Std Dev 2.039
Constant 0.05891
Mean −0.1323
Sigma 1.145
pullPt
Std Dev 1.88
Constant 0.06186
Mean −0.2197
Sigma 1.161
pullPt
Std Dev 1.945
Constant 0.06073
Mean −0.2525
Sigma 1.169
pullPt
Std Dev 1.928
Constant 0.0609
Mean −0.2161
Sigma 1.181
pull of qoverp parameter
pullQoverp
Std Dev 2.12
Constant 0.05579
Mean −0.06573
Sigma 1.165
pullQoverp
Std Dev 1.865
Constant 0.06232
Mean −0.06616
Sigma 1.119
pullQoverp
Std Dev 1.922
Constant 0.06119
pullQoverp
Std Dev 1.906
Constant 0.06097
Mean −0.06582
Sigma 1.131
Ratio
DQM V0001 R000000001 Global CMSSW clf RECO
DQM V0001 R000000001 Global CMSSW hfilt RECO
DQM V0001 R000000001 Global CMSSW hfilt LowPtQuad RECO
DQM V0001 R000000001 Global CMSSW hfilt LowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 2.307
Constant 0.04781
Mean 0.02502
Sigma 1.401
pullPhi
Std Dev 2.269
Constant 0.05321
Mean −0.07267
Sigma 1.205
pullPhi
Std Dev 2.293
pullPhi
Std Dev 2.291
Constant 0.05156
Mean −0.03378
Sigma 1.242
pull of θ parameter
pullTheta
Std Dev 1.263
Constant 0.07099
Mean 0.04806
Sigma 1.033
pullTheta
Std Dev 1.233
Constant 0.07297
Mean 0.0005519
Sigma 0.996
pullTheta
Std Dev 1.284
Constant 0.07127
Mean 0.03523
pullTheta
Std Dev 1.227
Constant 0.07432
Mean −0.0007402
Sigma 0.9796
pull of dxy parameter
pullDxy
Std Dev 2.16
Constant 0.05389
Mean −0.0106
Sigma 1.255
pullDxy
Std Dev 2.188
Constant 0.0597
Mean 0.008229
Sigma 1.063
pullDxy
Std Dev 2.169
Constant 0.05628
pullDxy
Std Dev 2.212
Constant 0.05517
Mean 0.05486
Sigma 1.206
pull of dz parameter
pullDz
Std Dev 1.2
Constant 0.08062
Mean −0.03177
Sigma 0.9141
pullDz
Std Dev 1.149
Constant 0.08035
Mean −0.05658
Sigma 0.8944
pullDz
Std Dev 1.22
Constant 0.07749
Mean −0.07719
Sigma 0.9162
pullDz
Std Dev 1.158
Constant 0.0801
Mean −0.02235
Sigma 0.8812