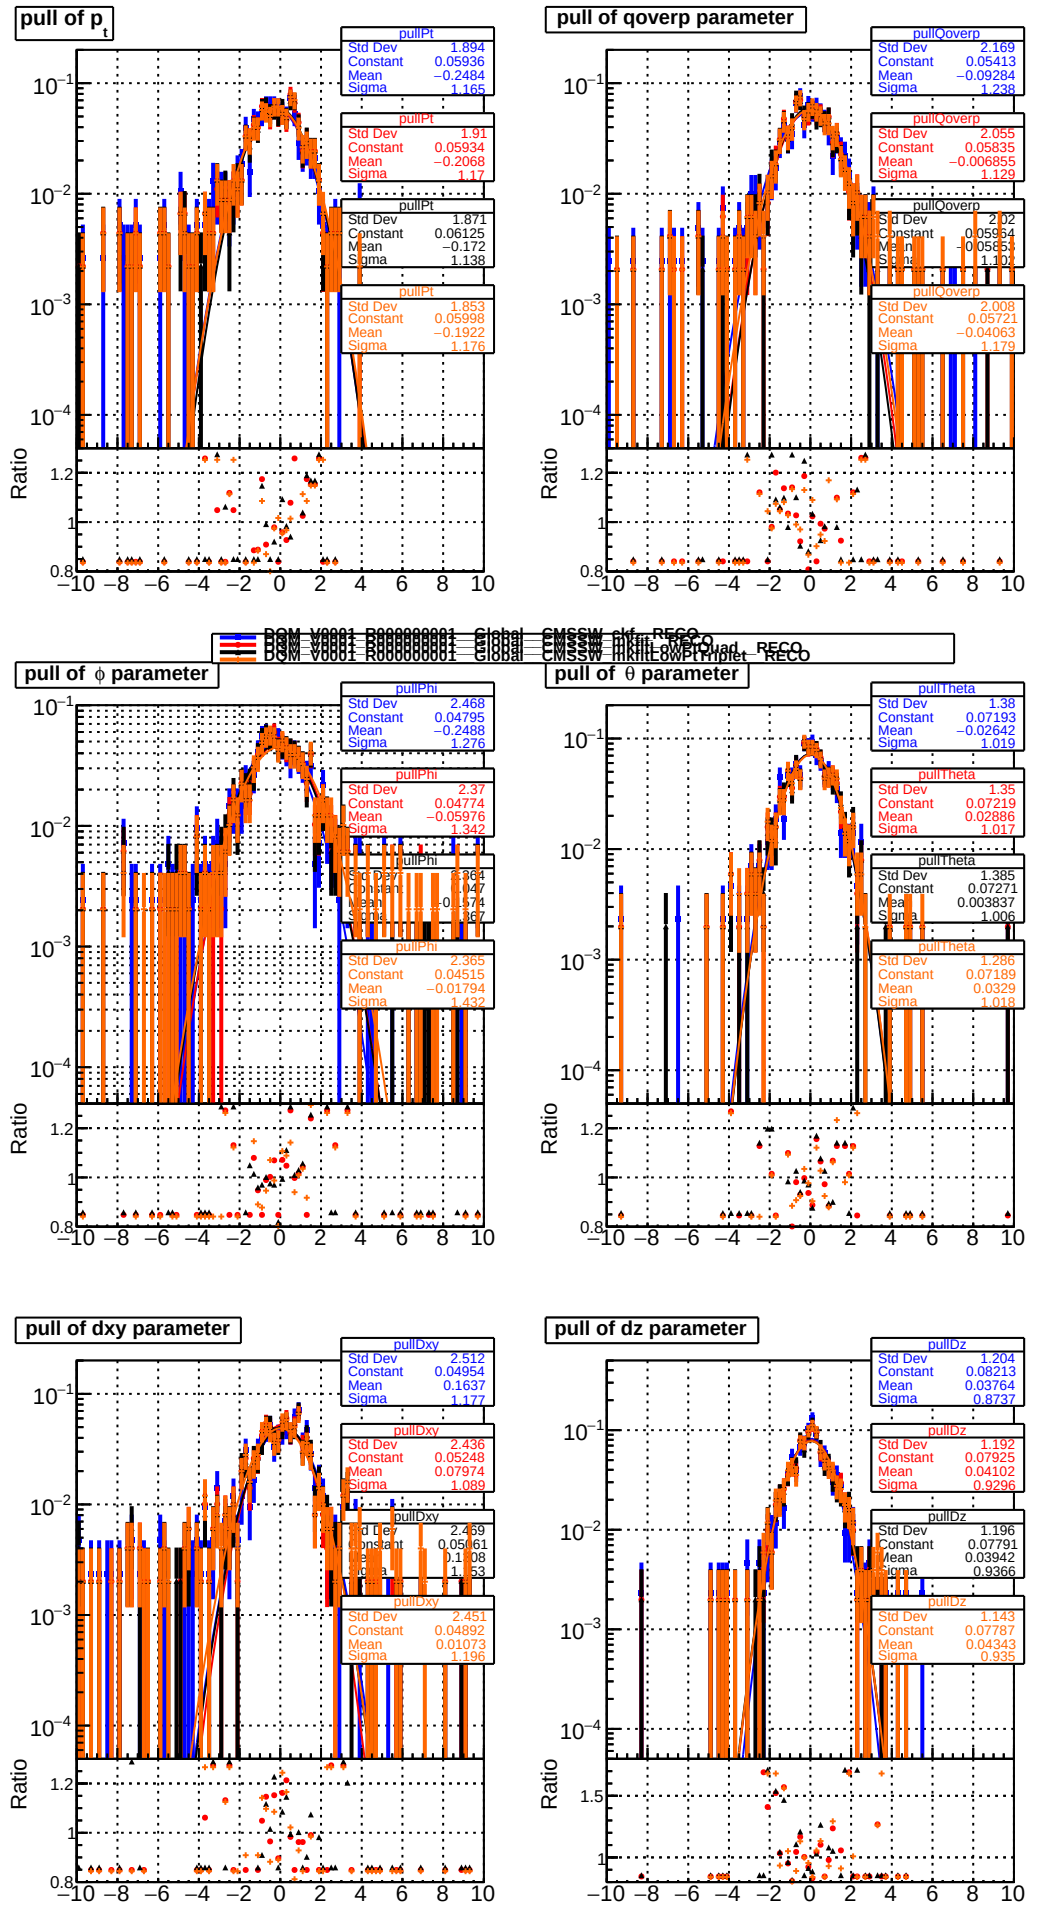
pull of p_t
pullPt
Std Dev 1.894
Constant 0.05936
Mean −0.2484
Sigma 1.165
pullPt
Std Dev 1.91
Constant 0.05934
Mean −0.2068
Sigma 1.17
pullPt
Std Dev 1.871
Constant 0.06125
Mean −0.172
Sigma 1.138
pullPt
Std Dev 1.853
Constant 0.05998
Mean −0.1922
Sigma 1.176
pull of qoverp parameter
pullQoverp
Std Dev 2.169
Constant 0.05413
Mean −0.09284
Sigma 1.238
pullQoverp
Std Dev 2.055
Constant 0.05835
Mean −0.006855
Sigma 1.129
pullQoverp
pullQoverp
Std Dev 2.008
Constant 0.05721
Mean −0.04063
Sigma 1.179
Ratio
DQM V0001 R000000001 Global CMSSW_clf_RECO
DQM V0001 R000000001 Global CMSSW_hiInit_RECO
DQM V0001 R000000001 Global CMSSW_hiInit_LowPtQuad_RECO
DQM V0001 R000000001 Global CMSSW_hiInit_LowPtTriplet_RECO
pull of ϕ parameter
pullPhi
Std Dev 2.468
Constant 0.04795
Mean −0.2488
Sigma 1.276
pullPhi
Std Dev 2.37
Constant 0.04774
Mean −0.05976
Sigma 1.342
pullPhi
pullPhi
Std Dev 2.365
Constant 0.04515
Mean −0.01794
Sigma 1.432
pull of θ parameter
pullTheta
Std Dev 1.38
Constant 0.07193
Mean −0.02642
Sigma 1.019
pullTheta
Std Dev 1.35
Constant 0.07219
Mean 0.02886
Sigma 1.017
pullTheta
Std Dev 1.385
Constant 0.07271
Mean 0.003837
Sigma 1.006
pullTheta
Std Dev 1.286
Constant 0.07189
Mean 0.0329
Sigma 1.018
pull of dxy parameter
pullDxy
Std Dev 2.512
Constant 0.04954
Mean 0.1637
Sigma 1.177
pullDxy
Std Dev 2.436
Constant 0.05248
Mean 0.07974
Sigma 1.089
pullDxy
pullDxy
Std Dev 2.451
Constant 0.04892
Mean 0.01073
Sigma 1.196
pull of dz parameter
pullDz
Std Dev 1.204
Constant 0.08213
Mean 0.03764
Sigma 0.8737
pullDz
Std Dev 1.192
Constant 0.07925
Mean 0.04102
Sigma 0.9296
pullDz
Std Dev 1.196
Constant 0.07791
Mean 0.03942
Sigma 0.9366
pullDz
Std Dev 1.143
Constant 0.07787
Mean 0.04343
Sigma 0.935