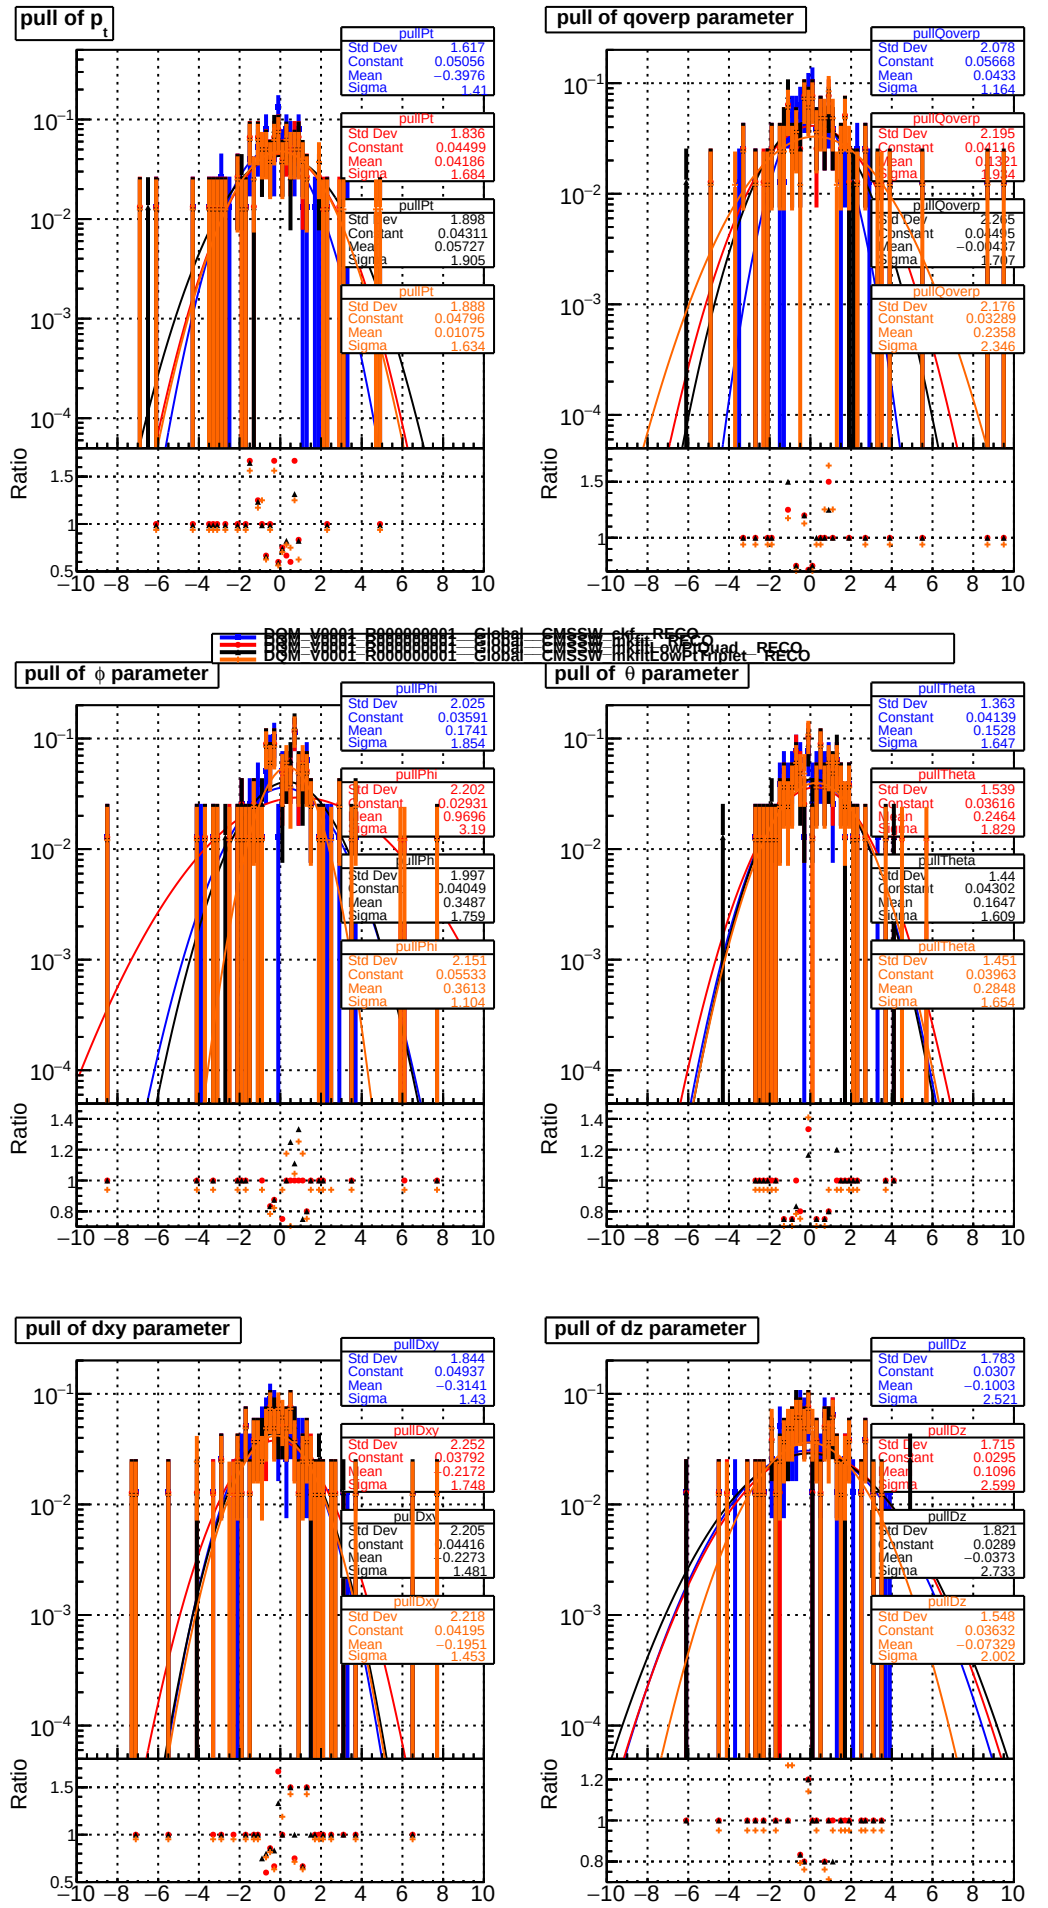
pull of p_t
pullPt
Std Dev 1.617
Constant 0.05056
Mean −0.3976
Sigma 1.41
pullPt
Std Dev 1.836
Constant 0.04499
Mean 0.04186
Sigma 1.684
pullPt
Std Dev 1.898
Constant 0.04311
Mean 0.05727
Sigma 1.905
pullPt
Std Dev 1.888
Constant 0.04796
Mean 0.01075
Sigma 1.634
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.078
Constant 0.05668
Mean 0.0433
Sigma 1.164
pullQoverp
Std Dev 2.195
Constant 0.04116
Mean 0.1321
Sigma 1.934
pullQoverp
Std Dev 2.265
Constant 0.04495
Mean −0.00437
Sigma 1.707
pullQoverp
Std Dev 2.176
Constant 0.03289
Mean 0.2358
Sigma 2.346
Ratio
DQM V0001 R000000001 Global CMSSW clf RECO
DQM V0001 R000000001 Global CMSSW mkfit RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtQuad RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 2.025
Constant 0.03591
Mean 0.1741
Sigma 1.854
pullPhi
Std Dev 2.202
Constant 0.02931
Mean 0.9696
Sigma 3.19
pullPhi
Std Dev 1.997
Constant 0.04049
Mean 0.3487
Sigma 1.759
pullPhi
Std Dev 2.151
Constant 0.05533
Mean 0.3613
Sigma 1.104
Ratio
pull of θ parameter
pullTheta
Std Dev 1.363
Constant 0.04139
Mean 0.1528
Sigma 1.647
pullTheta
Std Dev 1.539
Constant 0.03616
Mean 0.2464
Sigma 1.829
pullTheta
Std Dev 1.44
Constant 0.04302
Mean 0.1647
Sigma 1.609
pullTheta
Std Dev 1.451
Constant 0.03963
Mean 0.2848
Sigma 1.654
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.844
Constant 0.04937
Mean −0.3141
Sigma 1.43
pullDxy
Std Dev 2.252
Constant 0.03792
Mean −0.2172
Sigma 1.748
pullDxy
Std Dev 2.205
Constant 0.04416
Mean −0.2273
Sigma 1.481
pullDxy
Std Dev 2.218
Constant 0.04195
Mean −0.1951
Sigma 1.453
Ratio
pull of dz parameter
pullDz
Std Dev 1.783
Constant 0.0307
Mean −0.1003
Sigma 2.521
pullDz
Std Dev 1.715
Constant 0.0295
Mean 0.1096
Sigma 2.599
pullDz
Std Dev 1.821
Constant 0.0289
Mean −0.0373
Sigma 2.733
pullDz
Std Dev 1.548
Constant 0.03632
Mean −0.07329
Sigma 2.002
Ratio