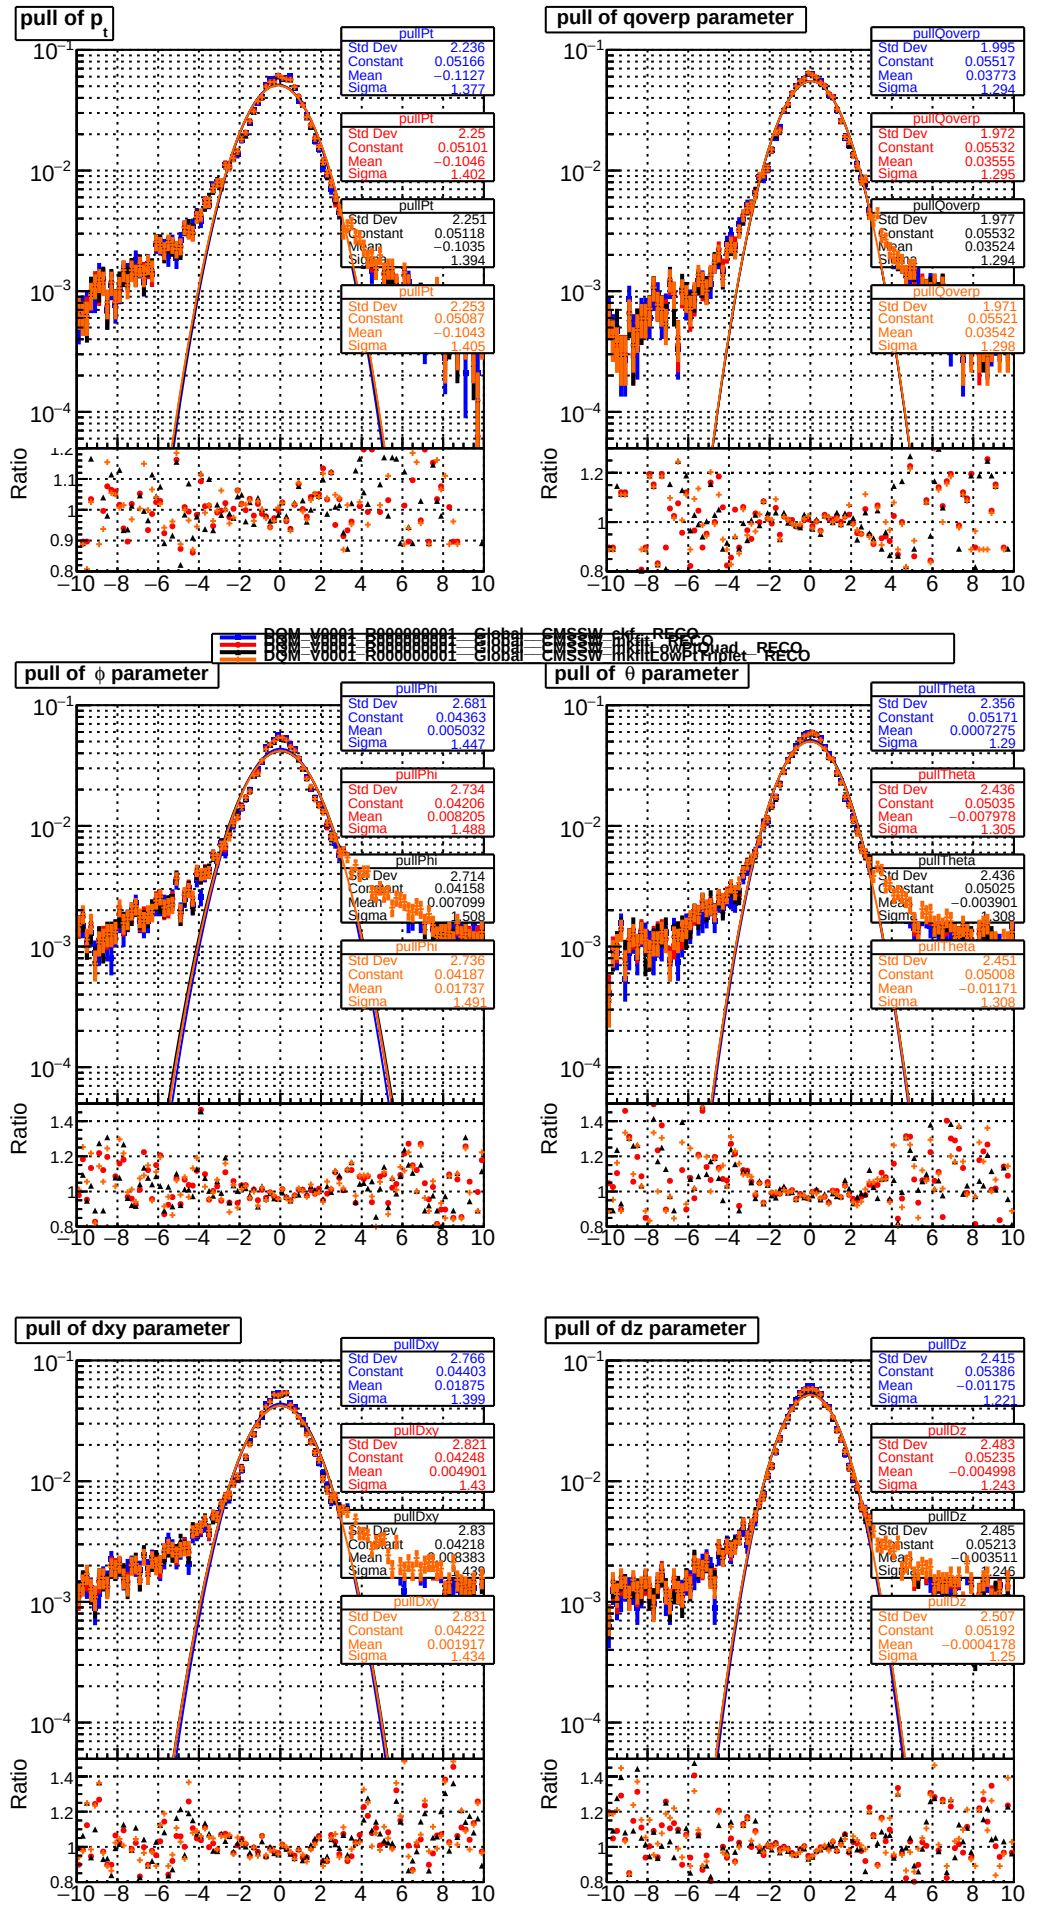
pull of p_t
pullPt
Std Dev 2.236
Constant 0.05166
Mean −0.1127
Sigma 1.377
pullPt
Std Dev 2.25
Constant 0.05101
Mean −0.1046
Sigma 1.402
pullPt
Std Dev 2.251
Constant 0.05118
Mean −0.1035
Sigma 1.394
pullPt
Std Dev 2.253
Constant 0.05087
Mean −0.1043
Sigma 1.405
pull of qoverp parameter
pullQoverp
Std Dev 1.995
Constant 0.05517
Mean 0.03773
Sigma 1.294
pullQoverp
Std Dev 1.972
Constant 0.05532
Mean 0.03555
Sigma 1.295
pullQoverp
Std Dev 1.977
Constant 0.05532
Mean 0.03524
Sigma 1.294
pullQoverp
Std Dev 1.971
Constant 0.05521
Mean 0.03542
Sigma 1.298
DQM V0001 R000000001 Global CMSSW clkf RECO
DQM V0001 R000000001 Global CMSSW mkfit RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtQuad RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 2.681
Constant 0.04363
Mean 0.005032
Sigma 1.447
pullPhi
Std Dev 2.734
Constant 0.04206
Mean 0.008205
Sigma 1.488
pullPhi
Std Dev 2.714
Constant 0.04158
Mean 0.007099
Sigma 1.508
pullPhi
Std Dev 2.736
Constant 0.04187
Mean 0.01737
Sigma 1.491
pull of θ parameter
pullTheta
Std Dev 2.356
Constant 0.05171
Mean 0.0007275
Sigma 1.29
pullTheta
Std Dev 2.436
Constant 0.05035
Mean −0.007978
Sigma 1.305
pullTheta
Std Dev 2.436
Constant 0.05025
Mean −0.003901
Sigma 1.308
pullTheta
Std Dev 2.451
Constant 0.05008
Mean −0.01171
Sigma 1.308
pull of dxy parameter
pullDxy
Std Dev 2.766
Constant 0.04403
Mean 0.01875
Sigma 1.399
pullDxy
Std Dev 2.821
Constant 0.04248
Mean 0.004901
Sigma 1.43
pullDxy
Std Dev 2.83
Constant 0.04218
Mean 0.008383
Sigma 1.439
pullDxy
Std Dev 2.831
Constant 0.04222
Mean 0.001917
Sigma 1.434
pull of dz parameter
pullDz
Std Dev 2.415
Constant 0.05386
Mean −0.01175
Sigma 1.221
pullDz
Std Dev 2.483
Constant 0.05235
Mean −0.004998
Sigma 1.243
pullDz
Std Dev 2.485
Constant 0.05213
Mean −0.003511
Sigma 1.246
pullDz
Std Dev 2.507
Constant 0.05192
Mean −0.0004178
Sigma 1.25
Ratio