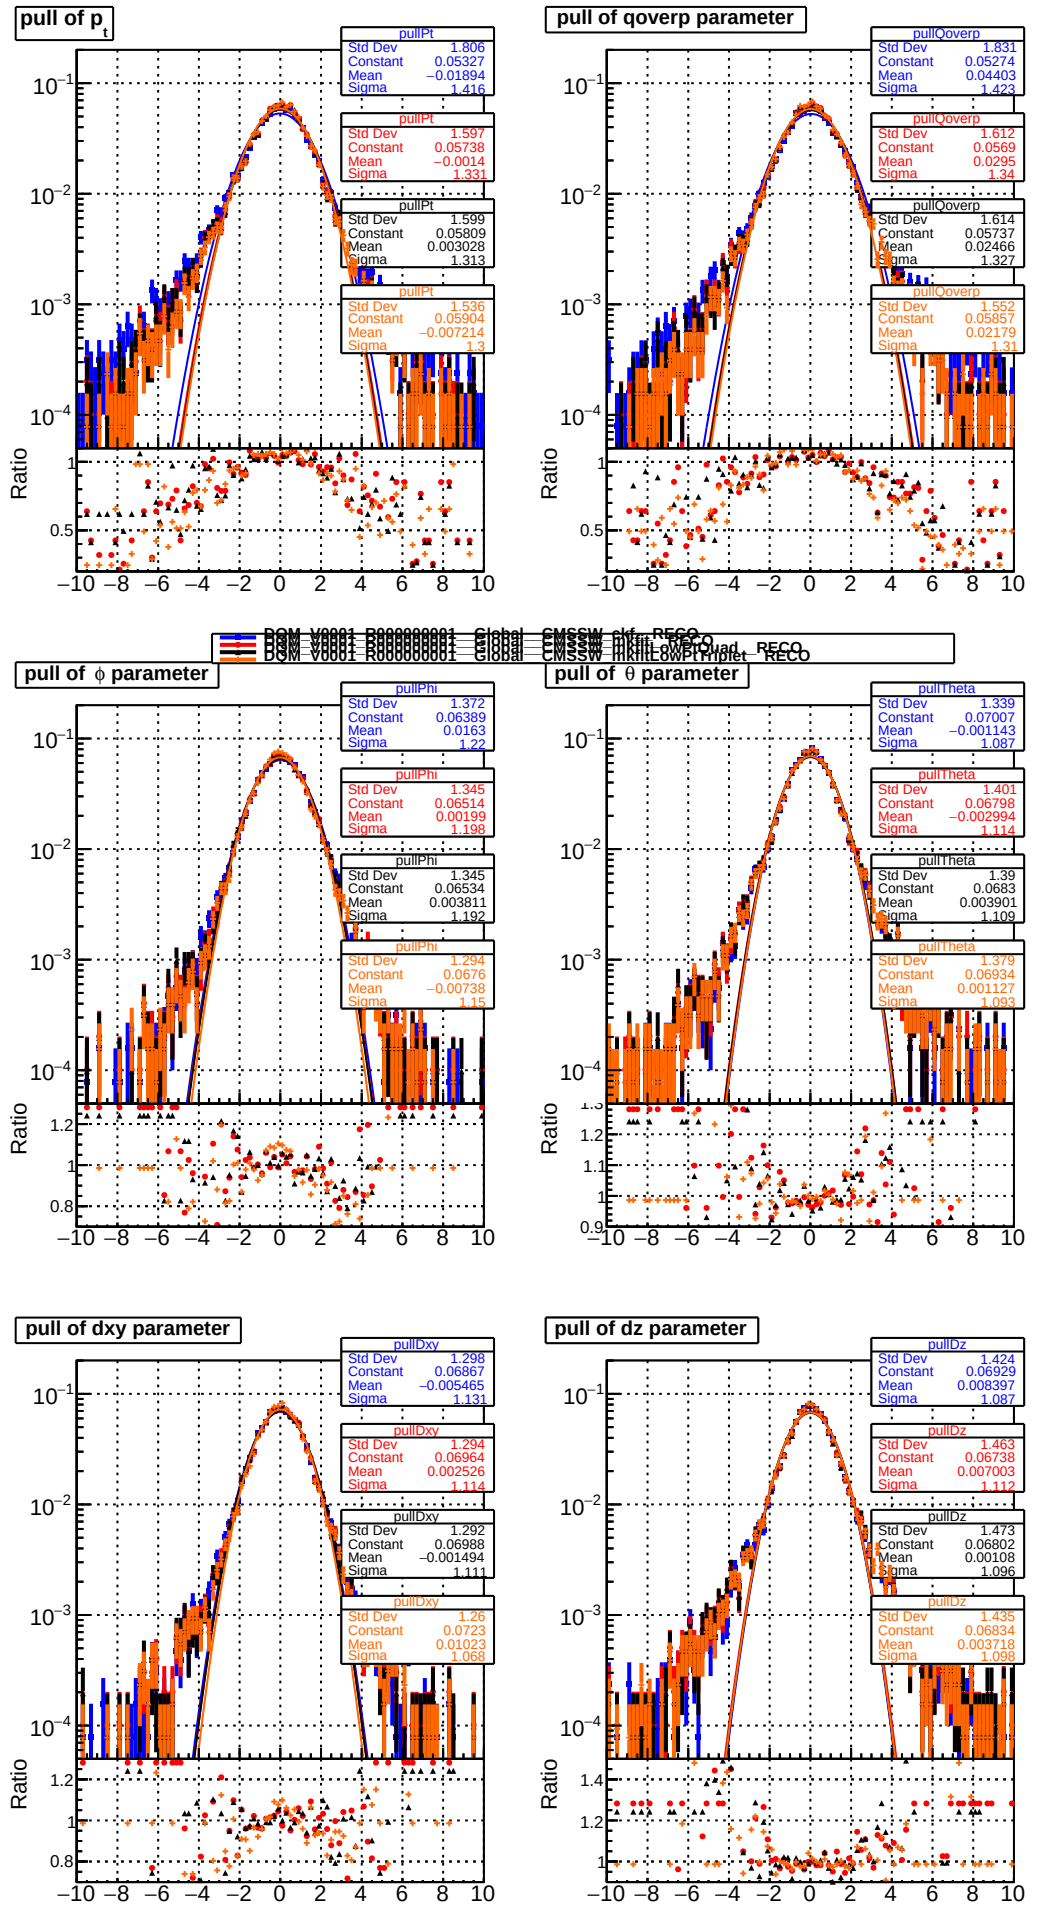
pull of p_t
pullPt
Std Dev 1.806
Constant 0.05327
Mean −0.01894
Sigma 1.416
pullPt
Std Dev 1.597
Constant 0.05738
Mean −0.0014
Sigma 1.331
pullPt
Std Dev 1.599
Constant 0.05809
Mean 0.003028
Sigma 1.313
pullPt
Std Dev 1.536
Constant 0.05904
Mean −0.007214
Sigma 1.3
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.831
Constant 0.05274
Mean 0.04403
Sigma 1.423
pullQoverp
Std Dev 1.612
Constant 0.0569
Mean 0.0295
Sigma 1.34
pullQoverp
Std Dev 1.614
Constant 0.05737
Mean 0.02466
Sigma 1.327
pullQoverp
Std Dev 1.552
Constant 0.05857
Mean 0.02179
Sigma 1.31
Ratio
DQM V0001 R000000001 Global CMSSW clf RECO
DQM V0001 R000000001 Global CMSSW mkfit RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtQuad RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 1.372
Constant 0.06389
Mean 0.0163
Sigma 1.22
pullPhi
Std Dev 1.345
Constant 0.06514
Mean 0.00199
Sigma 1.198
pullPhi
Std Dev 1.345
Constant 0.06534
Mean 0.003811
Sigma 1.192
pullPhi
Std Dev 1.294
Constant 0.0676
Mean −0.00738
Sigma 1.15
Ratio
pull of θ parameter
pullTheta
Std Dev 1.339
Constant 0.07007
Mean −0.001143
Sigma 1.087
pullTheta
Std Dev 1.401
Constant 0.06798
Mean −0.002994
Sigma 1.114
pullTheta
Std Dev 1.39
Constant 0.0683
Mean 0.003901
Sigma 1.109
pullTheta
Std Dev 1.379
Constant 0.06934
Mean 0.001127
Sigma 1.093
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.298
Constant 0.06867
Mean −0.005465
Sigma 1.131
pullDxy
Std Dev 1.294
Constant 0.06964
Mean 0.002526
Sigma 1.114
pullDxy
Std Dev 1.292
Constant 0.06988
Mean −0.001494
Sigma 1.111
pullDxy
Std Dev 1.26
Constant 0.0723
Mean 0.01023
Sigma 1.068
Ratio
pull of dz parameter
pullDz
Std Dev 1.424
Constant 0.06929
Mean 0.008397
Sigma 1.087
pullDz
Std Dev 1.463
Constant 0.06738
Mean 0.007003
Sigma 1.112
pullDz
Std Dev 1.473
Constant 0.06802
Mean 0.00108
Sigma 1.096
pullDz
Std Dev 1.435
Constant 0.06834
Mean 0.003718
Sigma 1.098
Ratio