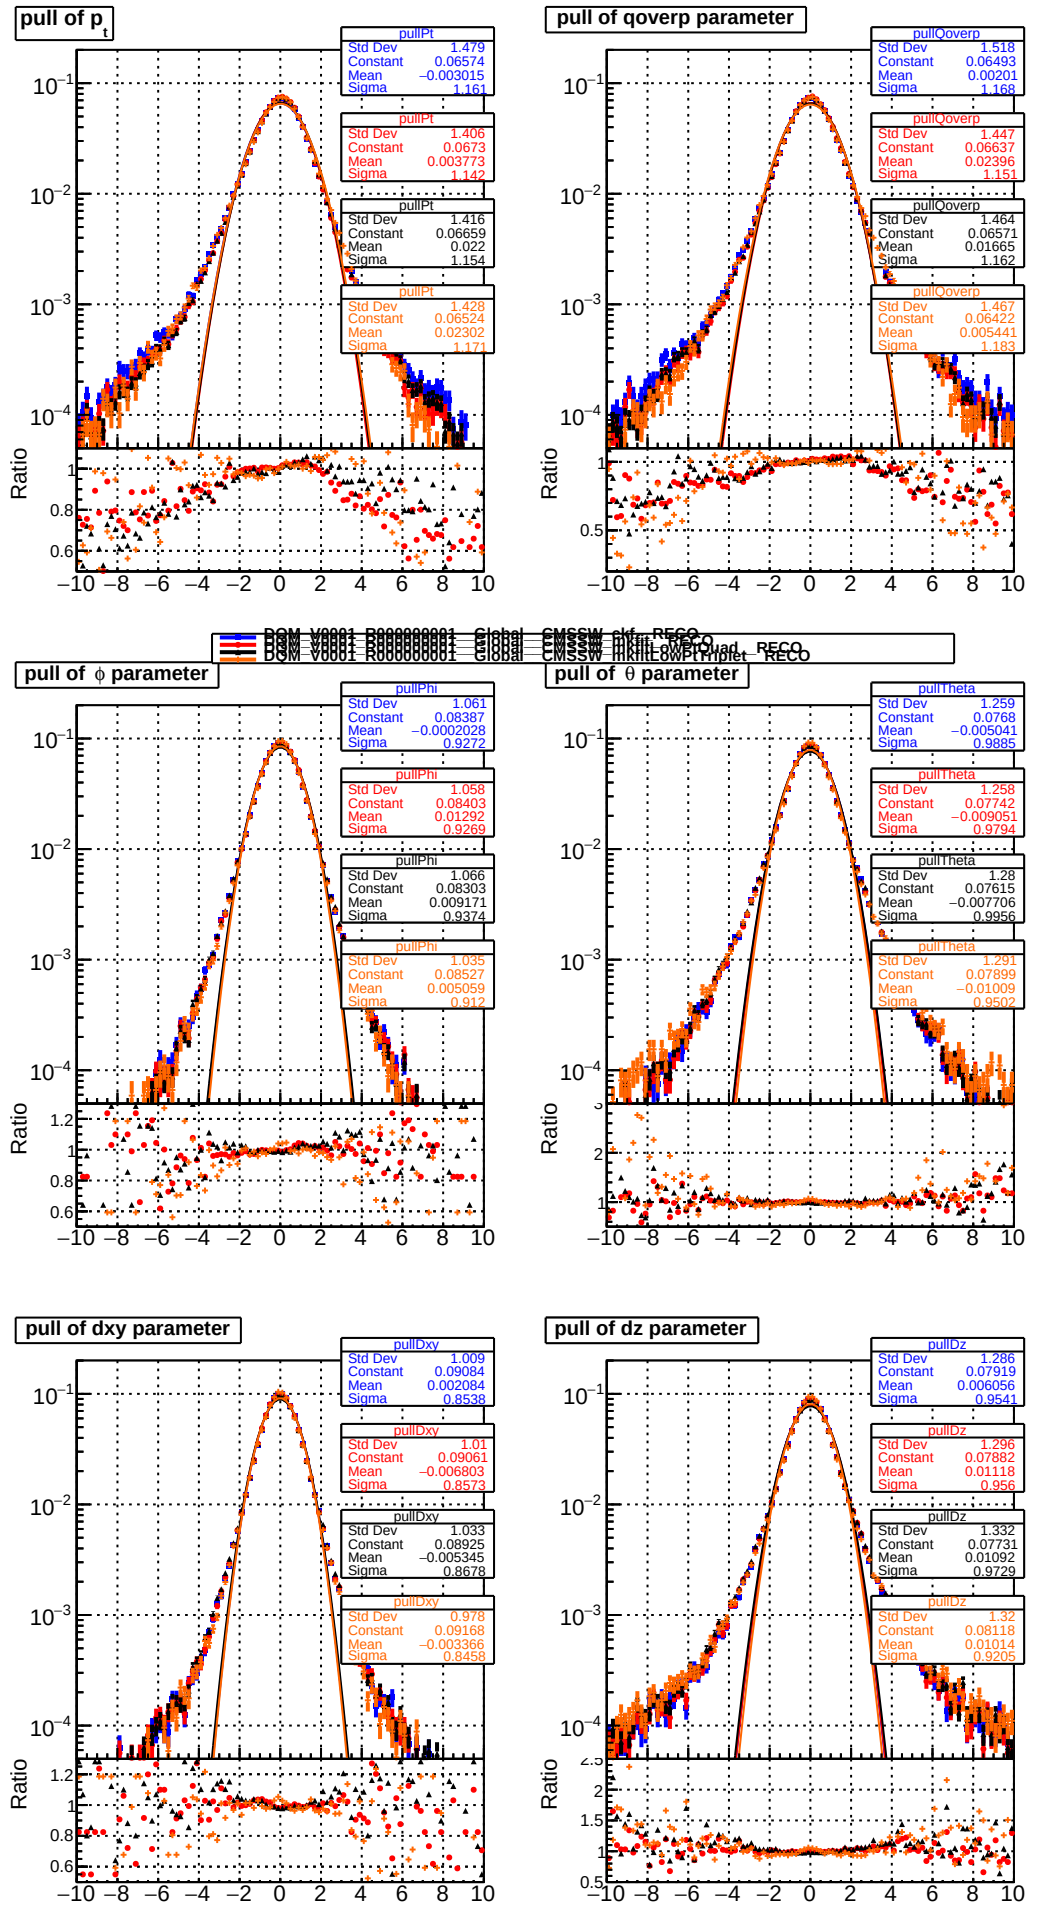
pull of p_t
pullPt
Std Dev 1.479
Constant 0.06574
Mean −0.003015
Sigma 1.161
pullPt
Std Dev 1.406
Constant 0.0673
Mean 0.003773
Sigma 1.142
pullPt
Std Dev 1.416
Constant 0.06659
Mean 0.022
Sigma 1.154
pullPt
Std Dev 1.428
Constant 0.06524
Mean 0.02302
Sigma 1.171
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.518
Constant 0.06493
Mean 0.00201
Sigma 1.168
pullQoverp
Std Dev 1.447
Constant 0.06637
Mean 0.02396
Sigma 1.151
pullQoverp
Std Dev 1.464
Constant 0.06571
Mean 0.01665
Sigma 1.162
pullQoverp
Std Dev 1.467
Constant 0.06422
Mean 0.005441
Sigma 1.183
Ratio
DQM V0001 R000000001 Global CMSSW clf RECO
DQM V0001 R000000001 Global CMSSW mkfit RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtQuad RECO
DQM V0001 R000000001 Global CMSSW mkfitLowPtTriplet RECO
pull of ϕ parameter
pullPhi
Std Dev 1.061
Constant 0.08387
Mean −0.0002028
Sigma 0.9272
pullPhi
Std Dev 1.058
Constant 0.08403
Mean 0.01292
Sigma 0.9269
pullPhi
Std Dev 1.066
Constant 0.08303
Mean 0.009171
Sigma 0.9374
pullPhi
Std Dev 1.035
Constant 0.08527
Mean 0.005059
Sigma 0.912
Ratio
pull of θ parameter
pullTheta
Std Dev 1.259
Constant 0.0768
Mean −0.005041
Sigma 0.9885
pullTheta
Std Dev 1.258
Constant 0.07742
Mean −0.009051
Sigma 0.9794
pullTheta
Std Dev 1.28
Constant 0.07615
Mean −0.007706
Sigma 0.9956
pullTheta
Std Dev 1.291
Constant 0.07899
Mean −0.01009
Sigma 0.9502
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.009
Constant 0.09084
Mean 0.002084
Sigma 0.8538
pullDxy
Std Dev 1.01
Constant 0.09061
Mean −0.006803
Sigma 0.8573
pullDxy
Std Dev 1.033
Constant 0.08925
Mean −0.005345
Sigma 0.8678
pullDxy
Std Dev 0.978
Constant 0.09168
Mean −0.003366
Sigma 0.8458
Ratio
pull of dz parameter
pullDz
Std Dev 1.286
Constant 0.07919
Mean 0.006056
Sigma 0.9541
pullDz
Std Dev 1.296
Constant 0.07882
Mean 0.01118
Sigma 0.956
pullDz
Std Dev 1.332
Constant 0.07731
Mean 0.01092
Sigma 0.9729
pullDz
Std Dev 1.32
Constant 0.08118
Mean 0.01014
Sigma 0.9205
Ratio