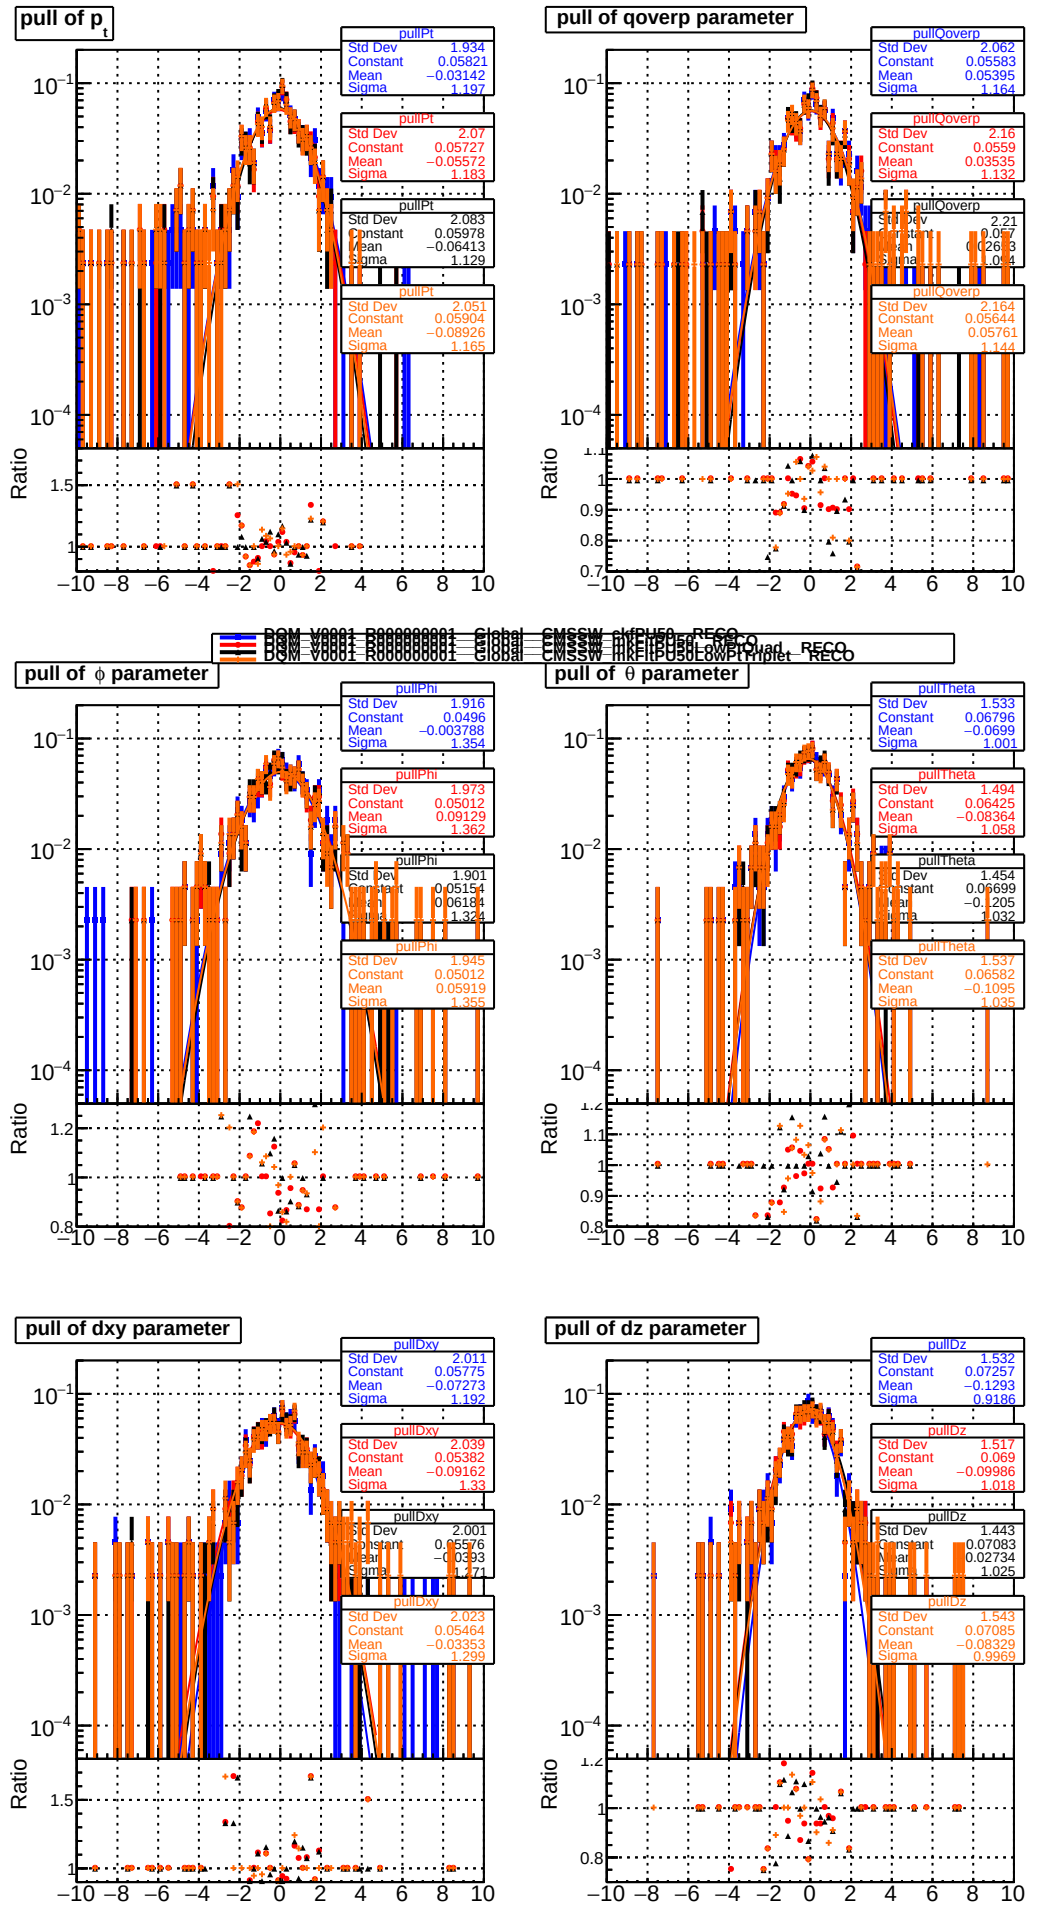
pull of p_t
pullPt
Std Dev 1.934
Constant 0.05821
Mean −0.03142
Sigma 1.197
pullPt
Std Dev 2.07
Constant 0.05727
Mean −0.05572
Sigma 1.183
pullPt
Std Dev 2.083
Constant 0.05978
Mean −0.06413
Sigma 1.129
pullPt
Std Dev 2.051
Constant 0.05904
Mean −0.08926
Sigma 1.165
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.062
Constant 0.05583
Mean 0.05395
Sigma 1.164
pullQoverp
Std Dev 2.16
Constant 0.0559
Mean 0.03535
Sigma 1.132
pullQoverp
Std Dev 2.21
pullQoverp
Std Dev 2.164
Constant 0.05644
Mean 0.05761
Sigma 1.144
Ratio
DQM V0001 R000000001 Global CMSSW_ckfPU50_RECO
DQM V0001 R000000001 Global CMSSW_mkFitPU50_RECO
DQM V0001 R000000001 Global CMSSW_mkFitPU50_lowPtQuad_RECO
DQM V0001 R000000001 Global CMSSW_mkFitPU50_lowPtTriplet_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.916
Constant 0.0496
Mean −0.003788
Sigma 1.354
pullPhi
Std Dev 1.973
Constant 0.05012
Mean 0.09129
Sigma 1.362
pullPhi
Std Dev 1.901
pullPhi
Std Dev 1.945
Constant 0.05012
Mean 0.05919
Sigma 1.355
Ratio
pull of θ parameter
pullTheta
Std Dev 1.533
Constant 0.06796
Mean −0.0699
Sigma 1.001
pullTheta
Std Dev 1.494
Constant 0.06425
Mean −0.08364
Sigma 1.058
pullTheta
Std Dev 1.454
Constant 0.06699
pullTheta
Std Dev 1.537
Constant 0.06582
Mean −0.1095
Sigma 1.035
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.011
Constant 0.05775
Mean −0.07273
Sigma 1.192
pullDxy
Std Dev 2.039
Constant 0.05382
Mean −0.09162
Sigma 1.33
pullDxy
Std Dev 2.001
pullDxy
Std Dev 2.023
Constant 0.05464
Mean −0.03353
Sigma 1.299
Ratio
pull of dz parameter
pullDz
Std Dev 1.532
Constant 0.07257
Mean −0.1293
Sigma 0.9186
pullDz
Std Dev 1.517
Constant 0.069
Mean −0.09986
Sigma 1.018
pullDz
Std Dev 1.443
Constant 0.07083
Mean 0.02734
Sigma 1.025
pullDz
Std Dev 1.543
Constant 0.07085
Mean −0.08329
Sigma 0.9969
Ratio