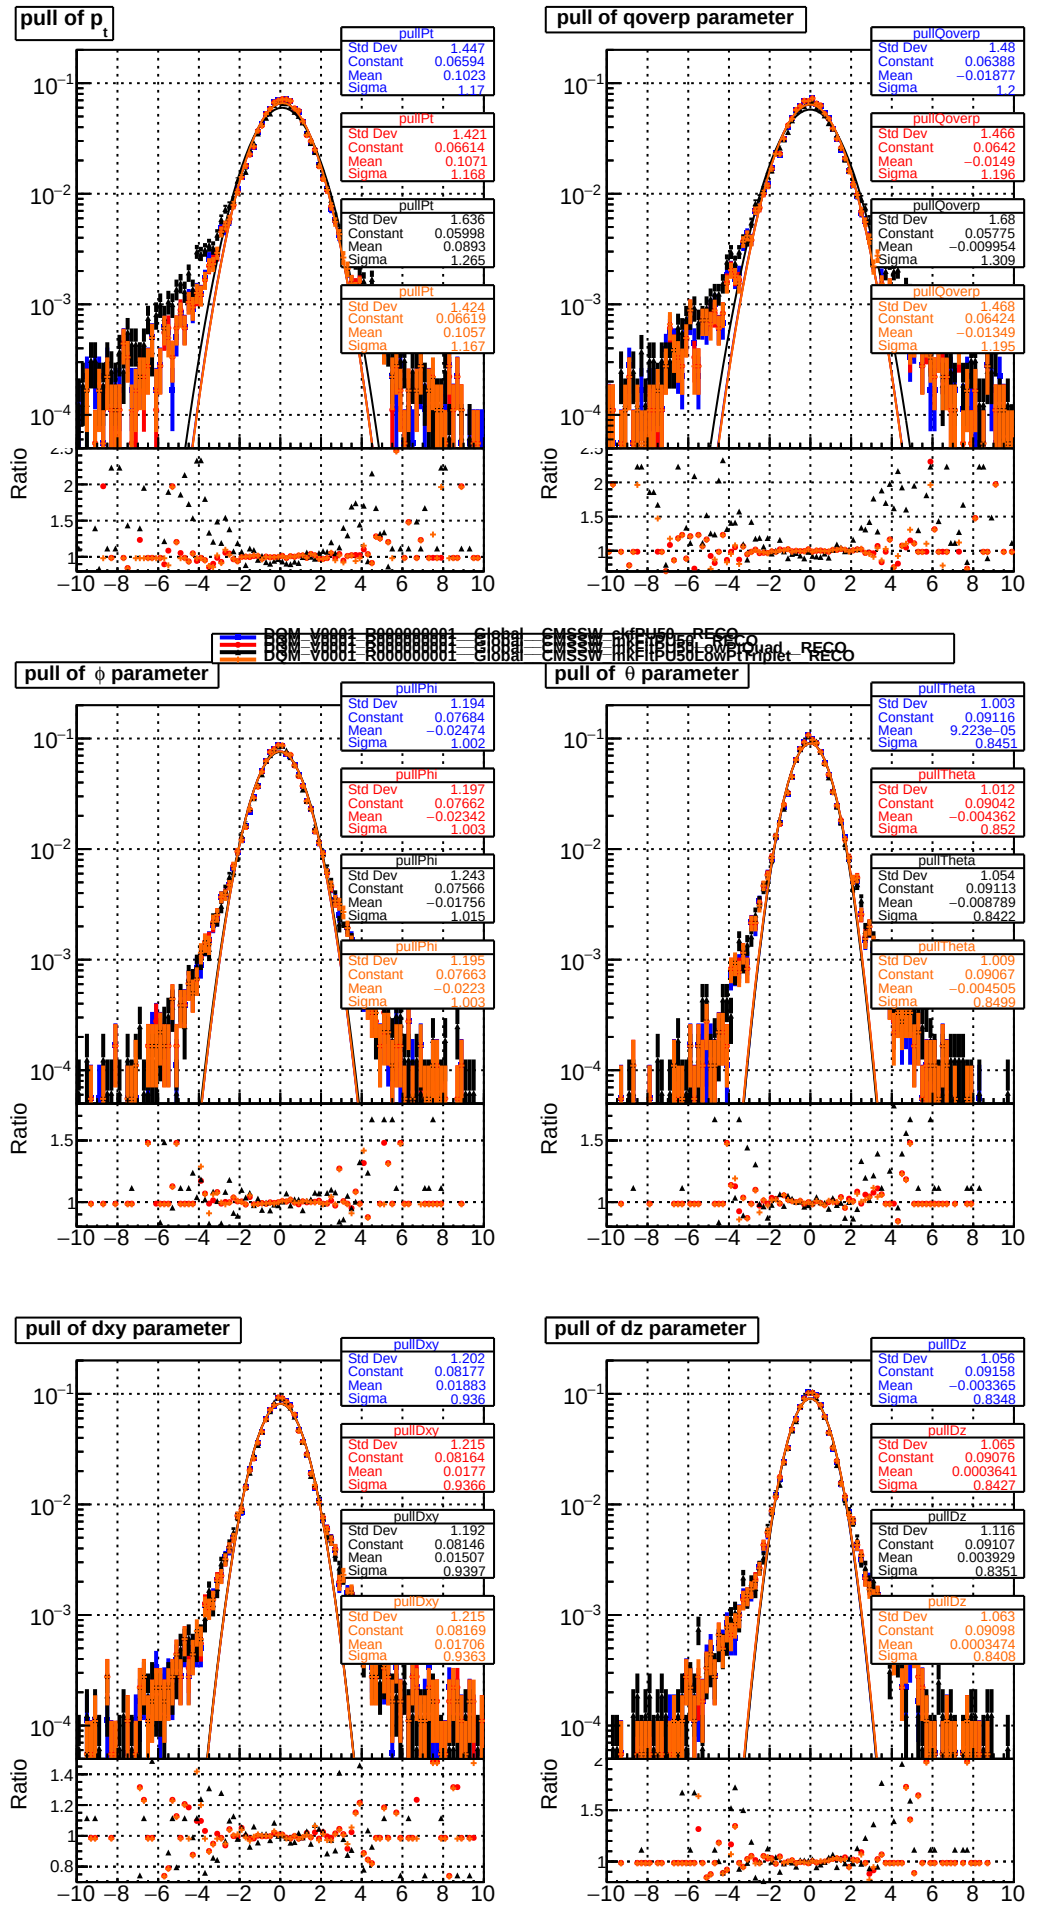
pull of p_t
pullPt
Std Dev 1.447
Constant 0.06594
Mean 0.1023
Sigma 1.17
pullPt
Std Dev 1.421
Constant 0.06614
Mean 0.1071
Sigma 1.168
pullPt
Std Dev 1.636
Constant 0.05998
Mean 0.0893
Sigma 1.265
pullPt
Std Dev 1.424
Constant 0.06619
Mean 0.1057
Sigma 1.167
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.48
Constant 0.06388
Mean −0.01877
Sigma 1.2
pullQoverp
Std Dev 1.466
Constant 0.0642
Mean −0.0149
Sigma 1.196
pullQoverp
Std Dev 1.68
Constant 0.05775
Mean −0.009954
Sigma 1.309
pullQoverp
Std Dev 1.468
Constant 0.06424
Mean −0.01349
Sigma 1.195
Ratio
DQM V0001 R000000001 Global CMSSW_ckfPU50_RECO
DQM V0001 R000000001 Global CMSSW_mkFitPU50_RECO
DQM V0001 R000000001 Global CMSSW_mkFitPU50LowPtQuad_RECO
DQM V0001 R000000001 Global CMSSW_mkFitPU50LowPtTriplet_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.194
Constant 0.07684
Mean −0.02474
Sigma 1.002
pullPhi
Std Dev 1.197
Constant 0.07662
Mean −0.02342
Sigma 1.003
pullPhi
Std Dev 1.243
Constant 0.07566
Mean −0.01756
Sigma 1.015
pullPhi
Std Dev 1.195
Constant 0.07663
Mean −0.0223
Sigma 1.003
Ratio
pull of θ parameter
pullTheta
Std Dev 1.003
Constant 0.09116
Mean 9.223e−05
Sigma 0.8451
pullTheta
Std Dev 1.012
Constant 0.09042
Mean −0.004362
Sigma 0.852
pullTheta
Std Dev 1.054
Constant 0.09113
Mean −0.008789
Sigma 0.8422
pullTheta
Std Dev 1.009
Constant 0.09067
Mean −0.004505
Sigma 0.8499
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.202
Constant 0.08177
Mean 0.01883
Sigma 0.936
pullDxy
Std Dev 1.215
Constant 0.08164
Mean 0.0177
Sigma 0.9366
pullDxy
Std Dev 1.192
Constant 0.08146
Mean 0.01507
Sigma 0.9397
pullDxy
Std Dev 1.215
Constant 0.08169
Mean 0.01706
Sigma 0.9363
Ratio
pull of dz parameter
pullDz
Std Dev 1.056
Constant 0.09158
Mean −0.003365
Sigma 0.8348
pullDz
Std Dev 1.065
Constant 0.09076
Mean 0.0003641
Sigma 0.8427
pullDz
Std Dev 1.116
Constant 0.09107
Mean 0.003929
Sigma 0.8351
pullDz
Std Dev 1.063
Constant 0.09098
Mean 0.0003474
Sigma 0.8408
Ratio