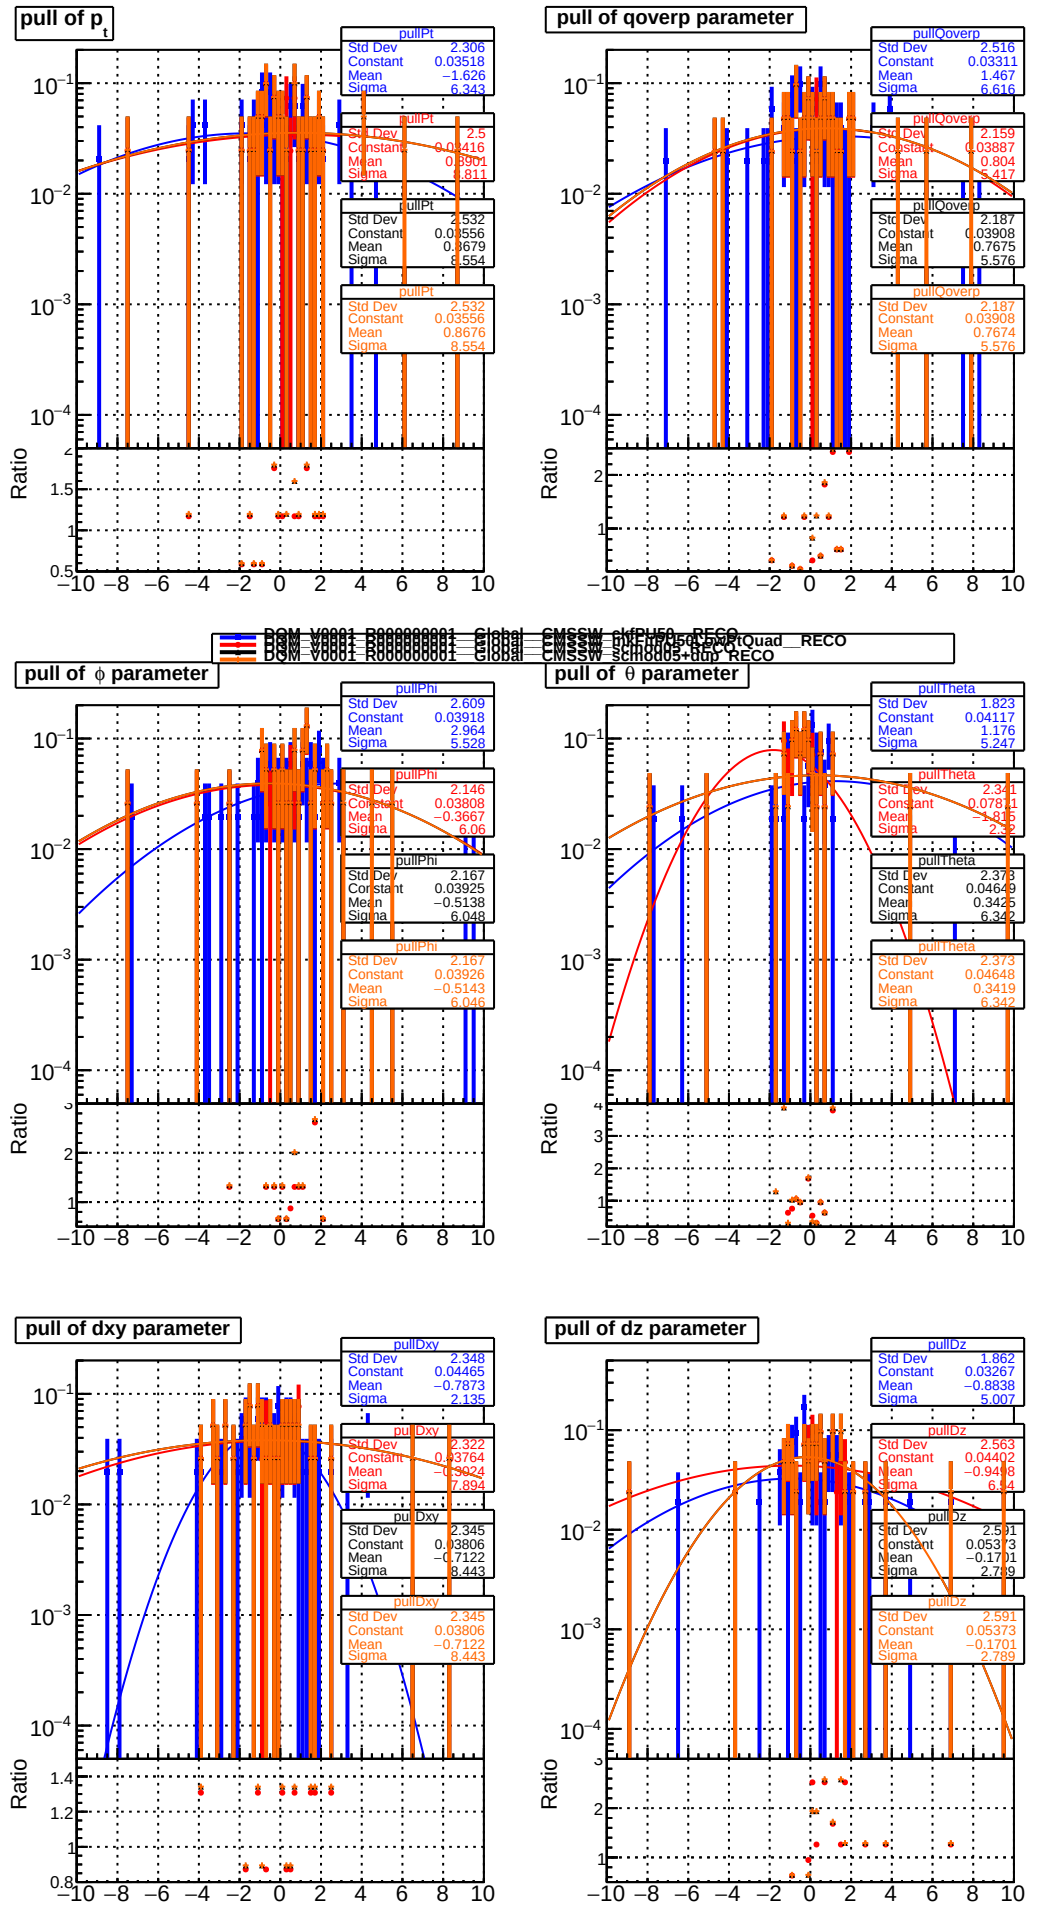
pull of p_t
pullPt
Std Dev 2.306
Constant 0.03518
Mean −1.626
Sigma 6.343
pullPt
Std Dev 2.5
Constant 0.03416
Mean 0.8901
Sigma 6.811
pullPt
Std Dev 2.532
Constant 0.03556
Mean 0.8679
Sigma 8.554
pullPt
Std Dev 2.532
Constant 0.03556
Mean 0.8676
Sigma 8.554
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.516
Constant 0.03311
Mean 1.467
Sigma 6.616
pullQoverp
Std Dev 2.159
Constant 0.03887
Mean 0.804
Sigma 5.417
pullQoverp
Std Dev 2.187
Constant 0.03908
Mean 0.7675
Sigma 5.576
pullQoverp
Std Dev 2.187
Constant 0.03908
Mean 0.7674
Sigma 5.576
Ratio
DQM V0001 R000000001 Global CMSSW_ckfPU50_RECO
DQM V0001 R000000001 Global CMSSW_pixelPU50_RECOQuad__RECO
DQM V0001 R000000001 Global CMSSW_scimod05+RECO
DQM V0001 R000000001 Global CMSSW_scimod05+dup_RECO
pull of ϕ parameter
pullPhi
Std Dev 2.609
Constant 0.03918
Mean 2.964
Sigma 5.528
pullPhi
Std Dev 2.146
Constant 0.03808
Mean −0.3667
Sigma 6.06
pullPhi
Std Dev 2.167
Constant 0.03925
Mean −0.5138
Sigma 6.048
pullPhi
Std Dev 2.167
Constant 0.03926
Mean −0.5143
Sigma 6.046
Ratio
pull of θ parameter
pullTheta
Std Dev 1.823
Constant 0.04117
Mean 1.176
Sigma 5.247
pullTheta
Std Dev 2.341
Constant 0.07811
Mean −1.815
Sigma 2.32
pullTheta
Std Dev 2.373
Constant 0.04649
Mean 0.3425
Sigma 6.342
pullTheta
Std Dev 2.373
Constant 0.04648
Mean 0.3419
Sigma 6.342
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.348
Constant 0.04465
Mean −0.7873
Sigma 2.135
pullDxy
Std Dev 2.322
Constant 0.03764
Mean −0.3024
Sigma 7.894
pullDxy
Std Dev 2.345
Constant 0.03806
Mean −0.7122
Sigma 8.443
pullDxy
Std Dev 2.345
Constant 0.03806
Mean −0.7122
Sigma 8.443
Ratio
pull of dz parameter
pullDz
Std Dev 1.862
Constant 0.03267
Mean −0.8838
Sigma 5.007
pullDz
Std Dev 2.563
Constant 0.04402
Mean −0.9498
Sigma 6.54
pullDz
Std Dev 2.591
Constant 0.05373
Mean −0.1701
Sigma 2.789
pullDz
Std Dev 2.591
Constant 0.05373
Mean −0.1701
Sigma 2.789
Ratio