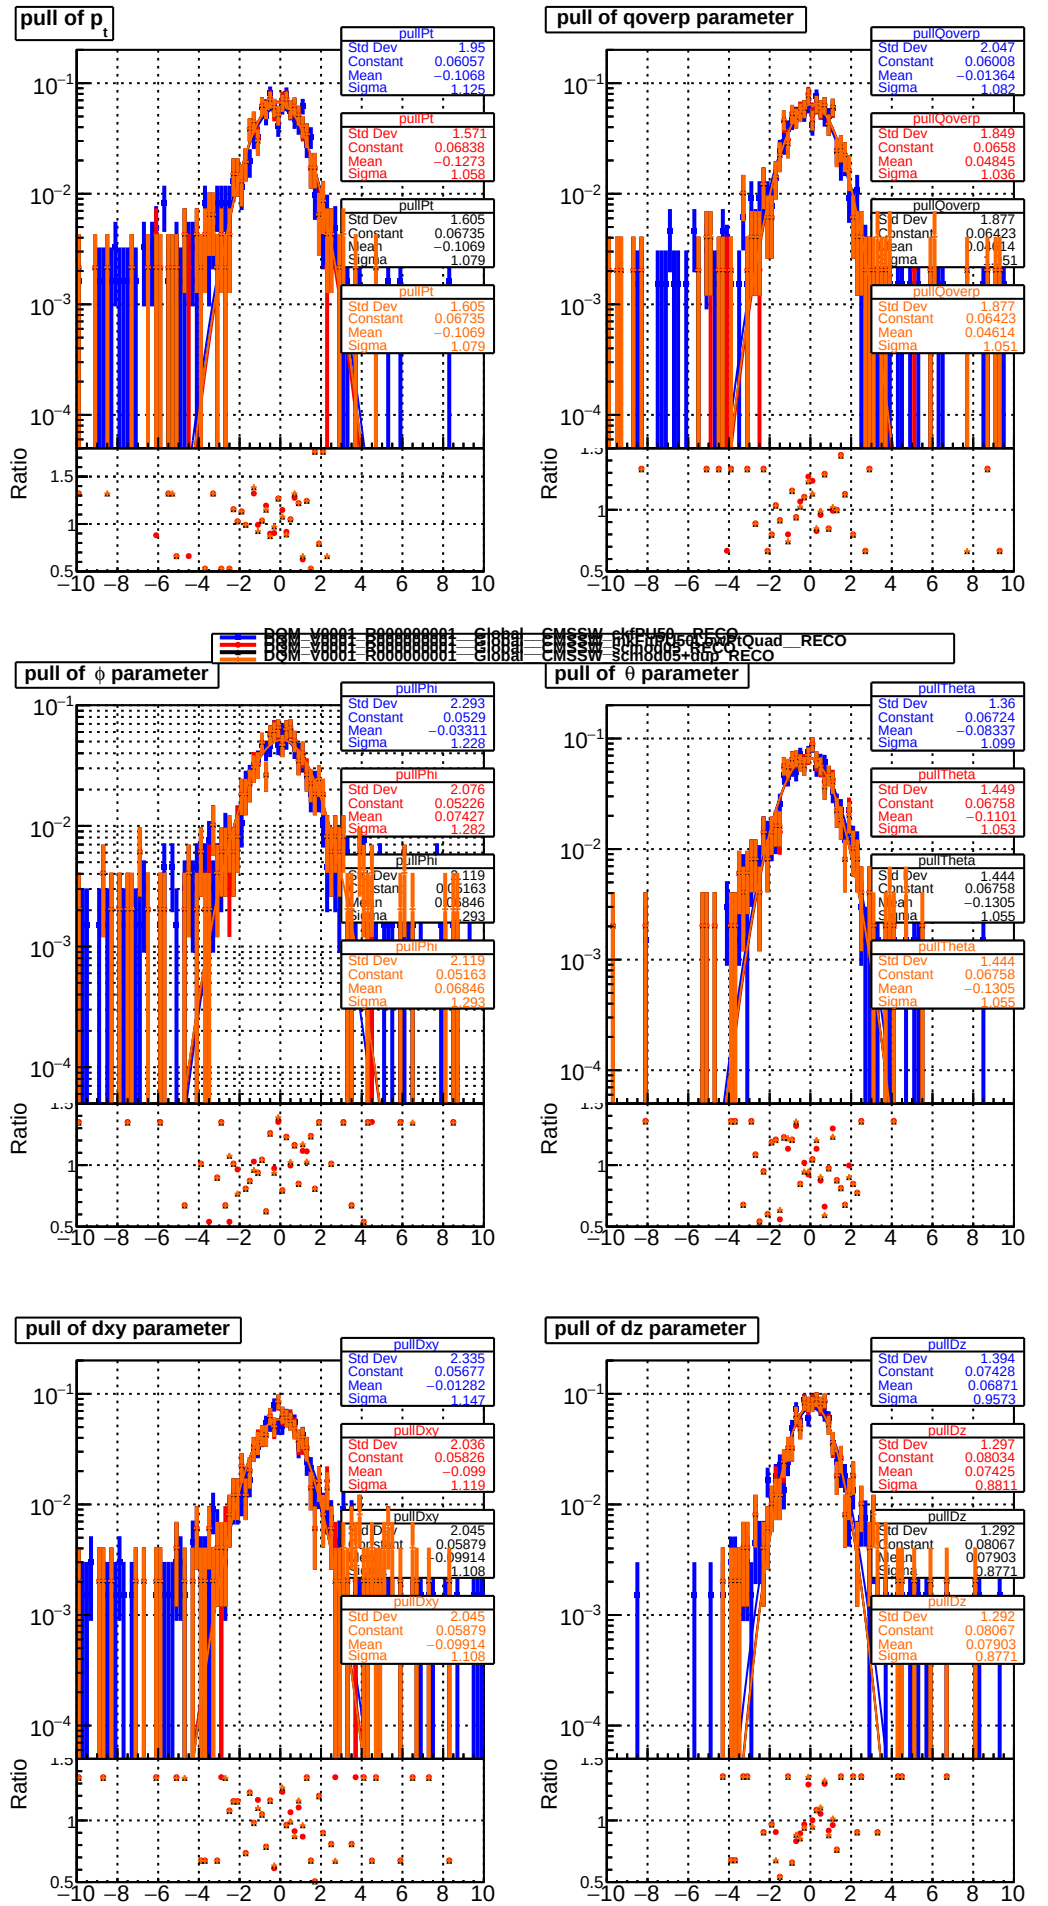
pull of p_t
pullPt
Std Dev 1.95
Constant 0.06057
Mean −0.1068
Sigma 1.125
pullPt
Std Dev 1.571
Constant 0.06838
Mean −0.1273
Sigma 1.058
pullPt
Std Dev 1.605
Constant 0.06735
Mean −0.1069
Sigma 1.079
pullPt
Std Dev 1.605
Constant 0.06735
Mean −0.1069
Sigma 1.079
pull of qoverp parameter
pullQoverp
Std Dev 2.047
Constant 0.06008
Mean −0.01364
Sigma 1.082
pullQoverp
Std Dev 1.849
Constant 0.0658
Mean 0.04845
Sigma 1.036
pullQoverp
Std Dev 1.877
Constant 0.06423
pullQoverp
Std Dev 1.877
Constant 0.06423
Mean 0.04614
Sigma 1.051
DQM V0001 R000000001 Global CMSSW_ckfPU50_RECO
DQM V0001 R000000001 Global CMSSW_pixelPU50_RECOQuad__RECO
DQM V0001 R000000001 Global CMSSW_scm005+dup RECO
pull of ϕ parameter
pullPhi
Std Dev 2.293
Constant 0.0529
Mean −0.03311
Sigma 1.228
pullPhi
Std Dev 2.076
Constant 0.05226
Mean 0.07427
Sigma 1.282
pullPhi
Std Dev 2.119
Constant 0.05163
Mean 0.06846
Sigma 1.293
pullPhi
Std Dev 2.119
Constant 0.05163
Mean 0.06846
Sigma 1.293
pull of θ parameter
pullTheta
Std Dev 1.36
Constant 0.06724
Mean −0.08337
Sigma 1.099
pullTheta
Std Dev 1.449
Constant 0.06758
Mean −0.1101
Sigma 1.053
pullTheta
Std Dev 1.444
Constant 0.06758
Mean −0.1305
Sigma 1.055
pullTheta
Std Dev 1.444
Constant 0.06758
Mean −0.1305
Sigma 1.055
pull of dxy parameter
pullDxy
Std Dev 2.335
Constant 0.05677
Mean −0.01282
Sigma 1.147
pullDxy
Std Dev 2.036
Constant 0.05826
Mean −0.099
Sigma 1.119
pullDxy
Std Dev 2.045
Constant 0.05879
Mean −0.09914
Sigma 1.108
pullDxy
Std Dev 2.045
Constant 0.05879
Mean −0.09914
Sigma 1.108
pull of dz parameter
pullDz
Std Dev 1.394
Constant 0.07428
Mean 0.06871
Sigma 0.9573
pullDz
Std Dev 1.297
Constant 0.08034
Mean 0.07425
Sigma 0.8811
pullDz
Std Dev 1.292
Constant 0.08067
Mean 0.07903
Sigma 0.8771
pullDz
Std Dev 1.292
Constant 0.08067
Mean 0.07903
Sigma 0.8771
Ratio