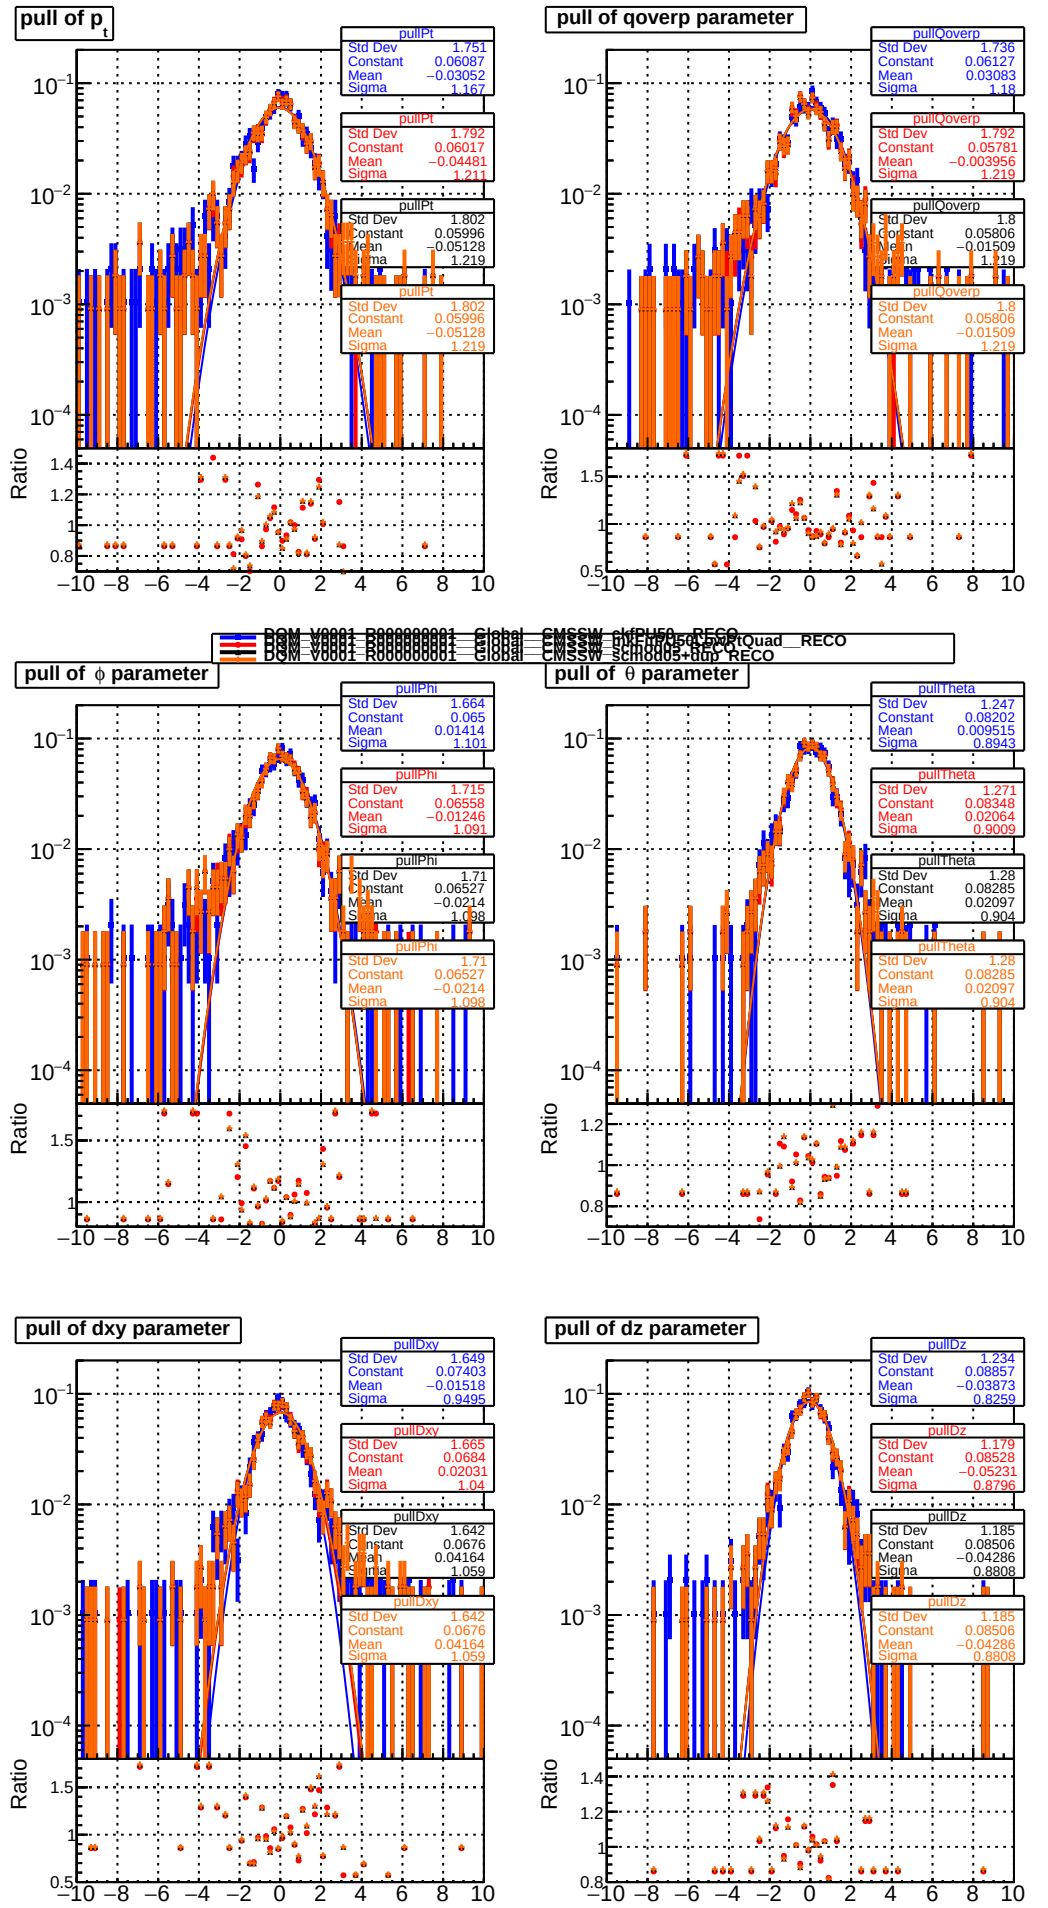
pull of p_t
pullPt
Std Dev 1.751
Constant 0.06087
Mean −0.03052
Sigma 1.167
pullPt
Std Dev 1.792
Constant 0.06017
Mean −0.04481
Sigma 1.211
pullPt
Std Dev 1.802
Constant 0.05996
Mean −0.05128
Sigma 1.219
pullPt
Std Dev 1.802
Constant 0.05996
Mean −0.05128
Sigma 1.219
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.736
Constant 0.06127
Mean 0.03083
Sigma 1.18
pullQoverp
Std Dev 1.792
Constant 0.05781
Mean −0.003956
Sigma 1.219
pullQoverp
Std Dev 1.8
Constant 0.05806
Mean −0.01509
Sigma 1.219
pullQoverp
Std Dev 1.8
Constant 0.05806
Mean −0.01509
Sigma 1.219
Ratio
DQM V0001 R000000001 Global CMSSW_clkPU50_RECO
DQM V0001 R000000001 Global CMSSW_pilPU50+pixelQuad__RECO
DQM V0001 R000000001 Global CMSSW_scl100d5+dup RECO
DQM V0001 R000000001 Global CMSSW_scl100d5+dup RECO
pull of ϕ parameter
pullPhi
Std Dev 1.664
Constant 0.065
Mean 0.01414
Sigma 1.101
pullPhi
Std Dev 1.715
Constant 0.06558
Mean −0.01246
Sigma 1.091
pullPhi
Std Dev 1.71
Constant 0.06527
Mean −0.0214
Sigma 1.098
pullPhi
Std Dev 1.71
Constant 0.06527
Mean −0.0214
Sigma 1.098
Ratio
pull of θ parameter
pullTheta
Std Dev 1.247
Constant 0.08202
Mean 0.009515
Sigma 0.8943
pullTheta
Std Dev 1.271
Constant 0.08348
Mean 0.02064
Sigma 0.9009
pullTheta
Std Dev 1.28
Constant 0.08285
Mean 0.02097
Sigma 0.904
pullTheta
Std Dev 1.28
Constant 0.08285
Mean 0.02097
Sigma 0.904
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.649
Constant 0.07403
Mean −0.01518
Sigma 0.9495
pullDxy
Std Dev 1.665
Constant 0.0684
Mean 0.02031
Sigma 1.04
pullDxy
Std Dev 1.642
Constant 0.0676
Mean 0.04164
Sigma 1.059
pullDxy
Std Dev 1.642
Constant 0.0676
Mean 0.04164
Sigma 1.059
Ratio
pull of dz parameter
pullDz
Std Dev 1.234
Constant 0.08857
Mean −0.03873
Sigma 0.8259
pullDz
Std Dev 1.179
Constant 0.08528
Mean −0.05231
Sigma 0.8796
pullDz
Std Dev 1.185
Constant 0.08506
Mean −0.04286
Sigma 0.8808
pullDz
Std Dev 1.185
Constant 0.08506
Mean −0.04286
Sigma 0.8808
Ratio