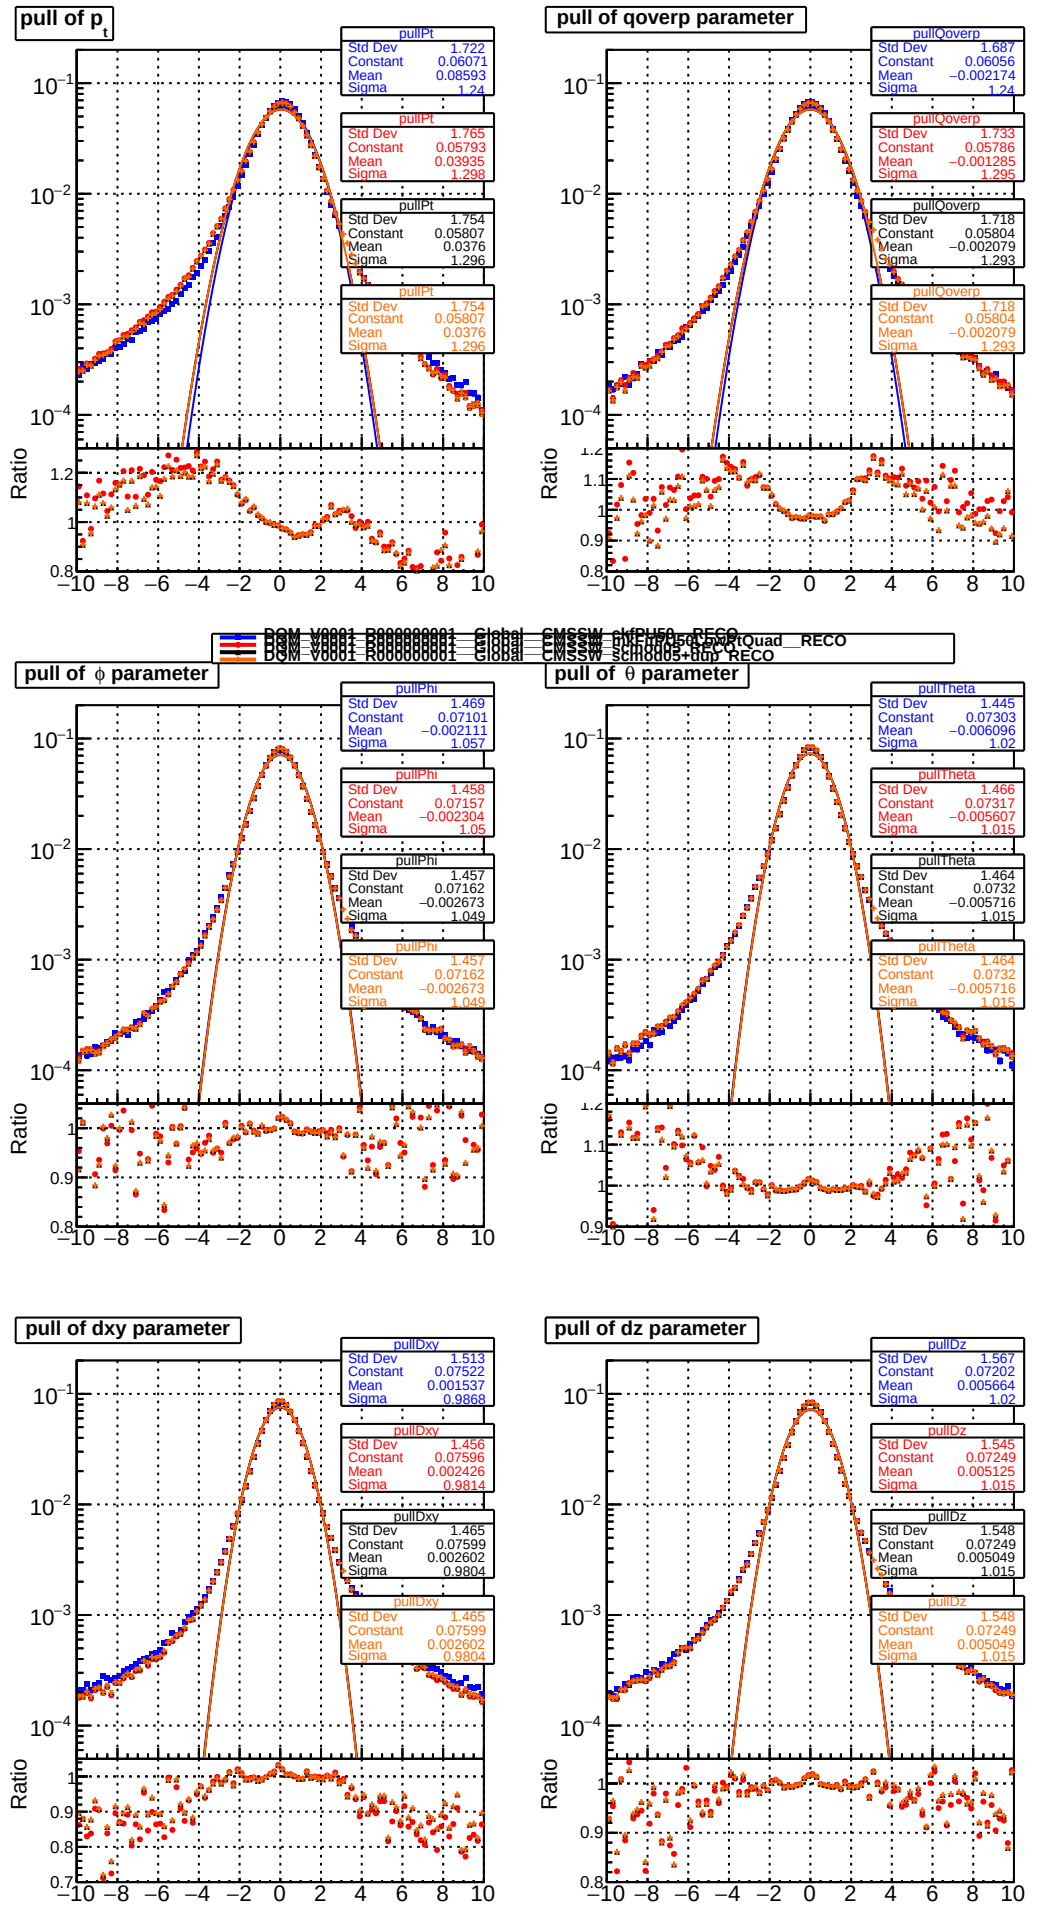
pull of p_t
pullPt
Std Dev 1.722
Constant 0.06071
Mean 0.08593
Sigma 1.24
pullPt
Std Dev 1.765
Constant 0.05793
Mean 0.03935
Sigma 1.298
pullPt
Std Dev 1.754
Constant 0.05807
Mean 0.0376
Sigma 1.296
pullPt
Std Dev 1.754
Constant 0.05807
Mean 0.0376
Sigma 1.296
pull of qoverp parameter
pullQoverp
Std Dev 1.687
Constant 0.06056
Mean −0.002174
Sigma 1.24
pullQoverp
Std Dev 1.733
Constant 0.05786
Mean −0.001285
Sigma 1.295
pullQoverp
Std Dev 1.718
Constant 0.05804
Mean −0.002079
Sigma 1.293
pullQoverp
Std Dev 1.718
Constant 0.05804
Mean −0.002079
Sigma 1.293
Ratio
DQM V0001 R000000001 Global CMSSW_clkPU50_RECO
DQM V0001 R000000001 Global CMSSW_pixPU50_RECO_QuadQuad__RECO
DQM V0001 R000000001 Global CMSSW_scm005+RECO
DQM V0001 R000000001 Global CMSSW_scm005+dup_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.469
Constant 0.07101
Mean −0.002111
Sigma 1.057
pullPhi
Std Dev 1.458
Constant 0.07157
Mean −0.002304
Sigma 1.05
pullPhi
Std Dev 1.457
Constant 0.07162
Mean −0.002673
Sigma 1.049
pullPhi
Std Dev 1.457
Constant 0.07162
Mean −0.002673
Sigma 1.049
pull of θ parameter
pullTheta
Std Dev 1.445
Constant 0.07303
Mean −0.006096
Sigma 1.02
pullTheta
Std Dev 1.466
Constant 0.07317
Mean −0.005607
Sigma 1.015
pullTheta
Std Dev 1.464
Constant 0.0732
Mean −0.005716
Sigma 1.015
pullTheta
Std Dev 1.464
Constant 0.0732
Mean −0.005716
Sigma 1.015
pull of dxy parameter
pullDxy
Std Dev 1.513
Constant 0.07522
Mean 0.001537
Sigma 0.9868
pullDxy
Std Dev 1.456
Constant 0.07596
Mean 0.002426
Sigma 0.9814
pullDxy
Std Dev 1.465
Constant 0.07599
Mean 0.002602
Sigma 0.9804
pullDxy
Std Dev 1.465
Constant 0.07599
Mean 0.002602
Sigma 0.9804
pull of dz parameter
pullDz
Std Dev 1.567
Constant 0.07202
Mean 0.005664
Sigma 1.02
pullDz
Std Dev 1.545
Constant 0.07249
Mean 0.005125
Sigma 1.015
pullDz
Std Dev 1.548
Constant 0.07249
Mean 0.005049
Sigma 1.015
pullDz
Std Dev 1.548
Constant 0.07249
Mean 0.005049
Sigma 1.015