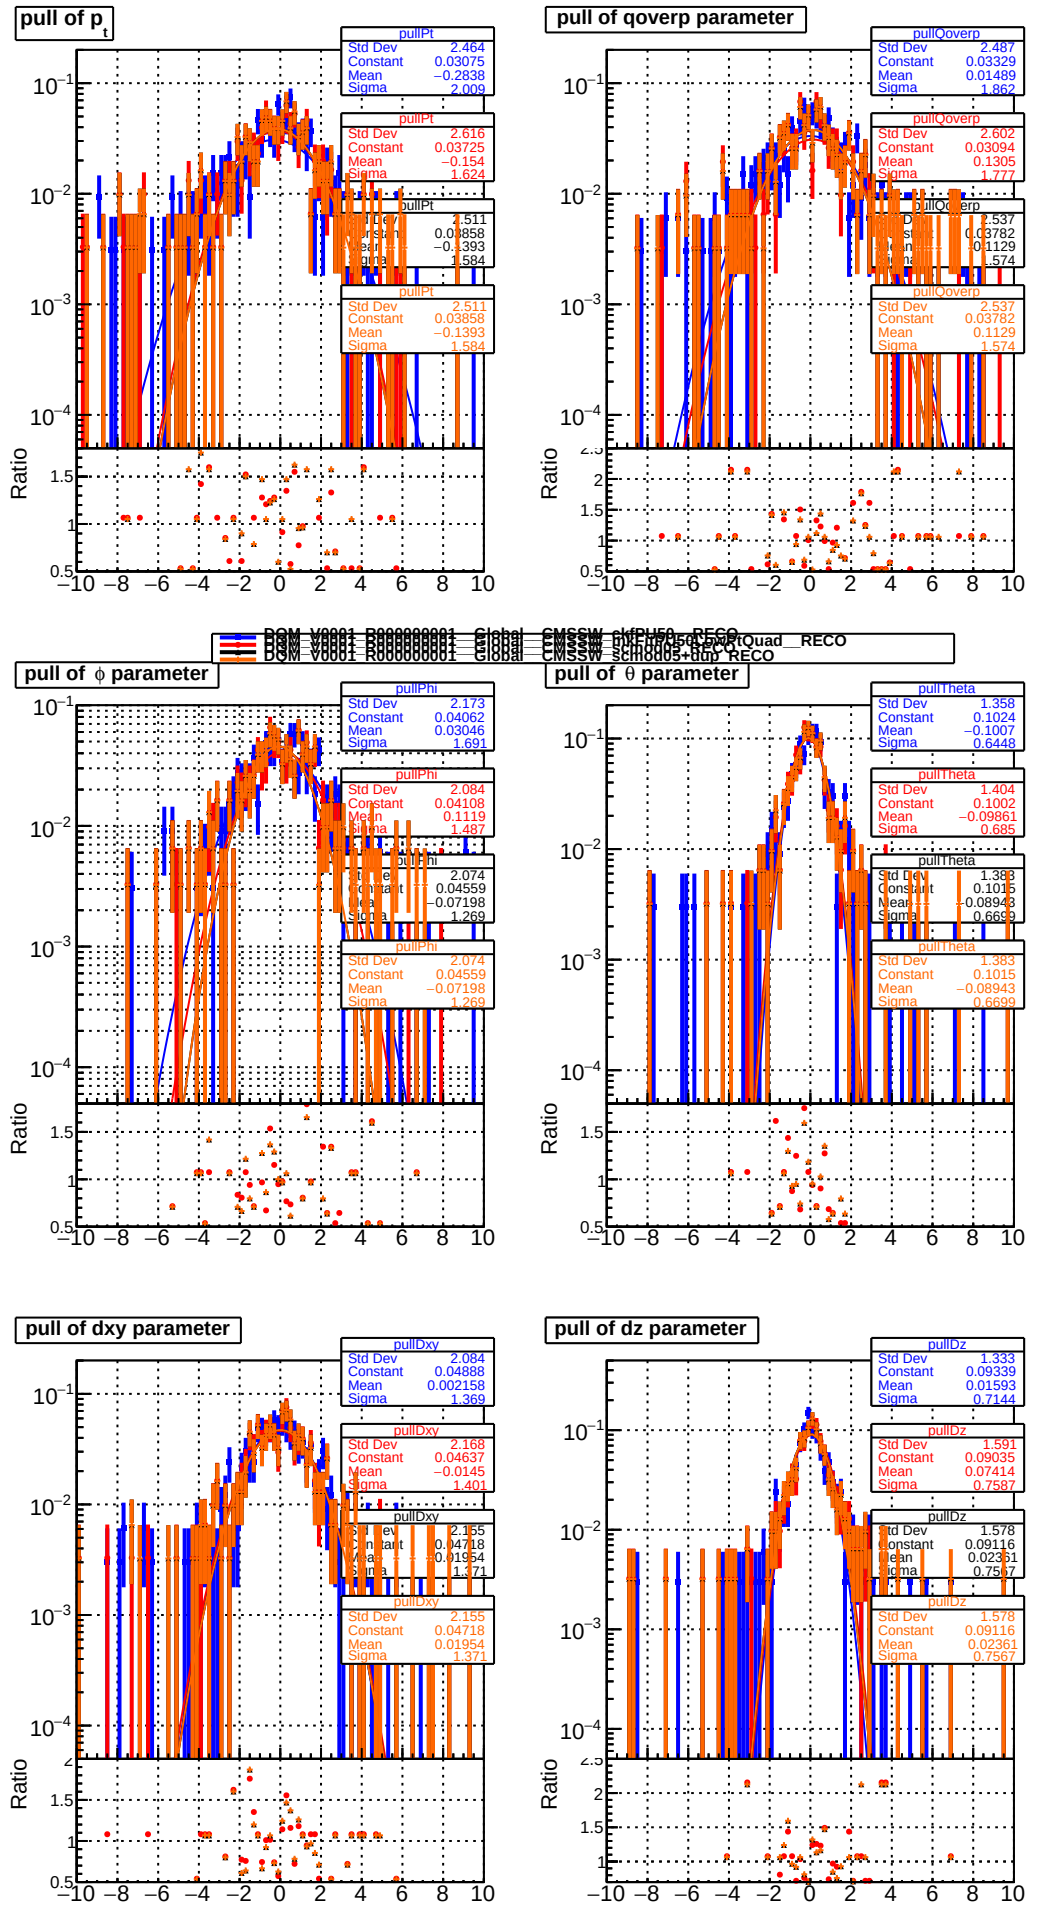
pull of p_t
pullPt
Std Dev 2.464
Constant 0.03075
Mean −0.2838
Sigma 2.009
pullPt
Std Dev 2.616
Constant 0.03725
Mean −0.154
Sigma 1.624
pullPt
Std Dev 2.511
Constant 0.03858
Mean −0.1393
Sigma 1.584
pullPt
Std Dev 2.511
Constant 0.03858
Mean −0.1393
Sigma 1.584
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.487
Constant 0.03329
Mean 0.01489
Sigma 1.862
pullQoverp
Std Dev 2.602
Constant 0.03094
Mean 0.1305
Sigma 1.777
pullQoverp
Std Dev 2.537
Constant 0.03782
Mean 0.1129
Sigma 1.574
pullQoverp
Std Dev 2.537
Constant 0.03782
Mean 0.1129
Sigma 1.574
Ratio
DQM V0001 R000000001 Global CMSSW_ckfPU50_RECO
DQM V0001 R000000001 Global CMSSW_pixelPU50_RECO_Quad__RECO
DQM V0001 R000000001 Global CMSSW_scm005+RECO
DQM V0001 R000000001 Global CMSSW_scm005+dup_RECO
pull of ϕ parameter
pullPhi
Std Dev 2.173
Constant 0.04062
Mean 0.03046
Sigma 1.691
pullPhi
Std Dev 2.084
Constant 0.04108
Mean 0.1119
Sigma 1.487
pullPhi
Std Dev 2.074
Constant 0.04559
Mean −0.07198
Sigma 1.269
pullPhi
Std Dev 2.074
Constant 0.04559
Mean −0.07198
Sigma 1.269
Ratio
pull of θ parameter
pullTheta
Std Dev 1.358
Constant 0.1024
Mean −0.1007
Sigma 0.6448
pullTheta
Std Dev 1.404
Constant 0.1002
Mean −0.09861
Sigma 0.685
pullTheta
Std Dev 1.383
Constant 0.1015
Mean −0.08943
Sigma 0.6699
pullTheta
Std Dev 1.383
Constant 0.1015
Mean −0.08943
Sigma 0.6699
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.084
Constant 0.04888
Mean 0.002158
Sigma 1.369
pullDxy
Std Dev 2.168
Constant 0.04637
Mean −0.0145
Sigma 1.401
pullDxy
Std Dev 2.155
Constant 0.04718
Mean 0.01954
Sigma 1.371
pullDxy
Std Dev 2.155
Constant 0.04718
Mean 0.01954
Sigma 1.371
Ratio
pull of dz parameter
pullDz
Std Dev 1.333
Constant 0.09339
Mean 0.01593
Sigma 0.7144
pullDz
Std Dev 1.591
Constant 0.09035
Mean 0.07414
Sigma 0.7587
pullDz
Std Dev 1.578
Constant 0.09116
Mean 0.02361
Sigma 0.7567
pullDz
Std Dev 1.578
Constant 0.09116
Mean 0.02361
Sigma 0.7567
Ratio