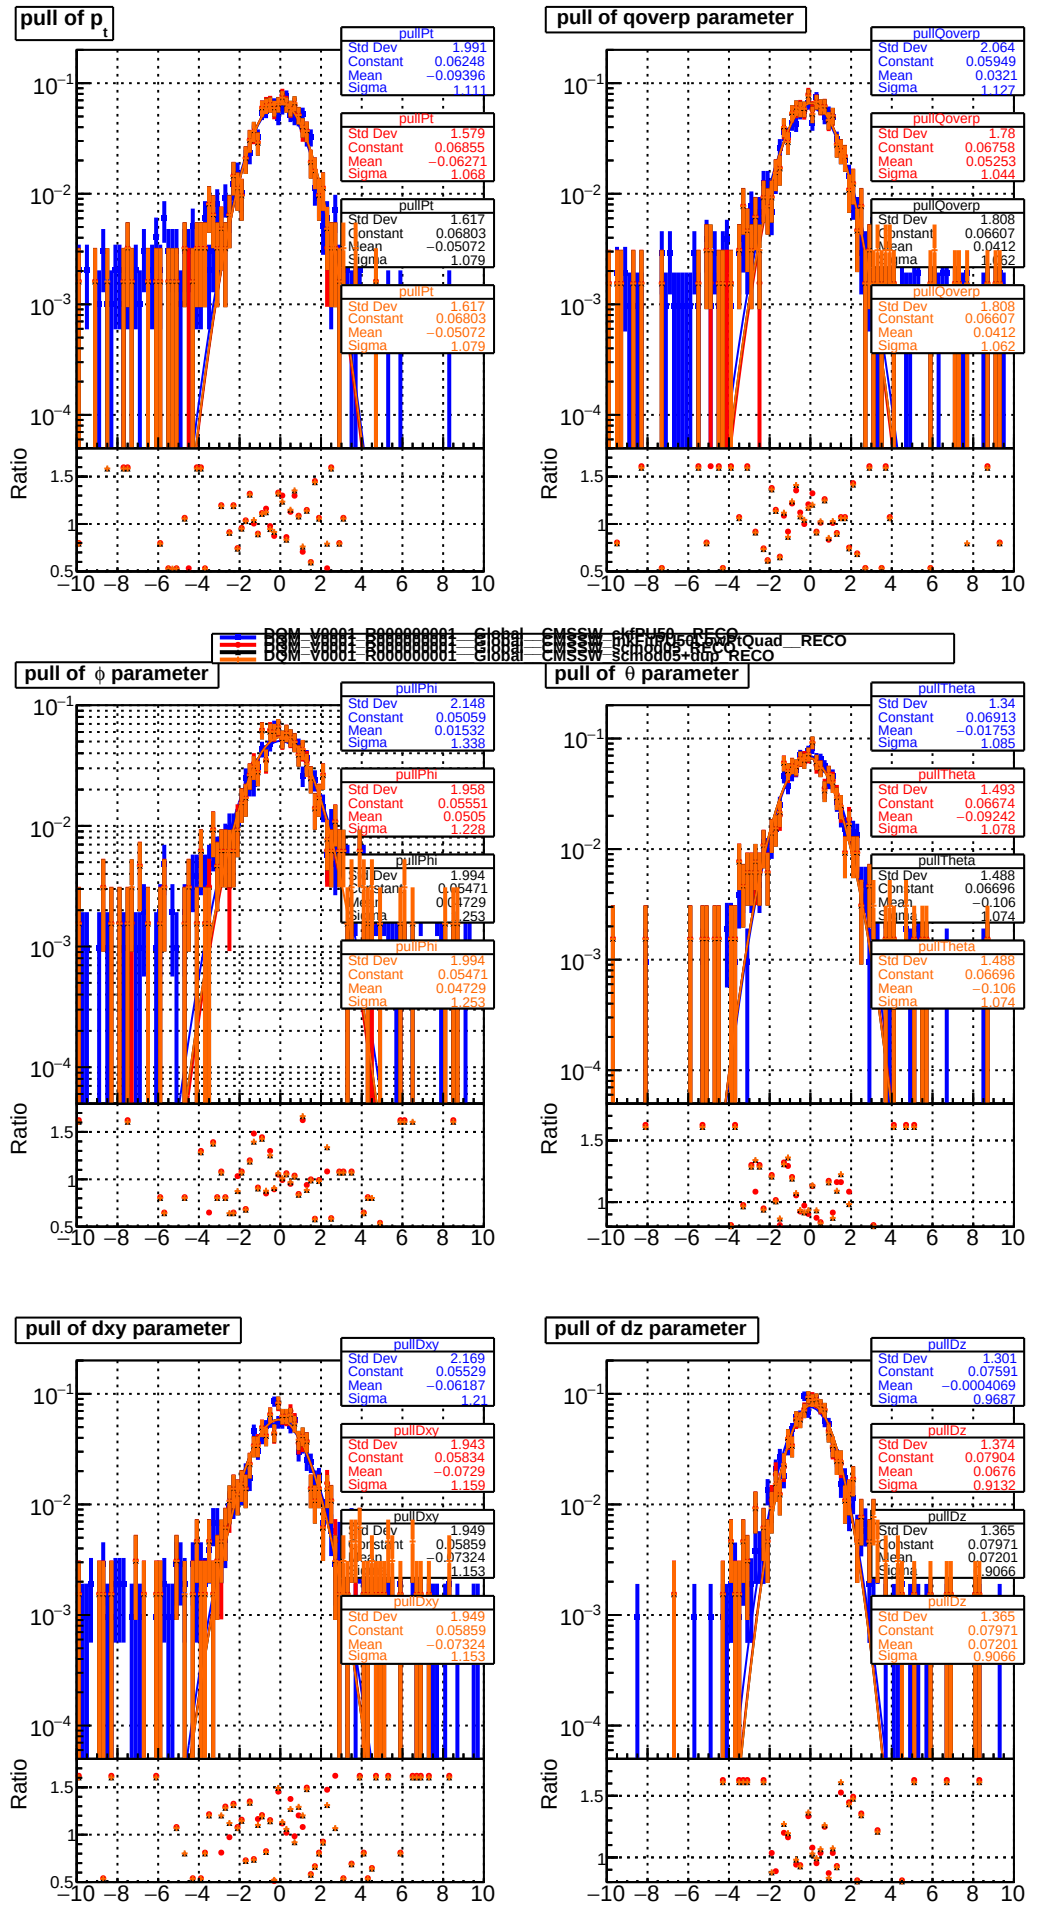
pull of p_t
pullPt
Std Dev 1.991
Constant 0.06248
Mean −0.09396
Sigma 1.111
pullPt
Std Dev 1.579
Constant 0.06855
Mean −0.06271
Sigma 1.068
pullPt
Std Dev 1.617
Constant 0.06803
Mean −0.05072
Sigma 1.079
pullPt
Std Dev 1.617
Constant 0.06803
Mean −0.05072
Sigma 1.079
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.064
Constant 0.05949
Mean 0.0321
Sigma 1.127
pullQoverp
Std Dev 1.78
Constant 0.06758
Mean 0.05253
Sigma 1.044
pullQoverp
Std Dev 1.808
Constant 0.06607
Mean 0.0412
pullQoverp
Std Dev 1.808
Constant 0.06607
Mean 0.0412
Sigma 1.062
Ratio
DQM V0001 R000000001 Global CMSSW_ckfPU50_RECO
DQM V0001 R000000001 Global CMSSW_pixelPU50_RECO_Quad__RECO
DQM V0001 R000000001 Global CMSSW_scinod05+RECO
DQM V0001 R000000001 Global CMSSW_scinod05+dup_RECO
pull of ϕ parameter
pullPhi
Std Dev 2.148
Constant 0.05059
Mean 0.01532
Sigma 1.338
pullPhi
Std Dev 1.958
Constant 0.05551
Mean 0.0505
Sigma 1.228
pullPhi
Std Dev 1.994
Constant 0.05471
Mean 0.04729
Sigma 1.253
pullPhi
Std Dev 1.994
Constant 0.05471
Mean 0.04729
Sigma 1.253
Ratio
pull of θ parameter
pullTheta
Std Dev 1.34
Constant 0.06913
Mean −0.01753
Sigma 1.085
pullTheta
Std Dev 1.493
Constant 0.06674
Mean −0.09242
Sigma 1.078
pullTheta
Std Dev 1.488
Constant 0.06696
Mean −0.106
Sigma 1.074
pullTheta
Std Dev 1.488
Constant 0.06696
Mean −0.106
Sigma 1.074
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.169
Constant 0.05529
Mean −0.06187
Sigma 1.21
pullDxy
Std Dev 1.943
Constant 0.05834
Mean −0.0729
Sigma 1.159
pullDxy
Std Dev 1.949
Constant 0.05859
Mean −0.07324
Sigma 1.153
pullDxy
Std Dev 1.949
Constant 0.05859
Mean −0.07324
Sigma 1.153
Ratio
pull of dz parameter
pullDz
Std Dev 1.301
Constant 0.07591
Mean −0.0004069
Sigma 0.9687
pullDz
Std Dev 1.374
Constant 0.07904
Mean 0.0676
Sigma 0.9132
pullDz
Std Dev 1.365
Constant 0.07971
Mean 0.07201
Sigma 0.9066
pullDz
Std Dev 1.365
Constant 0.07971
Mean 0.07201
Sigma 0.9066
Ratio