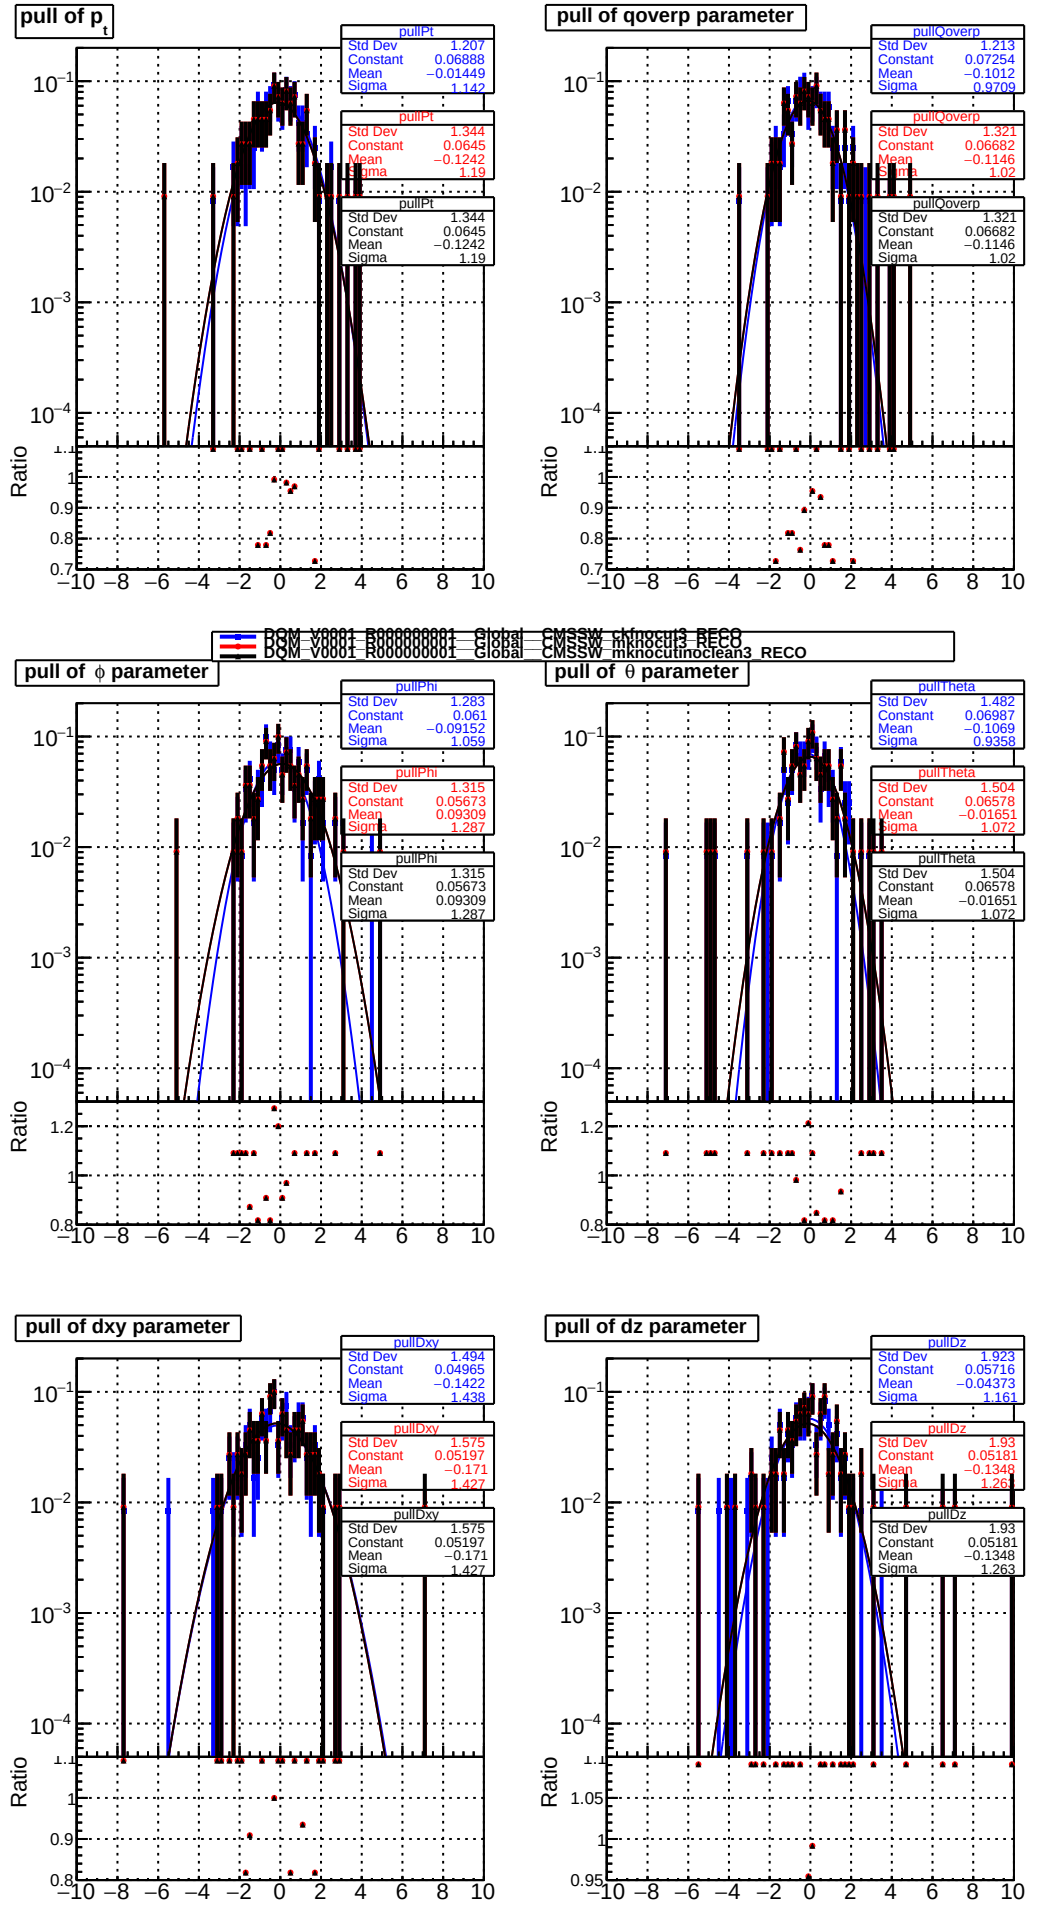
pull of p_t
pullPt
Std Dev 1.207
Constant 0.06888
Mean −0.01449
Sigma 1.142
pullPt
Std Dev 1.344
Constant 0.0645
Mean −0.1242
Sigma 1.19
pullPt
Std Dev 1.344
Constant 0.0645
Mean −0.1242
Sigma 1.19
pull of qoverp parameter
pullQoverp
Std Dev 1.213
Constant 0.07254
Mean −0.1012
Sigma 0.9709
pullQoverp
Std Dev 1.321
Constant 0.06682
Mean −0.1146
Sigma 1.02
pullQoverp
Std Dev 1.321
Constant 0.06682
Mean −0.1146
Sigma 1.02
DQM_V0001_R000000001__Global__CMSSW_ckfnocut3_RECO
DQM_V0001_R000000001__Global__CMSSW_mknocut3_RECO
DQM_V0001_R000000001__Global__CMSSW_mknocutinoclean3_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.283
Constant 0.061
Mean −0.09152
Sigma 1.059
pullPhi
Std Dev 1.315
Constant 0.05673
Mean 0.09309
Sigma 1.287
pullPhi
Std Dev 1.315
Constant 0.05673
Mean 0.09309
Sigma 1.287
pull of θ parameter
pullTheta
Std Dev 1.482
Constant 0.06987
Mean −0.1069
Sigma 0.9358
pullTheta
Std Dev 1.504
Constant 0.06578
Mean −0.01651
Sigma 1.072
pullTheta
Std Dev 1.504
Constant 0.06578
Mean −0.01651
Sigma 1.072
pull of dxy parameter
pullDxy
Std Dev 1.494
Constant 0.04965
Mean −0.1422
Sigma 1.438
pullDxy
Std Dev 1.575
Constant 0.05197
Mean −0.171
Sigma 1.427
pullDxy
Std Dev 1.575
Constant 0.05197
Mean −0.171
Sigma 1.427
pull of dz parameter
pullDz
Std Dev 1.923
Constant 0.05716
Mean −0.04373
Sigma 1.161
pullDz
Std Dev 1.93
Constant 0.05181
Mean −0.1348
Sigma 1.261
pullDz
Std Dev 1.93
Constant 0.05181
Mean −0.1348
Sigma 1.263
Ratio