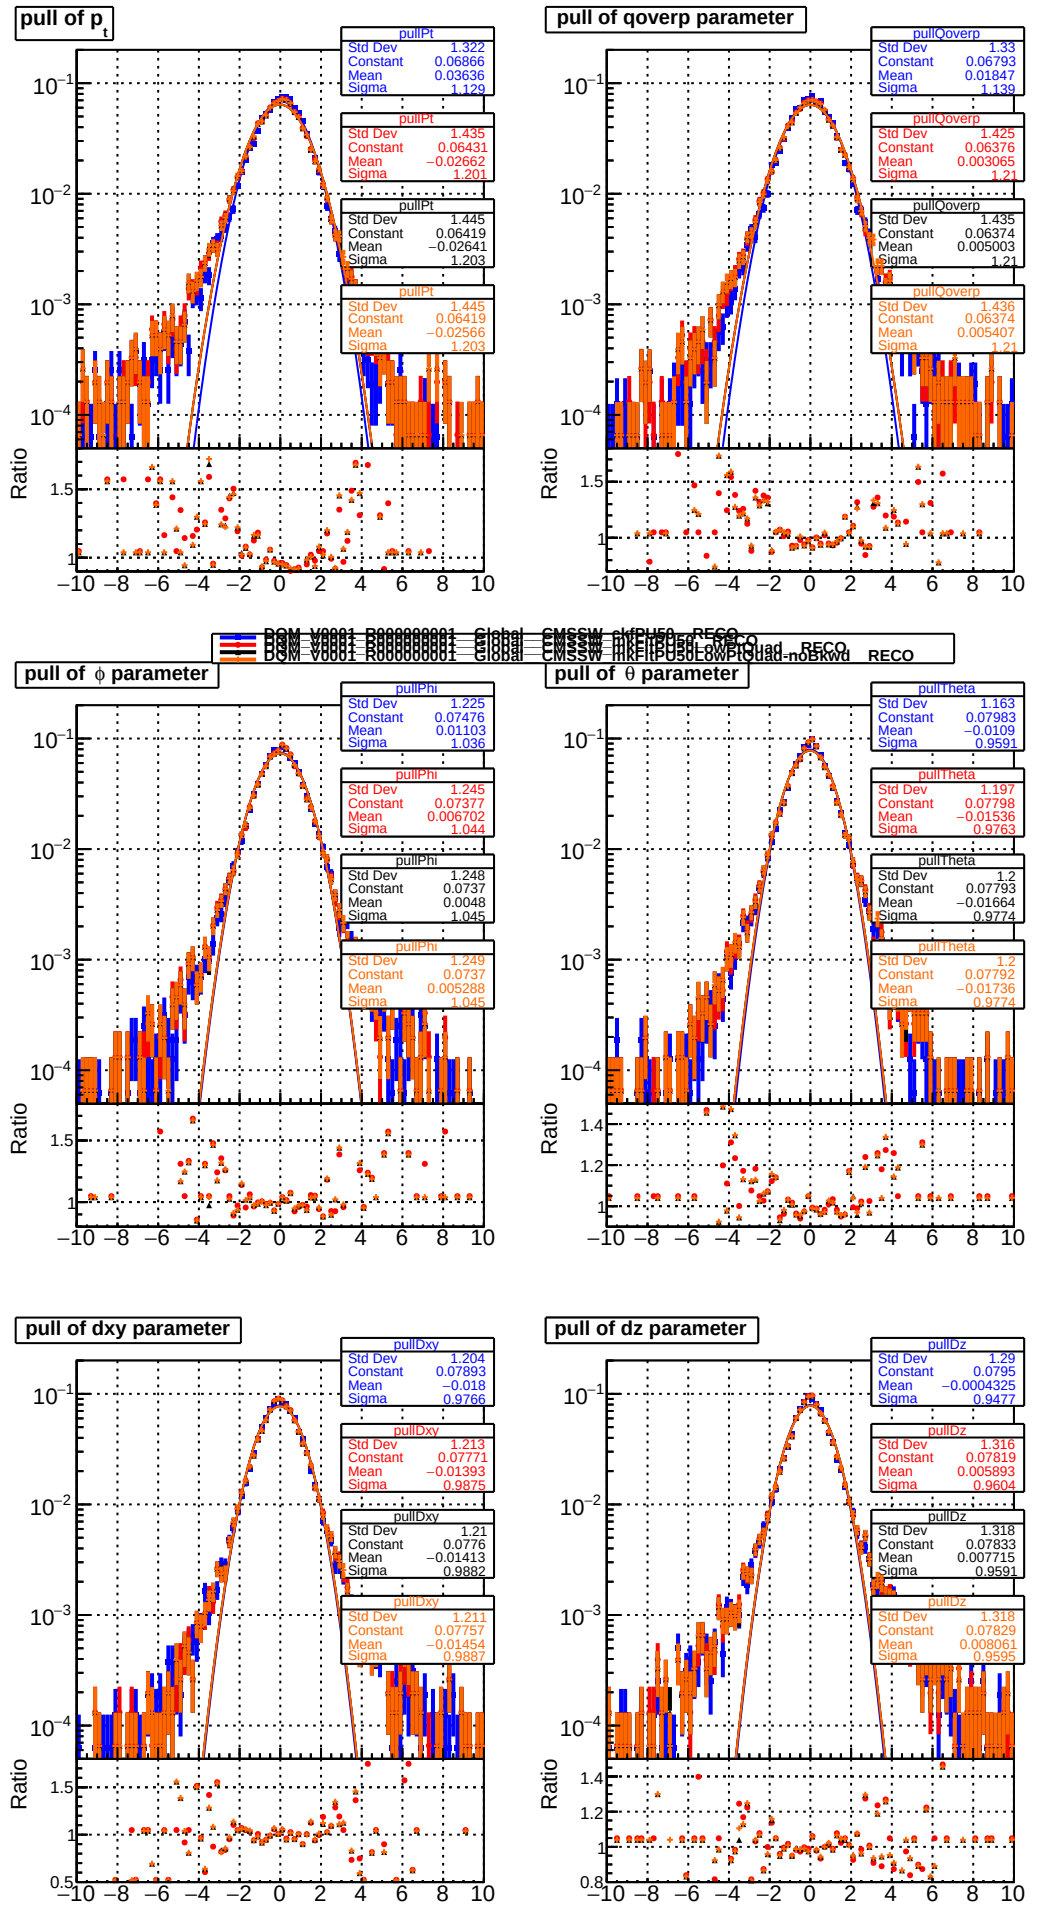
pull of p_t
pullPt
Std Dev 1.322
Constant 0.06866
Mean 0.03636
Sigma 1.129
pullPt
Std Dev 1.435
Constant 0.06431
Mean −0.02662
Sigma 1.201
pullPt
Std Dev 1.445
Constant 0.06419
Mean −0.02641
Sigma 1.203
pullPt
Std Dev 1.445
Constant 0.06419
Mean −0.02566
Sigma 1.203
pull of qoverp parameter
pullQoverp
Std Dev 1.33
Constant 0.06793
Mean 0.01847
Sigma 1.139
pullQoverp
Std Dev 1.425
Constant 0.06376
Mean 0.003065
Sigma 1.21
pullQoverp
Std Dev 1.435
Constant 0.06374
Mean 0.005003
Sigma 1.21
pullQoverp
Std Dev 1.436
Constant 0.06374
Mean 0.005407
Sigma 1.21
DQM V0001 R000000001 Global CMSSW ckfPU50 RECO
DQM V0001 R000000001 Global CMSSW mkFitPU50 RECO
DQM V0001 R000000001 Global CMSSW mkFitPU50-lowPtQuad RECO
DQM V0001 R000000001 Global CMSSW mkFitPU50-lowPtQuad-noBkwd RECO
pull of ϕ parameter
pullPhi
Std Dev 1.225
Constant 0.07476
Mean 0.01103
Sigma 1.036
pullPhi
Std Dev 1.245
Constant 0.07377
Mean 0.006702
Sigma 1.044
pullPhi
Std Dev 1.248
Constant 0.0737
Mean 0.0048
Sigma 1.045
pullPhi
Std Dev 1.249
Constant 0.0737
Mean 0.005288
Sigma 1.045
pull of θ parameter
pullTheta
Std Dev 1.163
Constant 0.07983
Mean −0.0109
Sigma 0.9591
pullTheta
Std Dev 1.197
Constant 0.07798
Mean −0.01536
Sigma 0.9763
pullTheta
Std Dev 1.2
Constant 0.07793
Mean −0.01664
Sigma 0.9774
pullTheta
Std Dev 1.2
Constant 0.07792
Mean −0.01736
Sigma 0.9774
pull of dxy parameter
pullDxy
Std Dev 1.204
Constant 0.07893
Mean −0.018
Sigma 0.9766
pullDxy
Std Dev 1.213
Constant 0.07771
Mean −0.01393
Sigma 0.9875
pullDxy
Std Dev 1.21
Constant 0.0776
Mean −0.01413
Sigma 0.9882
pullDxy
Std Dev 1.211
Constant 0.07757
Mean −0.01454
Sigma 0.9887
pull of dz parameter
pullDz
Std Dev 1.29
Constant 0.0795
Mean −0.0004325
Sigma 0.9477
pullDz
Std Dev 1.316
Constant 0.07819
Mean 0.005893
Sigma 0.9604
pullDz
Std Dev 1.318
Constant 0.07833
Mean 0.007715
Sigma 0.9591
pullDz
Std Dev 1.318
Constant 0.07829
Mean 0.008061
Sigma 0.9595
Ratio