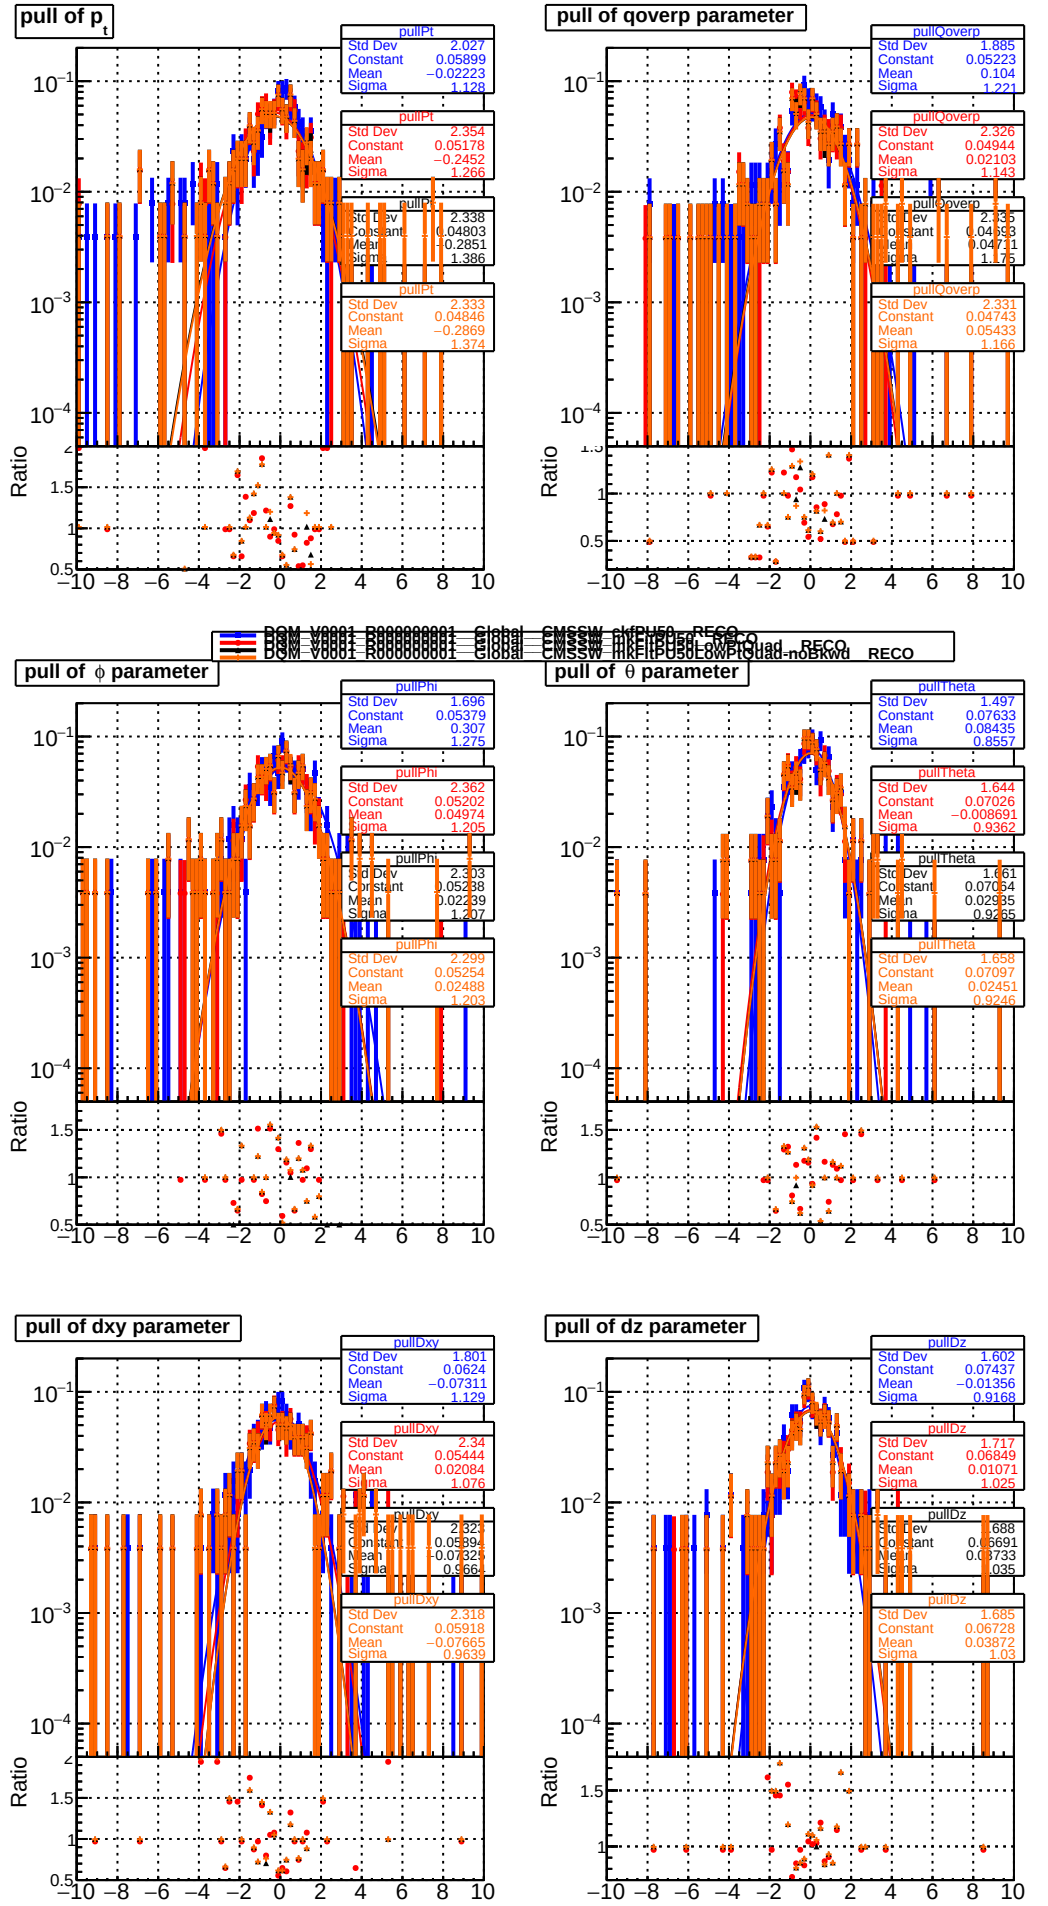
pull of $p_t$
pullPt
Std Dev 2.027
Constant 0.05899
Mean −0.02223
Sigma 1.128
pullPt
Std Dev 2.354
Constant 0.05178
Mean −0.2452
Sigma 1.266
pullPt
Std Dev 2.338
Constant 0.04803
Mean −0.2851
Sigma 1.386
pullPt
Std Dev 2.333
Constant 0.04846
Mean −0.2869
Sigma 1.374
pull of qoverp parameter
pullQoverp
Std Dev 1.885
Constant 0.05223
Mean 0.104
Sigma 1.221
pullQoverp
Std Dev 2.326
Constant 0.04944
Mean 0.02103
Sigma 1.143
pullQoverp
pullQoverp
Std Dev 2.331
Constant 0.04743
Mean 0.05433
Sigma 1.166
DQM V0001 R000000001 Global CMSSW_initPU50_RECO
DQM V0001 R000000001 Global CMSSW_initPU50_RECO
DQM V0001 R000000001 Global CMSSW_initPU50_lowPtQuad RECO
DQM V0001 R000000001 Global CMSSW_initPU50_lowPtQuad-noBkwd RECO
pull of ϕ parameter
pullPhi
Std Dev 1.696
Constant 0.05379
Mean 0.307
Sigma 1.275
pullPhi
Std Dev 2.362
Constant 0.05202
Mean 0.04974
Sigma 1.205
pullPhi
pullPhi
Std Dev 2.299
Constant 0.05254
Mean 0.02488
Sigma 1.203
pull of θ parameter
pullTheta
Std Dev 1.497
Constant 0.07633
Mean 0.08435
Sigma 0.8557
pullTheta
Std Dev 1.644
Constant 0.07026
Mean −0.008691
Sigma 0.9362
pullTheta
pullTheta
Std Dev 1.658
Constant 0.07097
Mean 0.02451
Sigma 0.9246
pull of dxy parameter
pullDxy
Std Dev 1.801
Constant 0.0624
Mean −0.07311
Sigma 1.129
pullDxy
Std Dev 2.34
Constant 0.05444
Mean 0.02084
Sigma 1.076
pullDxy
pullDxy
Std Dev 2.318
Constant 0.05918
Mean −0.07665
Sigma 0.9639
pull of dz parameter
pullDz
Std Dev 1.602
Constant 0.07437
Mean −0.01356
Sigma 0.9168
pullDz
Std Dev 1.717
Constant 0.06849
Mean 0.01071
Sigma 1.025
pullDz
pullDz
Std Dev 1.685
Constant 0.06728
Mean 0.03872
Sigma 1.03
Ratio