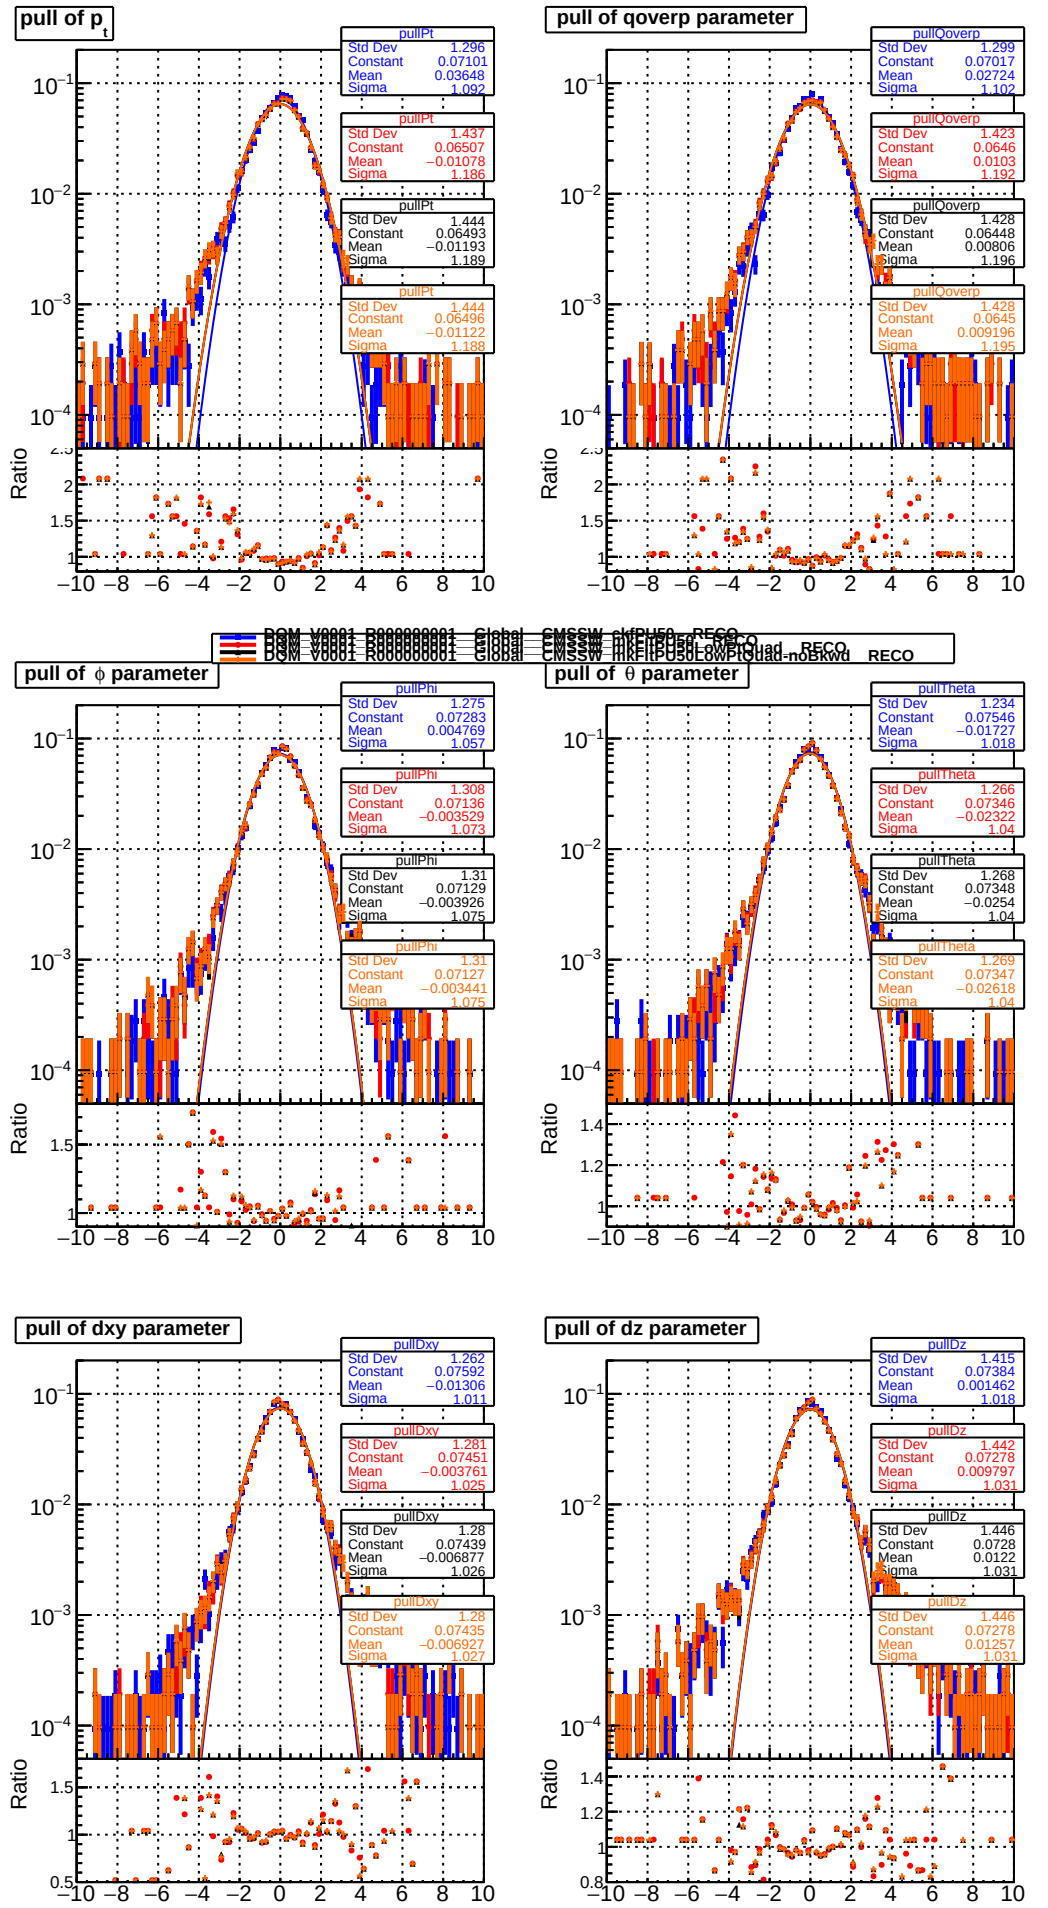
pull of p_t
pullPt
Std Dev 1.296
Constant 0.07101
Mean 0.03648
Sigma 1.092
pullPt
Std Dev 1.437
Constant 0.06507
Mean −0.01078
Sigma 1.186
pullPt
Std Dev 1.444
Constant 0.06493
Mean −0.01193
Sigma 1.189
pullPt
Std Dev 1.444
Constant 0.06496
Mean −0.01122
Sigma 1.188
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.299
Constant 0.07017
Mean 0.02724
Sigma 1.102
pullQoverp
Std Dev 1.423
Constant 0.0646
Mean 0.0103
Sigma 1.192
pullQoverp
Std Dev 1.428
Constant 0.06448
Mean 0.00806
Sigma 1.196
pullQoverp
Std Dev 1.428
Constant 0.0645
Mean 0.009196
Sigma 1.195
Ratio
DQM V0001 R000000001 Global CMSSW ckfPU50 RECO
DQM V0001 R000000001 Global CMSSW mkFitPU50 RECO
DQM V0001 R000000001 Global CMSSW mkFitPU50LowPtQuad RECO
DQM V0001 R000000001 Global CMSSW mkFitPU50LowPtQuad-noBkwd RECO
pull of ϕ parameter
pullPhi
Std Dev 1.275
Constant 0.07283
Mean 0.004769
Sigma 1.057
pullPhi
Std Dev 1.308
Constant 0.07136
Mean −0.003529
Sigma 1.073
pullPhi
Std Dev 1.31
Constant 0.07129
Mean −0.003926
Sigma 1.075
pullPhi
Std Dev 1.31
Constant 0.07127
Mean −0.003441
Sigma 1.075
Ratio
pull of θ parameter
pullTheta
Std Dev 1.234
Constant 0.07546
Mean −0.01727
Sigma 1.018
pullTheta
Std Dev 1.266
Constant 0.07346
Mean −0.02322
Sigma 1.04
pullTheta
Std Dev 1.268
Constant 0.07348
Mean −0.0254
Sigma 1.04
pullTheta
Std Dev 1.269
Constant 0.07347
Mean −0.02618
Sigma 1.04
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.262
Constant 0.07592
Mean −0.01306
Sigma 1.011
pullDxy
Std Dev 1.281
Constant 0.07451
Mean −0.003761
Sigma 1.025
pullDxy
Std Dev 1.28
Constant 0.07439
Mean −0.006877
Sigma 1.026
pullDxy
Std Dev 1.28
Constant 0.07435
Mean −0.006927
Sigma 1.027
Ratio
pull of dz parameter
pullDz
Std Dev 1.415
Constant 0.07384
Mean 0.001462
Sigma 1.018
pullDz
Std Dev 1.442
Constant 0.07278
Mean 0.009797
Sigma 1.031
pullDz
Std Dev 1.446
Constant 0.0728
Mean 0.0122
Sigma 1.031
pullDz
Std Dev 1.446
Constant 0.07278
Mean 0.01257
Sigma 1.031
Ratio