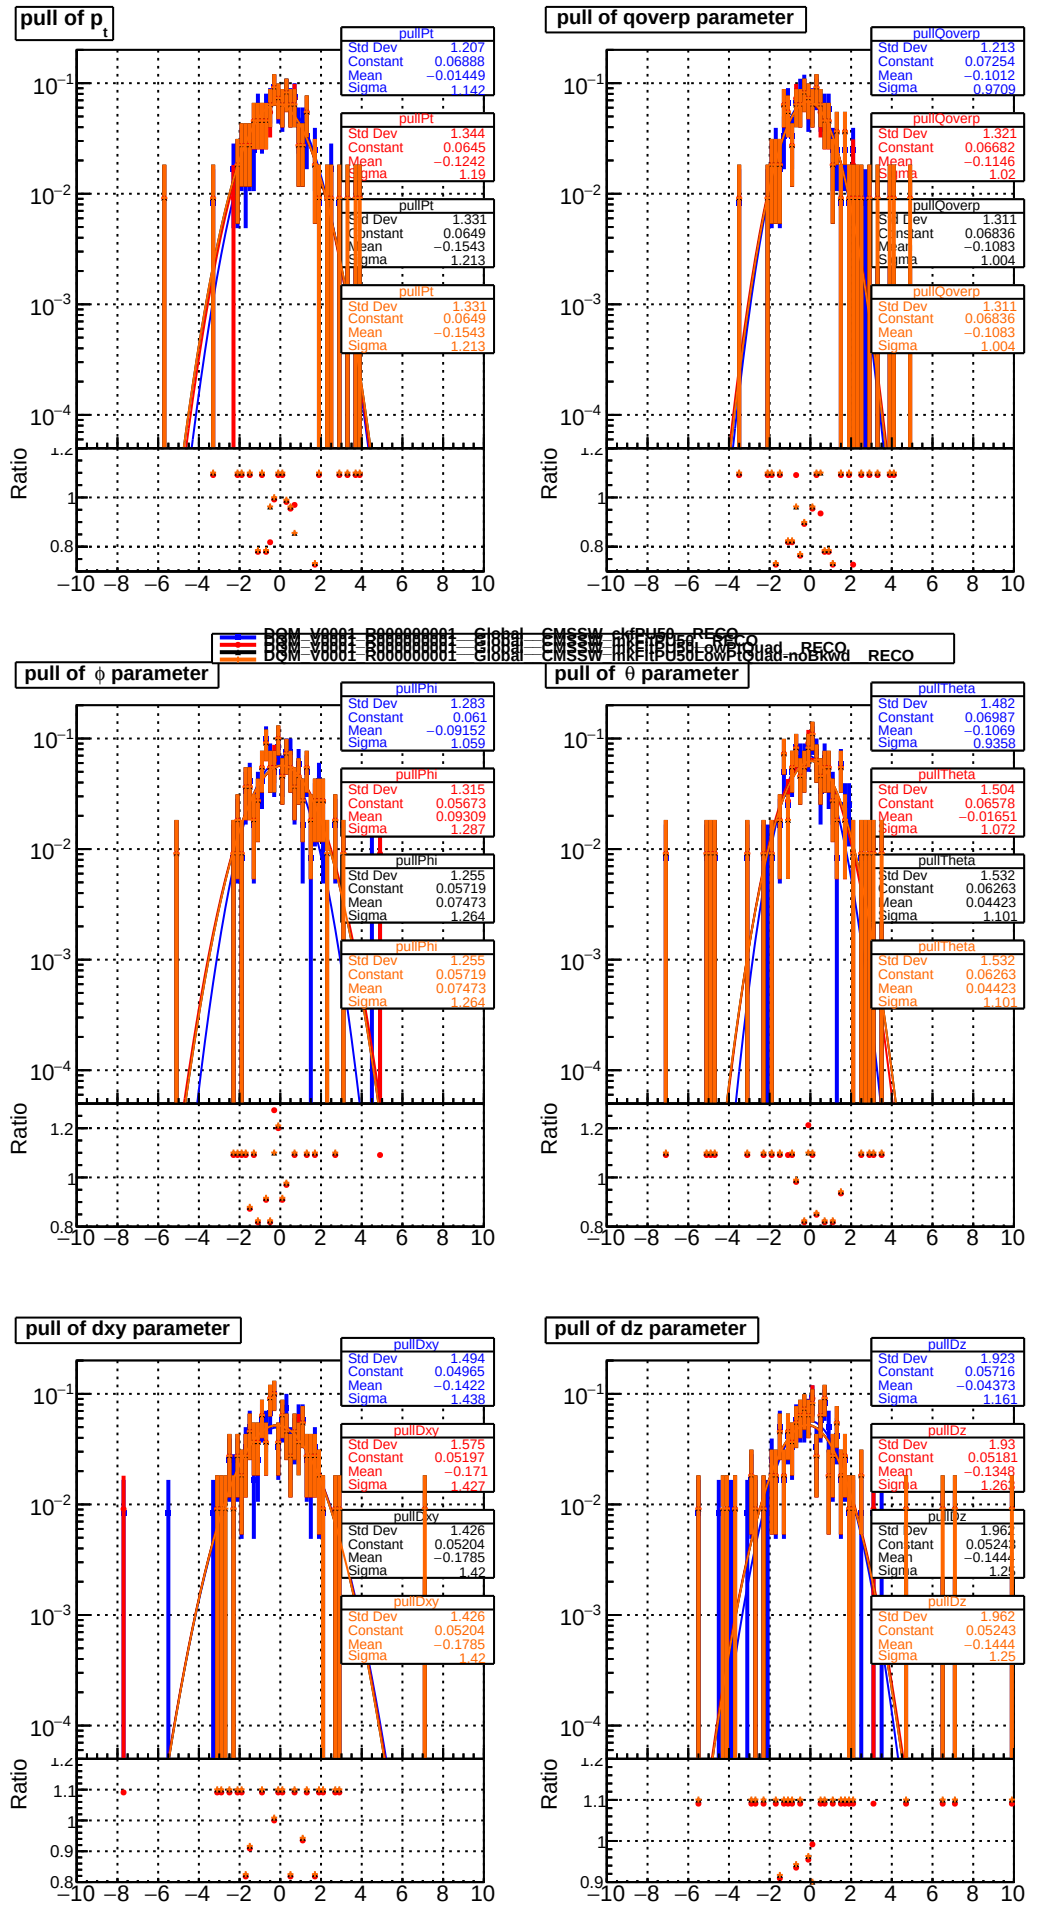
pull of p_t
pullPt
Std Dev 1.207
Constant 0.06888
Mean −0.01449
Sigma 1.142
pullPt
Std Dev 1.344
Constant 0.0645
Mean −0.1242
Sigma 1.19
pullPt
Std Dev 1.331
Constant 0.0649
Mean −0.1543
Sigma 1.213
pullPt
Std Dev 1.331
Constant 0.0649
Mean −0.1543
Sigma 1.213
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.213
Constant 0.07254
Mean −0.1012
Sigma 0.9709
pullQoverp
Std Dev 1.321
Constant 0.06682
Mean −0.1146
Sigma 1.02
pullQoverp
Std Dev 1.311
Constant 0.06836
Mean −0.1083
Sigma 1.004
pullQoverp
Std Dev 1.311
Constant 0.06836
Mean −0.1083
Sigma 1.004
Ratio
DQM V0001 R000000001 Global CMSSW_ckfPU50_RECO
DQM V0001 R000000001 Global CMSSW_mkFitPU50_RECO
DQM V0001 R000000001 Global CMSSW_mkFitPU50_lowPtQuad RECO
DQM V0001 R000000001 Global CMSSW_mkFitPU50_lowPtQuad-noBkwd RECO
pull of ϕ parameter
pullPhi
Std Dev 1.283
Constant 0.061
Mean −0.09152
Sigma 1.059
pullPhi
Std Dev 1.315
Constant 0.05673
Mean 0.09309
Sigma 1.287
pullPhi
Std Dev 1.255
Constant 0.05719
Mean 0.07473
Sigma 1.264
pullPhi
Std Dev 1.255
Constant 0.05719
Mean 0.07473
Sigma 1.264
Ratio
pull of θ parameter
pullTheta
Std Dev 1.482
Constant 0.06987
Mean −0.1069
Sigma 0.9358
pullTheta
Std Dev 1.504
Constant 0.06578
Mean −0.01651
Sigma 1.072
pullTheta
Std Dev 1.532
Constant 0.06263
Mean 0.04423
Sigma 1.101
pullTheta
Std Dev 1.532
Constant 0.06263
Mean 0.04423
Sigma 1.101
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.494
Constant 0.04965
Mean −0.1422
Sigma 1.438
pullDxy
Std Dev 1.575
Constant 0.05197
Mean −0.171
Sigma 1.427
pullDxy
Std Dev 1.426
Constant 0.05204
Mean −0.1785
Sigma 1.42
pullDxy
Std Dev 1.426
Constant 0.05204
Mean −0.1785
Sigma 1.42
Ratio
pull of dz parameter
pullDz
Std Dev 1.923
Constant 0.05716
Mean −0.04373
Sigma 1.161
pullDz
Std Dev 1.93
Constant 0.05181
Mean −0.1348
Sigma 1.261
pullDz
Std Dev 1.962
Constant 0.05243
Mean −0.1444
Sigma 1.25
pullDz
Std Dev 1.962
Constant 0.05243
Mean −0.1444
Sigma 1.25
Ratio