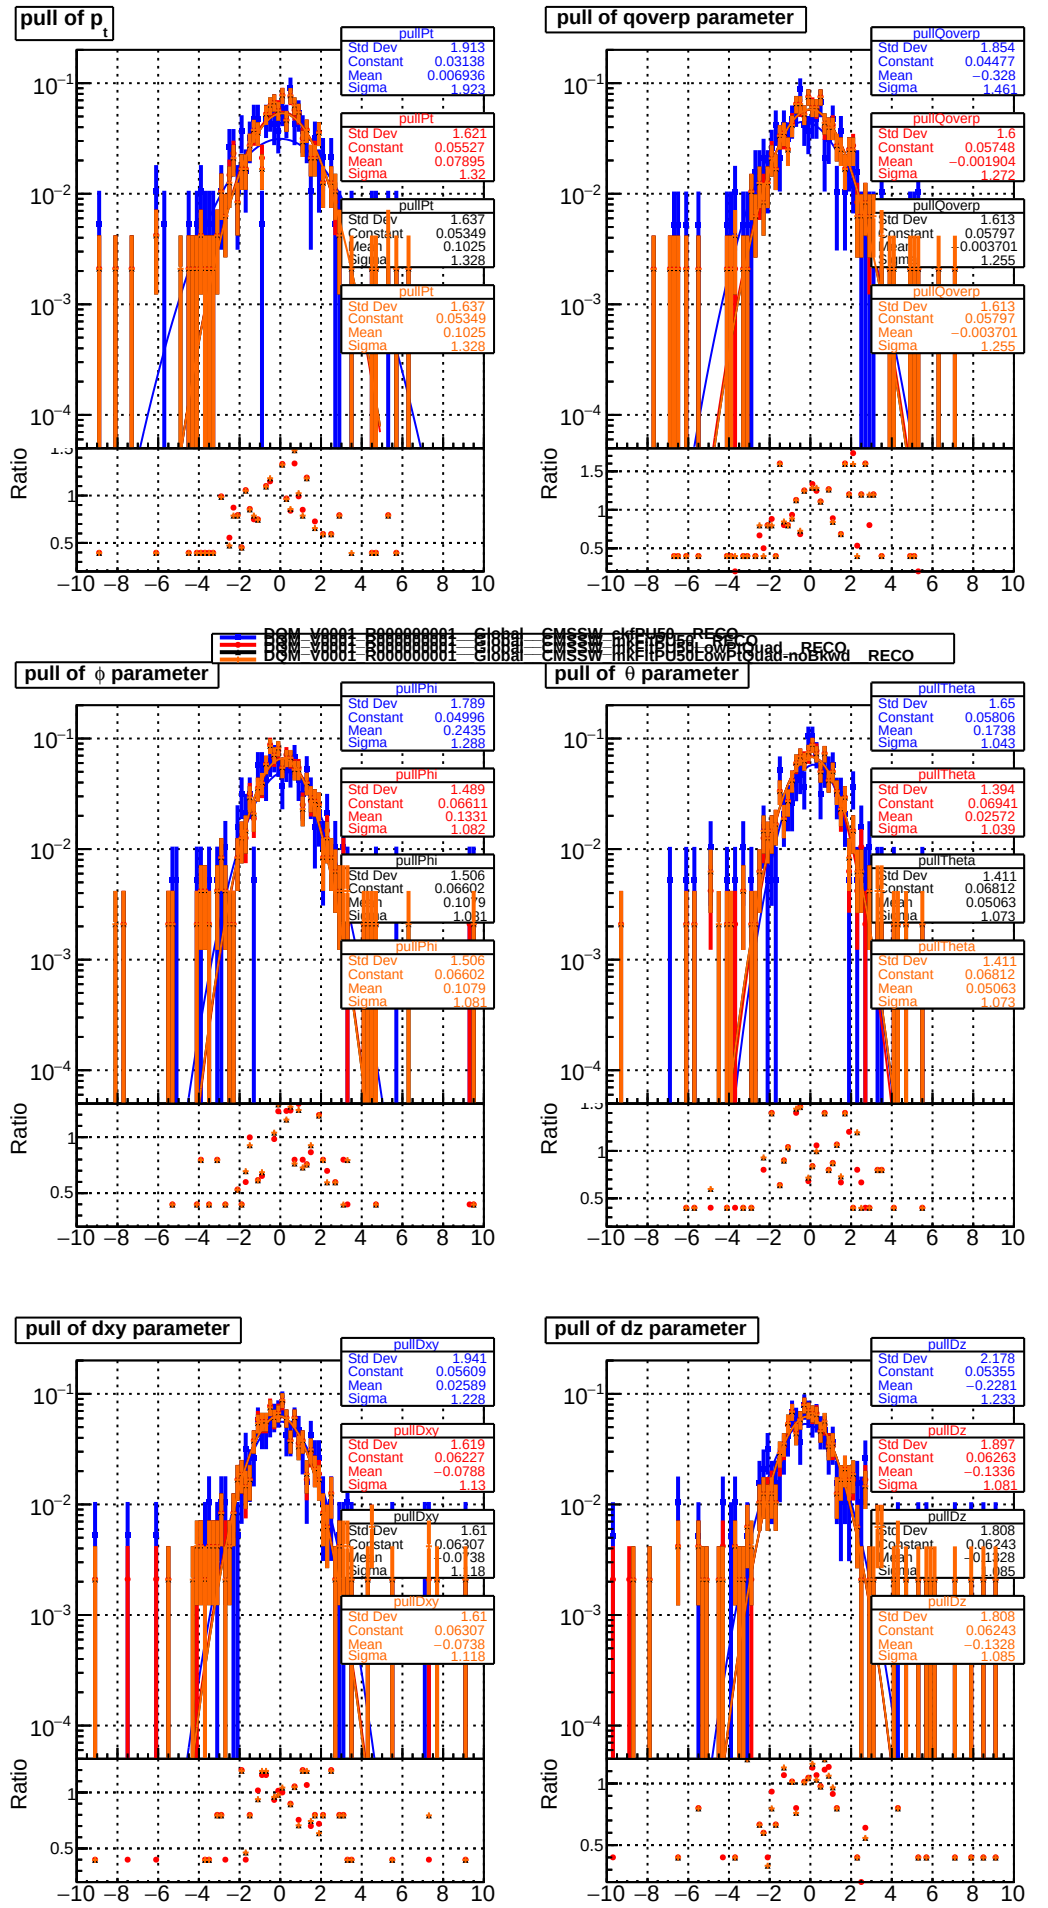
pull of p_t
pullPt
Std Dev 1.913
Constant 0.03138
Mean 0.006936
Sigma 1.923
pullPt
Std Dev 1.621
Constant 0.05527
Mean 0.07895
Sigma 1.32
pullPt
Std Dev 1.637
Constant 0.05349
Mean 0.1025
Sigma 1.328
pullPt
Std Dev 1.637
Constant 0.05349
Mean 0.1025
Sigma 1.328
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.854
Constant 0.04477
Mean −0.328
Sigma 1.461
pullQoverp
Std Dev 1.6
Constant 0.05748
Mean −0.001904
Sigma 1.272
pullQoverp
Std Dev 1.613
Constant 0.05797
Mean −0.003701
Sigma 1.255
pullQoverp
Std Dev 1.613
Constant 0.05797
Mean −0.003701
Sigma 1.255
Ratio
RECO
RECO
pull of ϕ parameter
pullPhi
Std Dev 1.789
Constant 0.04996
Mean 0.2435
Sigma 1.288
pullPhi
Std Dev 1.489
Constant 0.06611
Mean 0.1331
Sigma 1.082
pullPhi
Std Dev 1.506
Constant 0.06602
Mean 0.1079
Sigma 1.081
pullPhi
Std Dev 1.506
Constant 0.06602
Mean 0.1079
Sigma 1.081
Ratio
pull of θ parameter
pullTheta
Std Dev 1.65
Constant 0.05806
Mean 0.1738
Sigma 1.043
pullTheta
Std Dev 1.394
Constant 0.06941
Mean 0.02572
Sigma 1.039
pullTheta
Std Dev 1.411
Constant 0.06812
Mean 0.05063
Sigma 1.073
pullTheta
Std Dev 1.411
Constant 0.06812
Mean 0.05063
Sigma 1.073
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.941
Constant 0.05609
Mean 0.02589
Sigma 1.228
pullDxy
Std Dev 1.619
Constant 0.06227
Mean −0.0788
Sigma 1.13
pullDxy
Std Dev 1.61
Constant 0.06307
Mean −0.0738
Sigma 1.118
pullDxy
Std Dev 1.61
Constant 0.06307
Mean −0.0738
Sigma 1.118
Ratio
pull of dz parameter
pullDz
Std Dev 2.178
Constant 0.05355
Mean −0.2281
Sigma 1.233
pullDz
Std Dev 1.897
Constant 0.06263
Mean −0.1336
Sigma 1.081
pullDz
Std Dev 1.808
Constant 0.06243
Mean −0.1328
Sigma 1.085
pullDz
Std Dev 1.808
Constant 0.06243
Mean −0.1328
Sigma 1.085
Ratio