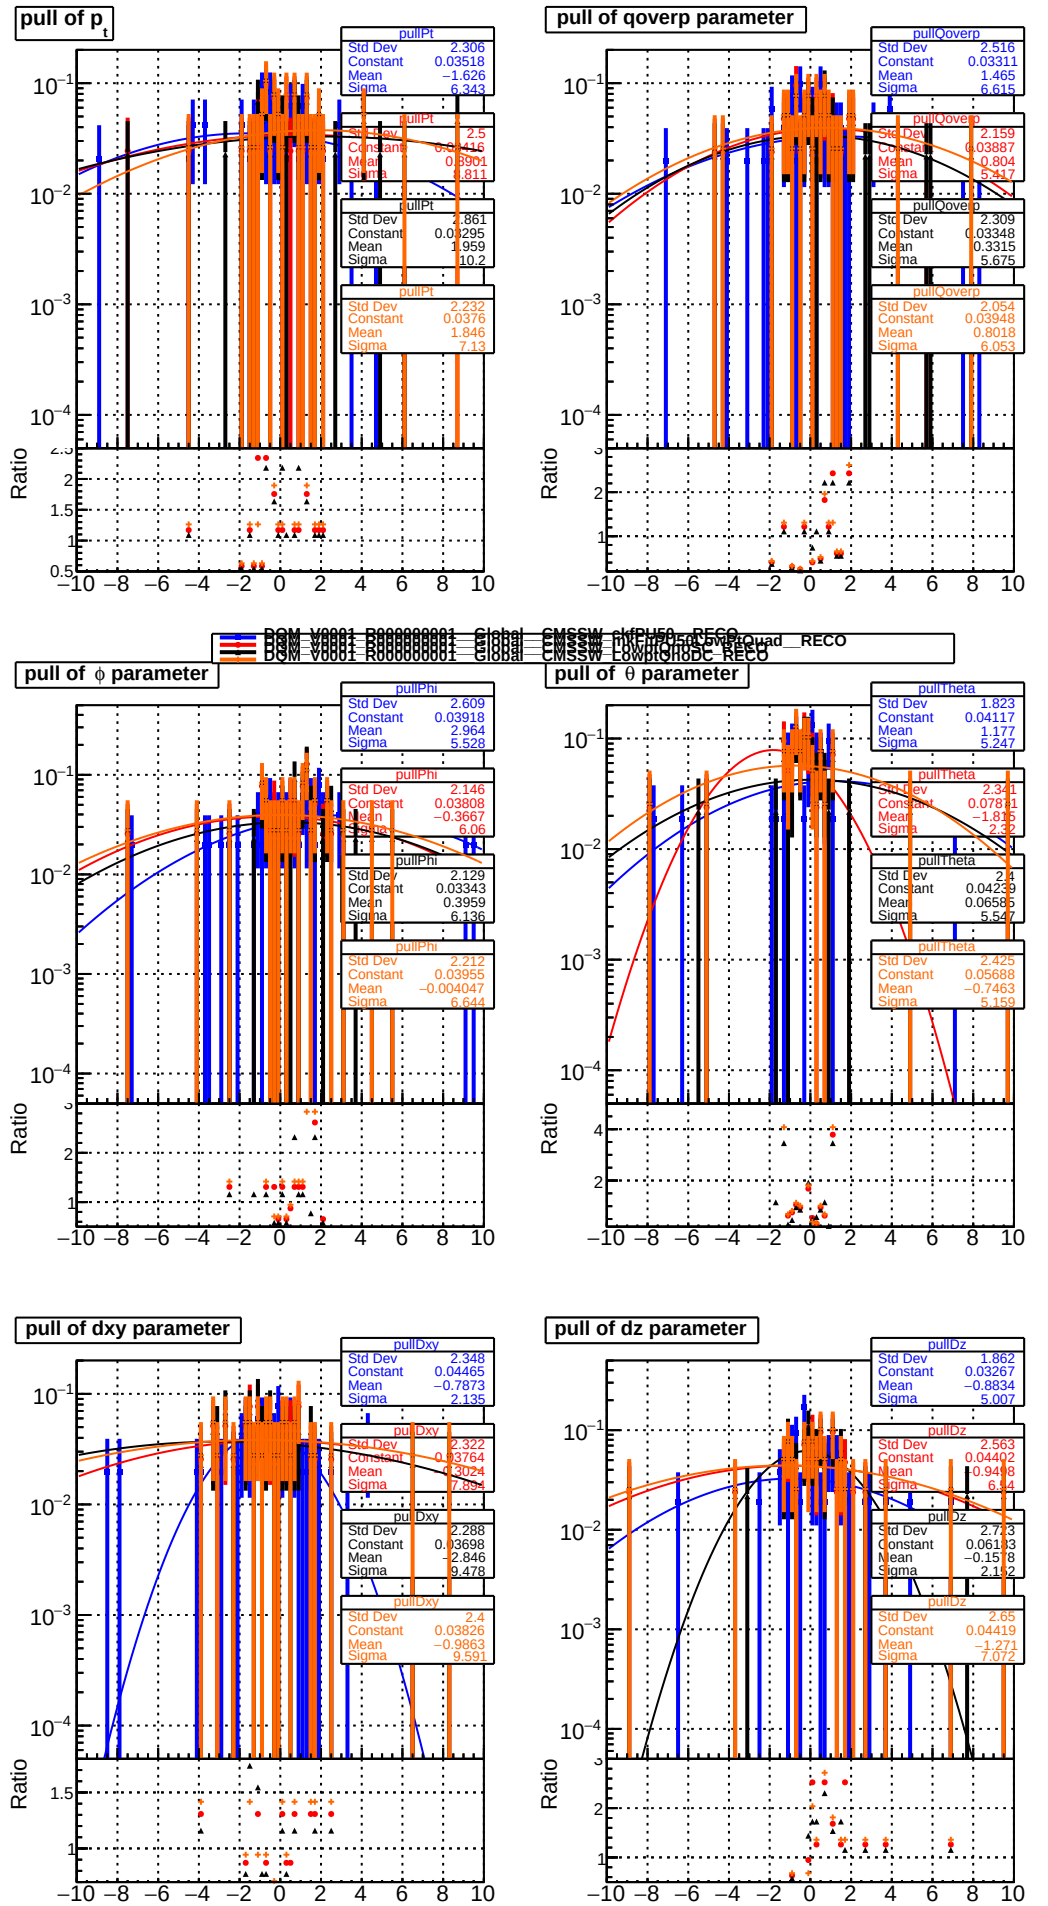
pull of p_t
pullPt
Std Dev 2.306
Constant 0.03518
Mean −1.626
Sigma 6.343
pullPt
Std Dev 2.5
Constant 0.04416
Mean 0.8901
Sigma 6.811
pullPt
Std Dev 2.861
Constant 0.01295
Mean 1.959
Sigma 10.2
pullPt
Std Dev 2.232
Constant 0.0376
Mean 1.846
Sigma 7.13
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.516
Constant 0.03311
Mean 1.465
Sigma 6.615
pullQoverp
Std Dev 2.159
Constant 0.03887
Mean 0.804
Sigma 5.417
pullQoverp
Std Dev 2.309
Constant 0.03348
Mean 0.3315
Sigma 5.675
pullQoverp
Std Dev 2.054
Constant 0.03948
Mean 0.8018
Sigma 6.053
Ratio
DQM V0001 R000000001 Global CMSSW_initHLT50_ctfWithMaterialTracksP5Quad__RECO
DQM V0001 R000000001 Global CMSSW_LowPtQuadD__RECO
DQM V0001 R000000001 Global CMSSW_LowPtQuadC__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.609
Constant 0.03918
Mean 2.964
Sigma 5.528
pullPhi
Std Dev 2.146
Constant 0.03808
Mean −0.3667
Sigma 6.06
pullPhi
Std Dev 2.129
Constant 0.03343
Mean 0.3959
Sigma 6.136
pullPhi
Std Dev 2.212
Constant 0.03955
Mean −0.004047
Sigma 6.644
Ratio
pull of θ parameter
pullTheta
Std Dev 1.823
Constant 0.04117
Mean 1.177
Sigma 5.247
pullTheta
Std Dev 2.341
Constant 0.07831
Mean −1.815
Sigma 2.32
pullTheta
Std Dev 2.4
Constant 0.04239
Mean 0.06585
Sigma 5.547
pullTheta
Std Dev 2.425
Constant 0.05688
Mean −0.7463
Sigma 5.159
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.348
Constant 0.04465
Mean −0.7873
Sigma 2.135
pullDxy
Std Dev 2.322
Constant 0.03764
Mean 0.3024
Sigma 7.854
pullDxy
Std Dev 2.288
Constant 0.03698
Mean −2.846
Sigma 9.478
pullDxy
Std Dev 2.4
Constant 0.03826
Mean −0.9863
Sigma 9.591
Ratio
pull of dz parameter
pullDz
Std Dev 1.862
Constant 0.03267
Mean −0.8834
Sigma 5.007
pullDz
Std Dev 2.563
Constant 0.04402
Mean −0.9498
Sigma 6.34
pullDz
Std Dev 2.723
Constant 0.06193
Mean −0.1578
Sigma 2.192
pullDz
Std Dev 2.65
Constant 0.04419
Mean −1.271
Sigma 7.072
Ratio